

F:\Projects\CPMTRZ\Drawings\Site\CPMTRZ_Base.dwg -- 1 COVER Mor 18, '25 -- 11:33am

GENERAL NOTES

1. ALL MATERIALS AND METHODS OF CONSTRUCTION SHALL CONFORM TO TOWN OF ZEBULON ENGINEERING DESIGN SPECIFICATIONS AND CONSTRUCTION STANDARDS, AND CITY OF RALEIGH FOR WATER AND SANITARY SEWER.
2. CONTRACTOR SHALL HAVE NORTH CAROLINA ONE CALL (1-800-632-4949) LOCATE ALL EXISTING UTILITIES PRIOR TO BEGINNING CONSTRUCTION.
3. CONTRACTOR SHALL VERIFY THE LOCATION AND DEPTH OF ALL EXISTING UTILITIES AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES OR CONFLICTS PRIOR TO BEGINNING CONSTRUCTION.
4. BOUNDARY & EXISTING TOPOGRAPHY SURVEY PROVIDED BY TAYLOR LAND CONSULTING, FEBRUARY 2021.
5. THERE ARE NO PROTECTED WETLANDS WITHIN THE PROJECT SITE.
6. ALL CONSTRUCTION SHALL CONFORM TO A.D.A. STANDARDS
7. PLAN IS SUBJECT TO REVISIONS DURING CONSTRUCTION DRAWING APPROVAL PROCESS.
8. CONSTRUCTION DRAWING APPROVAL IS REQUIRED BEFORE CONSTRUCTION ON THIS PROJECT MAY BEGIN. THE DEVELOPER SHALL BE RESPONSIBLE FOR PAYING ALL APPLICABLE DEVELOPMENT FEES PRIOR TO CONSTRUCTION DRAWING APPROVAL.
9. ALL ROADWAY INFRASTRUCTURE CONSTRUCTION SHALL CONFORM TO THE TOWN OF ZEBULON STANDARDS AND SPECIFICATIONS.
10. CONTRACTOR SHALL CONTACT THE TOWN OF ZEBULON TO SCHEDULE A PRE-CONSTRUCTION MEETING PRIOR TO BEGINNING CONSTRUCTION.
11. ALL ROADWAY, SIDEWALK AND STORM DRAINAGE IMPROVEMENTS IN ROW OR DEDICATED PUBLIC EASEMENTS WILL BE REQUIRED TO BE DEDICATED TO THE TOWN OF ZEBULON AT COMPLETION OF THE PROJECT.
12. AS-BUILT SITE PLANS FOR ROADWAY AND UTILITY WORK MUST BE SUBMITTED AND APPROVED PRIOR TO FINAL ACCEPTANCE. CONTRACTOR IS RESPONSIBLE FOR MAINTAINING RED-LINE LINE DRAWINGS.
13. DEVELOPER/OWNER IS RESPONSIBLE FOR CONTRACTING WITH THIRD PARTY NCDOT CERTIFIED TESTING FIRM. THE FIRM MUST BE APPROVED BY TOWN OF ZEBULON. MATERIAL TESTING IS REQUIRED FOR ALL ROADWAY WORK. FINAL REPORTING AND CERTIFICATION (SEALED) IS REQUIRED AT COMPLETION OF THE PROJECT BY THE GEO-TECHNICAL ENGINEER. TESTING IS REQUIRED FOR SUBGRADE, ROADWAY STONE, ASPHALT AND CURB AND GUTTER PER TOWN OF ZEBULON SPECS.
14. ALL CURB AND GUTTER REQUIRES CONCRETE TESTING FOR THE FOLLOWING REQUIREMENTS (SECTION 2.1.1):

i. 4" CONCRETE SLUMP

ii. TEMPERATURE -- 50 AND 90 DEGREES

iii. AIR MIXTURE RANGE 3.5% TO 6.5%

iv. STRUCTURAL BREAK TEST -- 7,14,28 DAYS @ 3,000PSI @ 28 DAYS

v. SAMPLES EVERY 1,000 LF OF CURB AND GUTTER TO ENSURE QUALITY


vi. MAX WATER-CEMENT RATIO BY WEIGHT: 0.594

vii. MINIMUM CEMENT CONTENT (LBS/CY): 602
15. CONCRETE SIDEWALK TESTING IS NOT REQUIRED; UNLESS CONSTRUCTION INSPECTOR DETERMINES THAT QUALITY IS INFERIOR AND DOES NOT MEET INDUSTRY STANDARDS. CONTRACTOR MUST MAINTAIN A 4" SLUMP FOR ALL SIDEWALK WORK. AIR TEMPERATURES AT PLACEMENT MUST BE 40 DEGREES AND RISING. SURFACE TEMPERATURES SHALL BE 50 DEGREES OR GREATER. (SECTION 2.2.2 E)
16. ASPHALT CORE SAMPLES SHOULD BE SELECTED EVERY 300 FEET OR MINIMUM OF TWO CORES PER ROADWAY FOR ANALYSIS OF THICKNESS AND DENSITY. ASPHALT MIX SF 9.5 B SHOULD BE COMPACTED TO A MINIMUM OF 92% OF THE MAXIMUM SPECIFIC GRAVITY. ASPHALT MIX OF 9.5 A SHOULD BE COMPACTED TO A MINIMUM OF 90% OF THE MAXIMUM SPECIFIC GRAVITY. THE CONTRACTOR IS RESPONSIBLE FOR DEVELOPING/CREATING A CHART/MAP OF THE CORED LOCATIONS FOR SUBMITTAL WITH THE TESTING. CORES WILL BE RANDOMLY TAKEN ALONG THE LONGITUDINAL DIRECTIONS ACROSS THE ROADWAY BUT NOT WITHIN ONE FOOT OF THE EDGE OF PAVEMENT. THE RESULTS OF THE SAMPLES GREATER THAN TEN FEET APART WILL NOT BE AVERAGED AND USED TO VERIFY COMPLIANCE WITH THE TOWN OF ZEBULON SPECIFICATIONS. (SECTION 2.6.H)
17. ROADWAY SUB-GRADE TESTING/INSTALLATION REQUIREMENTS: 98% STANDARD PROCTOR ON ALL SOILS EVERY 300'. ALL LOCATIONS TESTED SHALL MEET 98% TESTING REQUIREMENTS. AVERAGING OF DENSITY SCORES TO MEET STANDARD IS NOT ALLOWED. SUCCESSFUL PROOF ROLLS REQUIRED FOR ALL SUB-GRADE SOILS. (SECTION 2.5.2 A)
18. ROADWAY ABC STONE TESTING/INSTALLATION REQUIREMENTS: 98% STANDARD PROCTOR ON ALL ROADWAY ABC EVERY 150 FEET. ALL LOCATIONS TESTED SHALL MEET THE 98% TESTING REQUIREMENTS. AVERAGING OF DENSITY SCORES TO MEET STANDARDS IS NOT ALLOWED. SUCCESSFUL PROOF ROLLS REQUIRED FOR ALL ROADWAY ABC STONE. (SECTION 2.5.3 A)
19. IF THE ROADWAY SUBGRADE OR ROADWAY STONE IS EXPOSED TO PRECIPITATION (RAIN, SNOW, ICE, ETC.) GREATER THAN 0.10 OF AN INCH BEFORE IT IS COVERED WITH ABC STONE OR ASPHALT THE EXPOSED SUBGRADE OR ABC STONE MUST PASS AN ADDITIONAL PROOF ROLL. ADDITIONAL DENSITY IS NOT REQUIRED.
20. IMPERVIOUS SURFACE COVERAGE SHALL NOT EXCEED IMPERVIOUS SHOWN ON THE LOT. IMPERVIOUS SURFACE LIMITS WILL BE STRICTLY ENFORCED INTO PERPETUITY.
21. PRIOR TO BUILDING PERMITS A PLAT MUST BE RECORDED AT THE WAKE COUNTY REGISTER OF DEEDS OFFICE FOR ALL UTILITY EASEMENT DEDICATIONS.

ZONING CONDITIONS

1. USES SHALL BE LIMITED TO SINGLE FAMILY DETACHED, SINGLE FAMILY ATTACHED, AND PERMITTED ACCESSORY USES.
2. MINIMUM SINGLE FAMILY ATTACHED UNIT SHALL BE A MINIMUM OF 1,200 S.F..
3. MINIMUM DRIVEWAY STEM LENGTH SHALL BE 20'.
4. MACK TODD ROAD -- DEDICATE 5' OF RIGHT OF WAY. BUILD ½ OF THE ULTIMATE 70' RIGHT-OF-WAY SECTION. ROADWAY SECTION WILL INCLUDE 5' WIDE SIDEWALK FOR THE FULL LENGTH OF PROPERTY.
5. PROVIDE A 10' WIDE TYPE A BUFFER ALONG PIN 1795-82-9159 WHERE SINGLE FAMILY ATTACHED UNITS ARE LOCATED ADJACENT TO THE SHARED PROPERTY LINE AS SHOWN ON CONCEPT PLAN.
6. PROVIDE FOUNDATION PLANTS ALONG THE FRONT FAÇADE OF THE UNITS THAT FRONT ON MACK TODD ROAD IN LIEU OF A STREETSCAPE BUFFER. A MINIMUM OF THE FOLLOWING SHALL BE PLANTED: 3 EVERGREEN SHRUBS (12" HEIGHT @ INSTALLATION) PER UNIT AND SHALL BE A PLANT THAN CAN BE MAINTAINED AT 18" HEIGHT WHERE LOCATED IN THE SIGHT TRIANGLE. PLANT SELECTION TO BE DETERMINED AT SITE PLAN. SEE DETAIL ON L-2 FOR TYPICAL EXAMPLE OF FOUNDATION LANDSCAPING.
7. SLAB FOUNDATION SHALL BE PERMITTED.
8. VINYL SIDING SHALL NOT BE PERMITTED BUT VINYL ACCENTS, SUCH AS WINDOWS, DECORATIVE TRIM, AND OTHER ELEMENTS SHALL BE PERMITTED.
9. DEVELOPER SHALL PROVIDE EASEMENT FOR AND CONSTRUCT THE SECTION OF THE CORRIDOR 8 GREENWAY THAT RUNS ALONG THE EAST SIDE OF THE DEVELOPMENT.
10. NATIVE TREES SHALL BE USED FOR ANY STREET TREE OR BUFFER PLANTING.
11. 50% OF THE REQUIRED OPEN SPACE SHALL BE DEDICATED TO URBAN OPEN SPACE.

MADISON RIDGE
TOWNHOMES
CONSTRUCTION PLANS
ZEBULON , NORTH CAROLINA

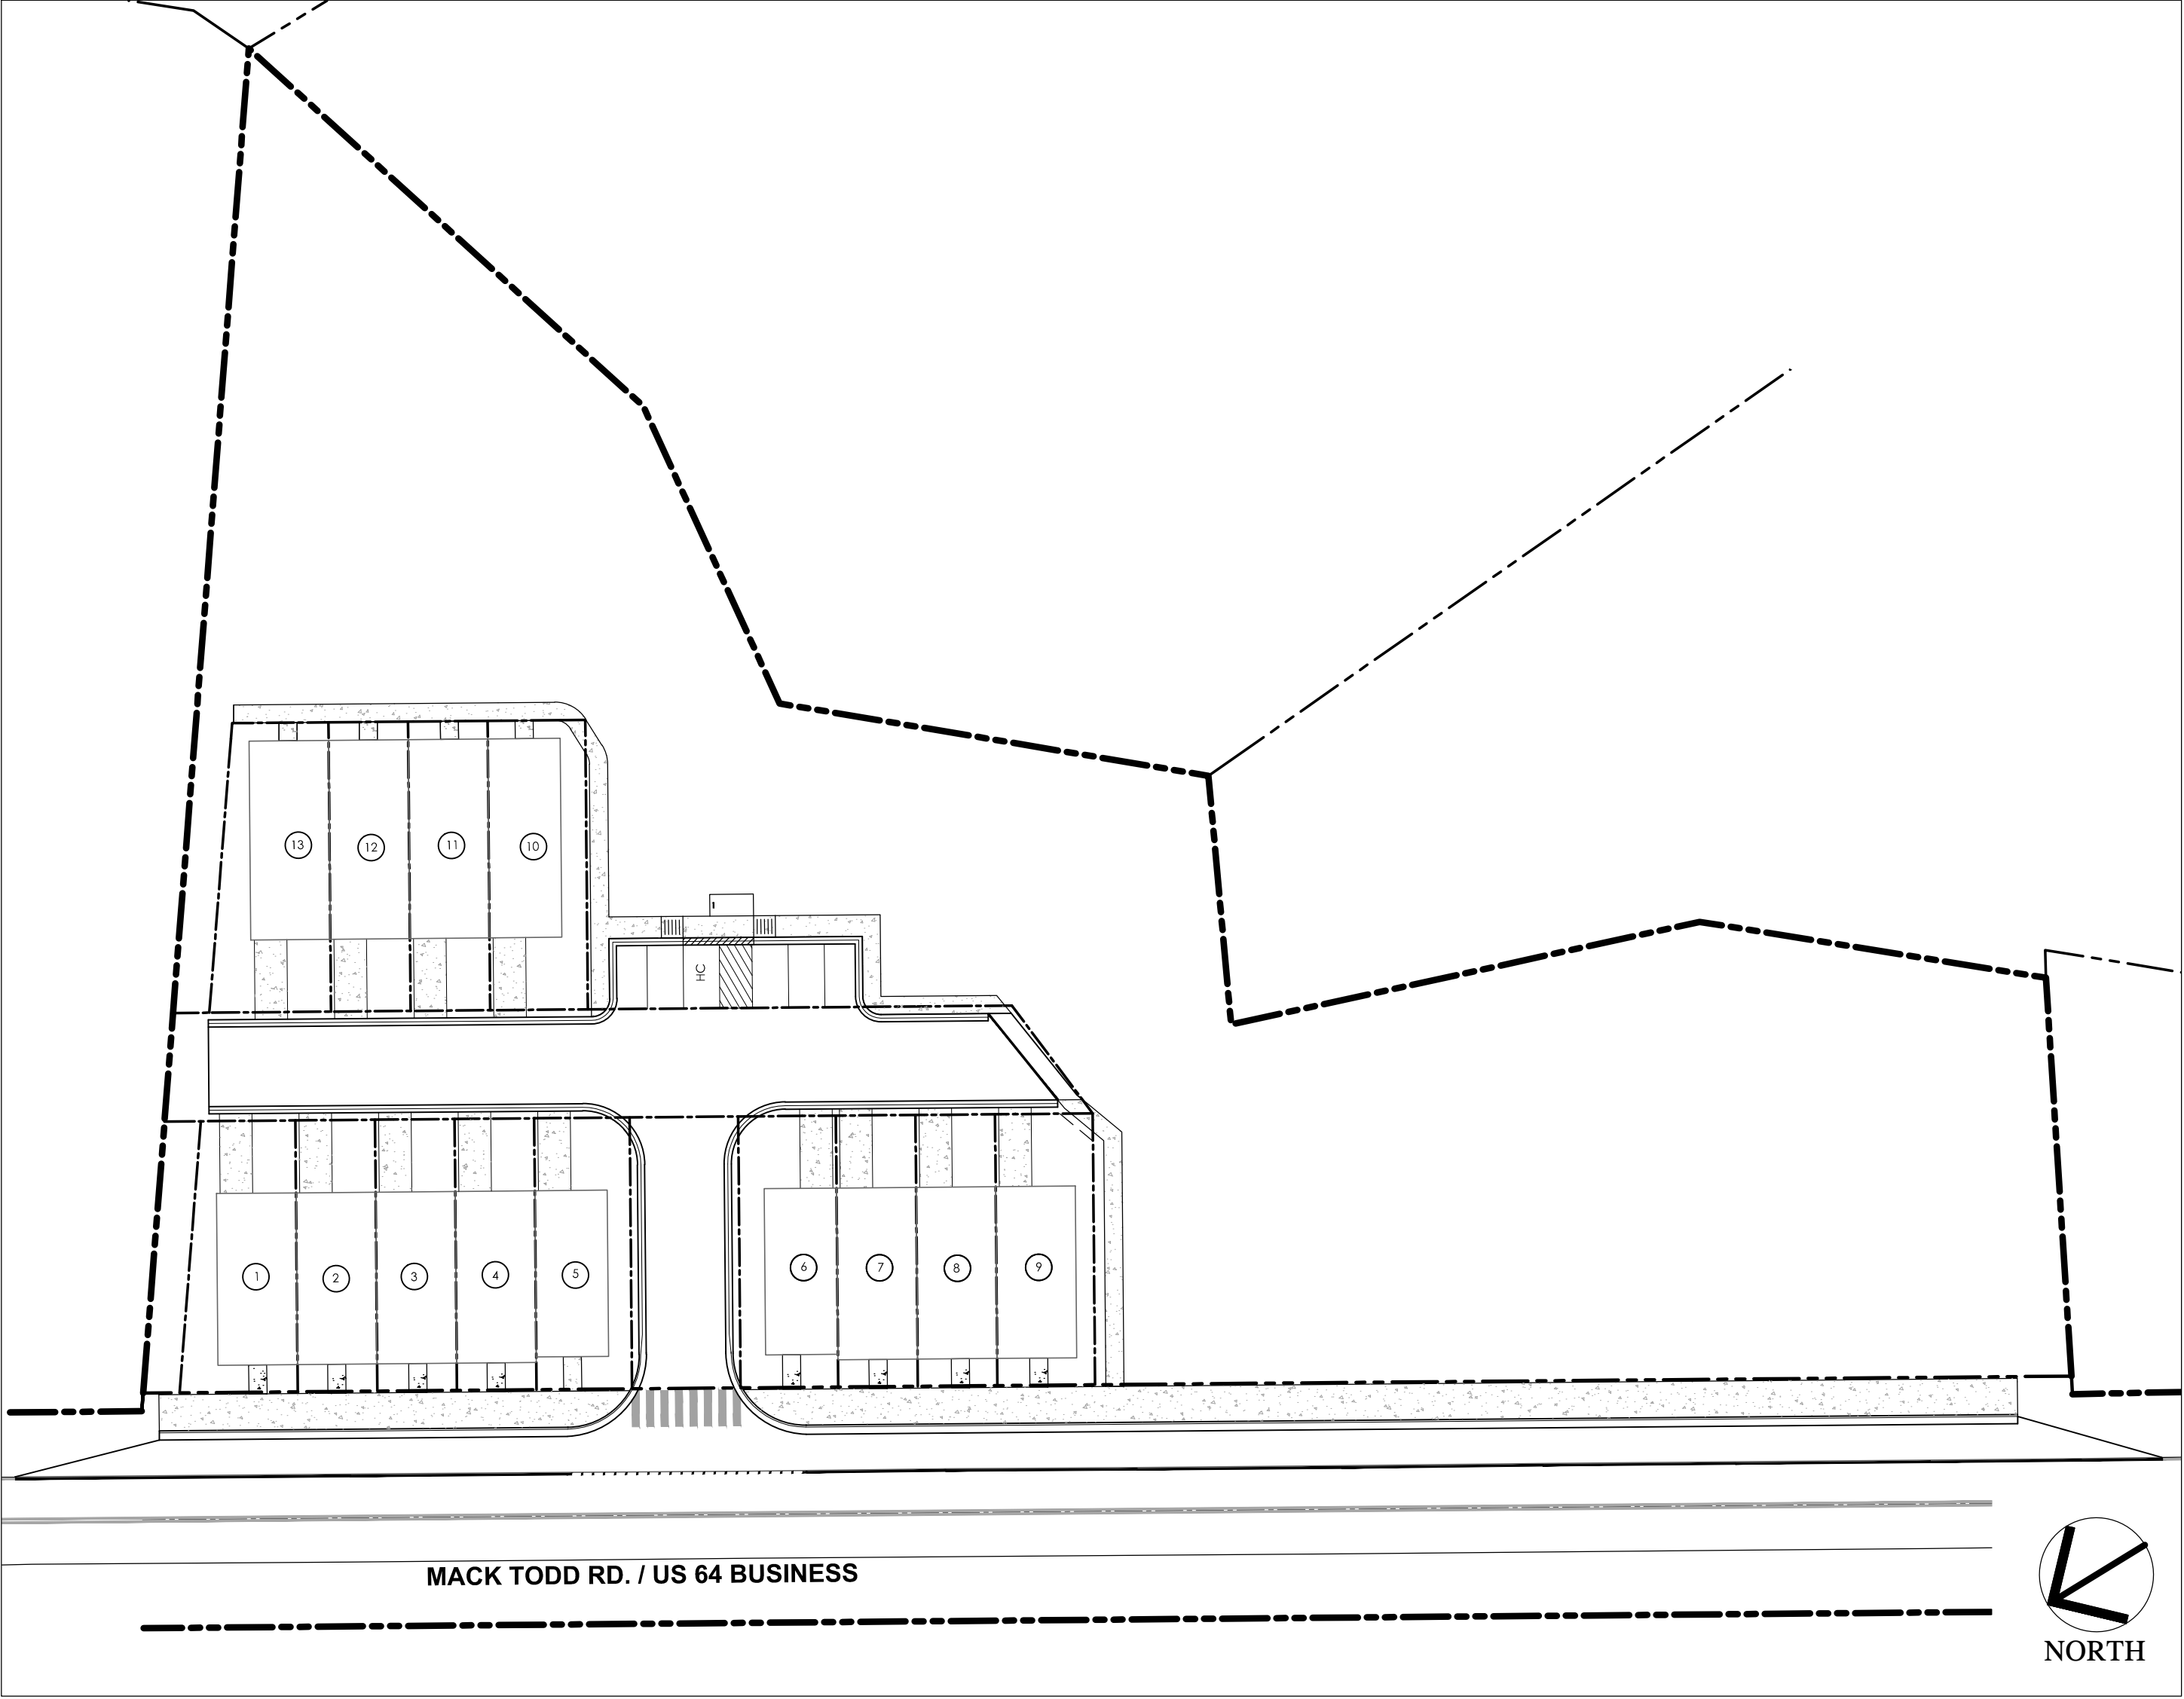

VICINITY MAP SCALE: 1"=40'



VICINITY MAP NTS

SITE PROJECT DATA

1. DEVELOPMENT NAME:

MADISON RIDGE TOWNHOMES
2. WAKE COUNTY P.I.N.s:

1795-82-7060
3. TOTAL NUMBER OF LOTS:

13 TOWNHOME LOTS
4. TRACT AREA:

2.30 AC
5. ZONING:

PD
6. INSIDE TOWN LIMITS:

YES
7. WATERSHED:

NEUSE RIVER BASIN
8. DISTURBED AREA:

1.6 AC
9. PROPOSED IMPERVIOUS SURFACE

STREETS/SIDEWALKS = 0.28 AC
LOTS = 0.41 AC± (1,365 SF/LOT)
TOTAL = 0.69 AC±
10. FEMA INFORMATION

THE SITE IS NOT WITHIN A FEMA FLOOD ZONE PER MAPS # 3720179700K -- PANEL 1797
EFFECTIVE DATE 07/19/2022
11. OWNER / DEVELOPER:

CAPITAL PROPERTIES OF NORTH CAROLINA LLC
1540 GRAND WILLOW WAY
RALEIGH, NC 27614
(919) 779-9664
CONTACT: MICHAEL NEDRIGA
12. CONTACT PERSON

PIEDMONT LAND DESIGN, LLP
c/o MIKE SCHNEIDER
8522-204 SIX FORKS ROAD
RALEIGH , NORTH CAROLINA 27615
(919) 845-7600 (PHONE)
(919) 845-7703 (FAX)
MikeS@piedmontlanddesign.com (E-MAIL)

** SEE SITE PLAN FOR ADDITIONAL SITE DATA

DRAWING INDEX

- SITE 1

COVER SHEET
- SITE 2

EXISTING CONDITIONS PLAN
- L-2

SITE PLAN
- L-3

LANDSCAPE PLAN
- SITE 4

GRADING AND DRAINAGE PLAN
- SITE 5

UTILITY PLAN
- SITE 6

STAGE ONE EROSION CONTROL PLAN
- SITE 7

STAGE TWO EROSION CONTROL PLAN
- SITE 8

STREET A & B PLAN AND PROFILES
- SITE 9

SCM DETAILS & PLANTING PLAN
- SITE 10

ROAD WIDENING PLAN
- SITE 11

ROAD CROSS SECTIONS
- SITE 12

DETAILS
- SITE 13

DETAILS
- SITE 14

DETAILS
- SITE 15

DETAILS
- SITE 16

DETAILS
- SITE 17

DETAILS
- SITE 18

DETAILS
- SITE 19

DETAILS
- SITE 20

DETAILS

LOT QUANTITIES

LOTS	QUANTITY
TOWN HOMES	13 LOTS

PUBLIC STREET QUANTITIES

STREET	LENGTH
STREET A	0 LF
STREET B	0 LF

STREET LIGHT QUANTITIES

TYPE	QUANTITY
STREET LIGHTS	0

PUBLIC STORM QUANTITIES

SIZE	LENGTH
15"	381 LF
24"	30 LF
TOTAL	411 LF

HOA STORM QUANTITIES

SIZE	LENGTH
15"	306 LF
18"	40 LF
TOTAL	340 LF

PUBLIC WATER QUANTITIES

SIZE	LENGTH
6" DIP	333 LF

NUMBER OF SERVICE CONNECTIONS = 14
NUMBER OF STUBS = 1
NUMBER OF MAIN TIE-IN POINTS = 1
NUMBER OF SERVICE ABANDONMENTS = 0

PUBLIC SEWER QUANTITIES

SIZE	LENGTHS
8" PVC	301 LF
TOTAL	301 LF

NUMBER OF SERVICE CONNECTIONS = 13
NUMBER OF STUBS = 0
NUMBER OF MAIN TIE-IN POINTS = 1
NUMBER OF SERVICE ABANDONMENTS = 0

SEWER FLOW DATA

NUMBER OF BEDROOMS= 52
PROPOSED SEWER FLOW= 52 X 75 GPD/BR= 3,900 GPD

EROSION CONTROL, STORMWATER
AND FLOODPLAIN MANAGEMENT

APPROVED

EROSION CONTROL ☐ SEC-
STORMWATER MGMT. ☐ SWF-
FLOOD STUDY ☐ SWF-
DATE _____



ENVIRONMENTAL CONSULTANT SIGNATURE

ATTENTION CONTRACTORS

The Contractor responsible for the extension of water, sewer, and/or reuse, as approved in these plans, is responsible for contacting the Public Utilities Inspector at 919-996-3245 or <https://cityworks.raleighnc.gov/contractors/New> and schedule a Pre-construction meeting prior to beginning any construction. Raleigh Water must be contacted at (919) 996-4540 at least twenty-four hours prior to beginning any work activity around critical water and sewer infrastructure.

Failure to notify the Divisions in advance of beginning construction, will result in the issuance of monetary fines, and require reinstallation of any water or sewer facilities not inspected as a result of this notification failure.

Failure to call for Inspection, install a downstream plug, have permitted plans on the jobsite, or any other violation of City of Raleigh Standards will result in a fine and possible exclusion from future work in the City of Raleigh.

CITY OF RALEIGH - PLANS AUTHORIZED FOR CONSTRUCTION

Electronic Approval: This approval is being issued electronically. This approval is valid only upon the signature of a City of Raleigh Review Officer below. The City will retain a copy of the approved plans. Any work authorized by this approval must proceed in accordance with the plans kept on file with the City. This electronic approval may not be edited once issued. Any modification to this approval once issued will invalidate this approval.

City of Raleigh Development Approval _____
Raleigh Water Review Officer _____

Public

Water Distribution / Extension System

The City of Raleigh consents to the connection and extension of the City's public water system as shown on this plan. The material and Construction methods used for this project shall conform to the standards and specifications of the City's Public Utilities Handbook.

City of Raleigh
Public Utilities Department Permit # **W-XXXX**

Authorization to Construct See digital signature

Public

Sewer Collection / Extension System

The City of Raleigh consents to the connection and extension of the City's public sewer system as shown on this plan. The material and Construction methods used for this project shall conform to the standards and specifications of the City's Public Utilities Handbook.


City of Raleigh
Public Utilities Department Permit # **S-XXXX**

Authorization to Construct See digital signature

P.L.D.

PIEDMONT LAND DESIGN, PLLC

8522-204 SIX FORKS ROAD
RALEIGH, NORTH CAROLINA 27615
919.845.7600 PHONE
919.845.7703 FAX
ENGR. FIRM LICENSE NO. F-0843

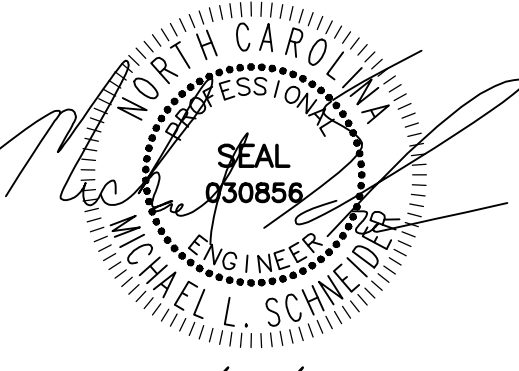

2/04/25

MADISON RIDGE TOWNHOMES

901 MACK TODD ROAD
ZEBULON, NORTH CAROLINA

ISSUED: 04 FEB 2025


REVISIONS:

DRAWN BY: MLS
CHECKED BY: MLS


PROJECT: CPMTRZ

COVER SHEET

DWG. NO. SITE 1

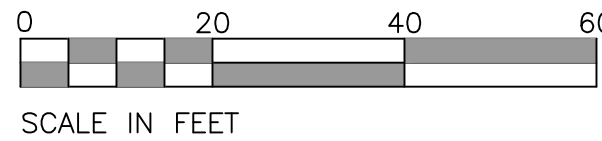

1. ALL MATERIALS AND METHODS OF CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE TOWN OF ZEBULON AND THE STATE OF NORTH CAROLINA STANDARDS AND SPECIFICATIONS.
2. CONTRACTOR SHALL HAVE NORTH CAROLINA ONE CALL (1-800-632-4949) LOCATE ALL EXISTING UTILITIES PRIOR TO BEGINNING CONSTRUCTION.
3. CONTRACTOR SHALL VERIFY THE LOCATION AND DEPTH OF ALL EXISTING UTILITIES AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES OR CONFLICTS PRIOR TO BEGINNING CONSTRUCTION.
4. CONTRACTOR IS RESPONSIBLE FOR REMOVING OR RELOCATING ALL UTILITIES IN CONFLICT WITH NEW CONSTRUCTION. CONTRACTOR SHALL COORDINATE WITH UTILITY COMPANIES PRIOR TO DISTURBANCE.
5. CONTRACTOR SHALL DISPOSE OF ALL MATERIALS IN ACCORDANCE WITH ALL LOCAL AND STATE REGULATIONS.

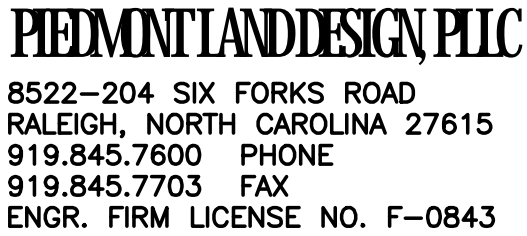


ISSUED: 04 FEB 2025

[illegible]

PROJECT: CPMTRZ

DWG. NO. **SITE 2**

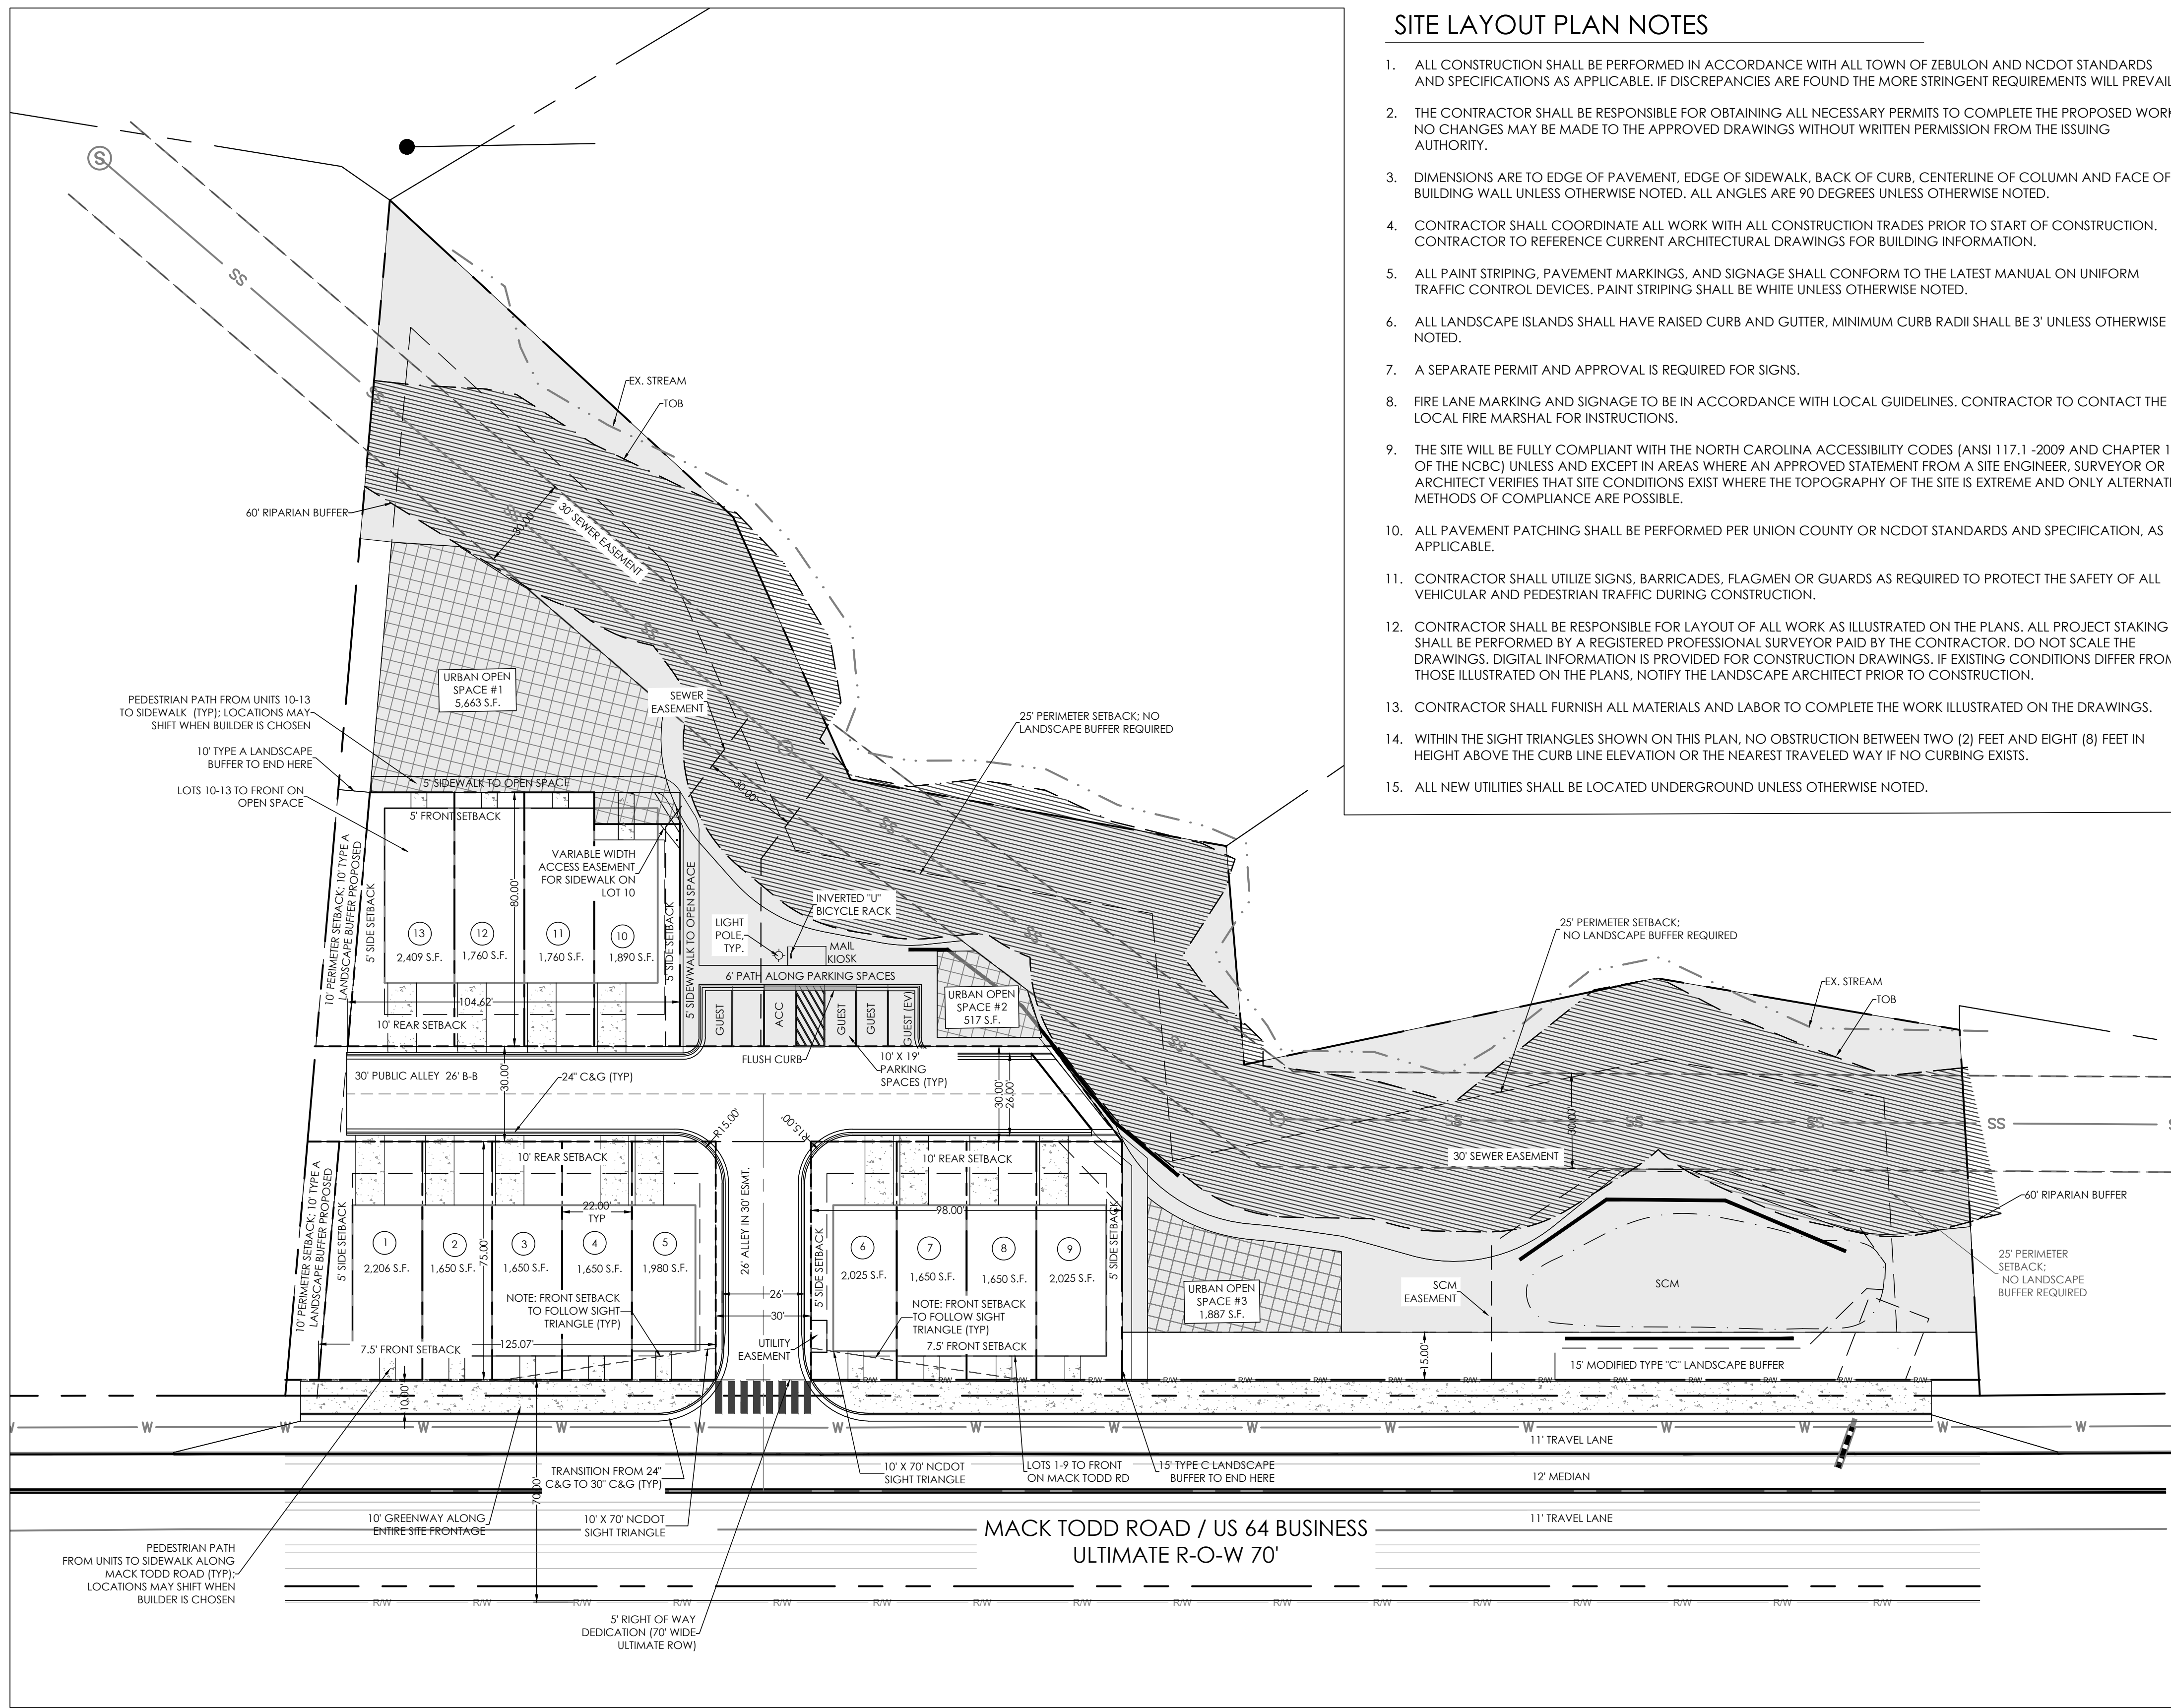

SITE LAYOUT PLAN NOTES

1. ALL CONSTRUCTION SHALL BE PERFORMED IN ACCORDANCE WITH ALL TOWN OF ZEBULON AND NCDOT STANDARDS AND SPECIFICATIONS AS APPLICABLE. IF DISCREPANCIES ARE FOUND THE MORE STRINGENT REQUIREMENTS WILL PREVAIL.
2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS TO COMPLETE THE PROPOSED WORK. NO CHANGES MAY BE MADE TO THE APPROVED DRAWINGS WITHOUT WRITTEN PERMISSION FROM THE ISSUING AUTHORITY.
3. DIMENSIONS ARE TO EDGE OF PAVEMENT, EDGE OF SIDEWALK, BACK OF CURB, CENTERLINE OF COLUMN AND FACE OF BUILDING WALL UNLESS OTHERWISE NOTED. ALL ANGLES ARE 90 DEGREES UNLESS OTHERWISE NOTED.
4. CONTRACTOR SHALL COORDINATE ALL WORK WITH ALL CONSTRUCTION TRADES PRIOR TO START OF CONSTRUCTION. CONTRACTOR TO REFERENCE CURRENT ARCHITECTURAL DRAWINGS FOR BUILDING INFORMATION.
5. ALL PAINT STRIPING, PAVEMENT MARKINGS, AND SIGNAGE SHALL CONFORM TO THE LATEST MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES. PAINT STRIPING SHALL BE WHITE UNLESS OTHERWISE NOTED.
6. ALL LANDSCAPE ISLANDS SHALL HAVE RAISED CURB AND GUTTER, MINIMUM CURB RADII SHALL BE 3' UNLESS OTHERWISE NOTED.
7. A SEPARATE PERMIT AND APPROVAL IS REQUIRED FOR SIGNS.
8. FIRE LANE MARKING AND SIGNAGE TO BE IN ACCORDANCE WITH LOCAL GUIDELINES. CONTRACTOR TO CONTACT THE LOCAL FIRE MARSHAL FOR INSTRUCTIONS.
9. THE SITE WILL BE FULLY COMPLIANT WITH THE NORTH CAROLINA ACCESSIBILITY CODES (ANSI 117.1 -2009 AND CHAPTER 11 OF THE NCBG) UNLESS AND EXCEPT IN AREAS WHERE AN APPROVED STATEMENT FROM A SITE ENGINEER, SURVEYOR OR ARCHITECT VERIFIES THAT SITE CONDITIONS EXIST WHERE THE TOPOGRAPHY OF THE SITE IS EXTREME AND ONLY ALTERNATE METHODS OF COMPLIANCE ARE POSSIBLE.
10. ALL PAVEMENT PATCHING SHALL BE PERFORMED PER UNION COUNTY OR NCDOT STANDARDS AND SPECIFICATION, AS APPLICABLE.
11. CONTRACTOR SHALL UTILIZE SIGNS, BARRICADES, FLAGMEN OR GUARDS AS REQUIRED TO PROTECT THE SAFETY OF ALL VEHICULAR AND PEDESTRIAN TRAFFIC DURING CONSTRUCTION.
12. CONTRACTOR SHALL BE RESPONSIBLE FOR LAYOUT OF ALL WORK AS ILLUSTRATED ON THE PLANS. ALL PROJECT STAKING SHALL BE PERFORMED BY A REGISTERED PROFESSIONAL SURVEYOR PAID BY THE CONTRACTOR. DO NOT SCALE THE DRAWINGS. DIGITAL INFORMATION IS PROVIDED FOR CONSTRUCTION DRAWINGS. IF EXISTING CONDITIONS DIFFER FROM THOSE ILLUSTRATED ON THE PLANS, NOTIFY THE LANDSCAPE ARCHITECT PRIOR TO CONSTRUCTION.
13. CONTRACTOR SHALL FURNISH ALL MATERIALS AND LABOR TO COMPLETE THE WORK ILLUSTRATED ON THE DRAWINGS.
14. WITHIN THE SIGHT TRIANGLES SHOWN ON THIS PLAN, NO OBSTRUCTION BETWEEN TWO (2) FEET AND EIGHT (8) FEET IN HEIGHT ABOVE THE CURB LINE ELEVATION OR THE NEAREST TRAVELED WAY IF NO CURBING EXISTS.
15. ALL NEW UTILITIES SHALL BE LOCATED UNDERGROUND UNLESS OTHERWISE NOTED.



SITE DATA

AREA:	2.30 AC
PIN:	1795-82-7060
EX. USE:	VACANT
PROPOSED USE:	RESIDENTIAL - TOWNHOMES
EX. ZONING:	R4-C
PROPOSED ZONING:	PD
DENSITY:	5.65 DU/AC
OPEN SPACE REQUIRED:	10% (0.23 AC)
OPEN SPACE PROVIDED:	53% (1.22 AC)
URBAN O.S. REQUIRED:	5% (1/4 OF REQUIRED O.S.) - 0.12 AC
URBAN O.S. PROVIDED:	8,067 S.F. / 0.19 AC
SINGLE FAMILY ATTACHED:	13 UNITS MAX. REAR LOADED UNITS
PERIMETER SETBACKS:	10' AND 25' PERIMETER SETBACK AS NOTED
LOT SETBACKS:	5' FRONT SETBACK FOR LOTS 10-13/7.5' FRONT SETBACK FOR LOTS 1-9 5' SIDE SETBACK 10' REAR SETBACK
PARKING REQUIRED:	2 SPACES PER UNIT - 26 TOTAL 0.25 GUEST SPACE PER UNIT - 4 TOTAL 2 SPACES FOR MAIL KIOSK (1 OF THESE ADA)
PARKING PROVIDED:	2 SPACES PER UNIT (ON LOT) - 26 TOTAL 4 GUEST SPACES 1 REGULAR AND 1 HC SPACE FOR THE MAIL KIOSK
LANDSCAPE BUFFERS:	15' STREET TREE BUFFER ALONG MACK TODD RD. WHERE THERE ARE NO FRONTING LOTS ON MACK TODD RD.
STREAM BUFFERS:	YES
WETLANDS:	NO
FLOODPLAIN:	NO

LEGEND

	PROJECT BOUNDARY
	STREAM BUFFER
	OPEN SPACE
	URBAN OPEN SPACE

1
L-2 CONCEPT PLAN
SCALE: 1"=30'

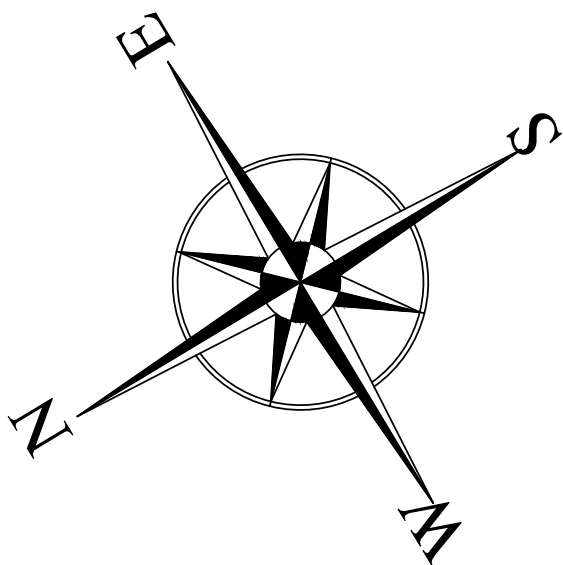
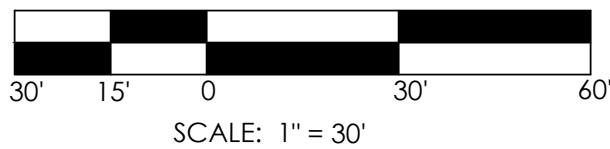


PRELIMINARY
NOT FOR
CONSTRUCTION

REVISIONS:

CONCEPT PLAN
901 MACK TODD ROAD
901 MACK TODD ROAD
ZEBULON, NC

SCALE:
AS NOTED
DRAWN BY:
PMP, MA
PROJECT #
23166
DATE:
3/17/2024
SHEET
L-2
OF 5

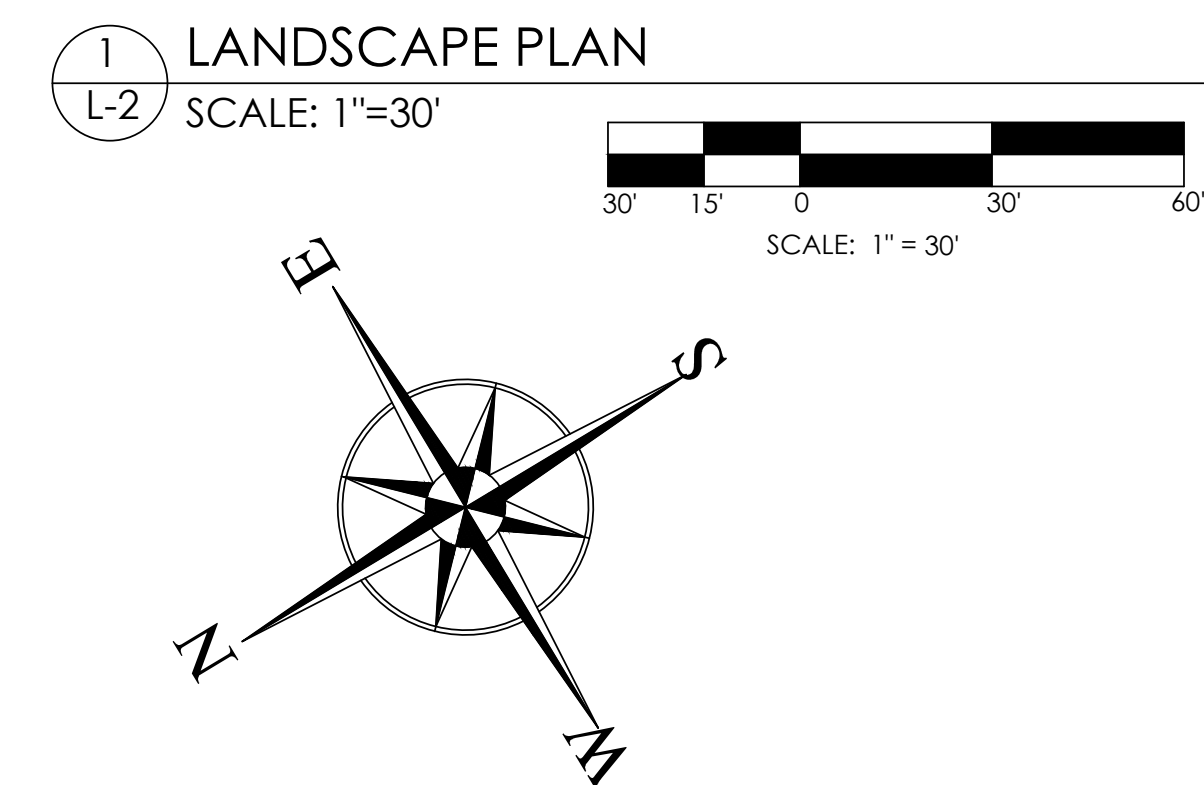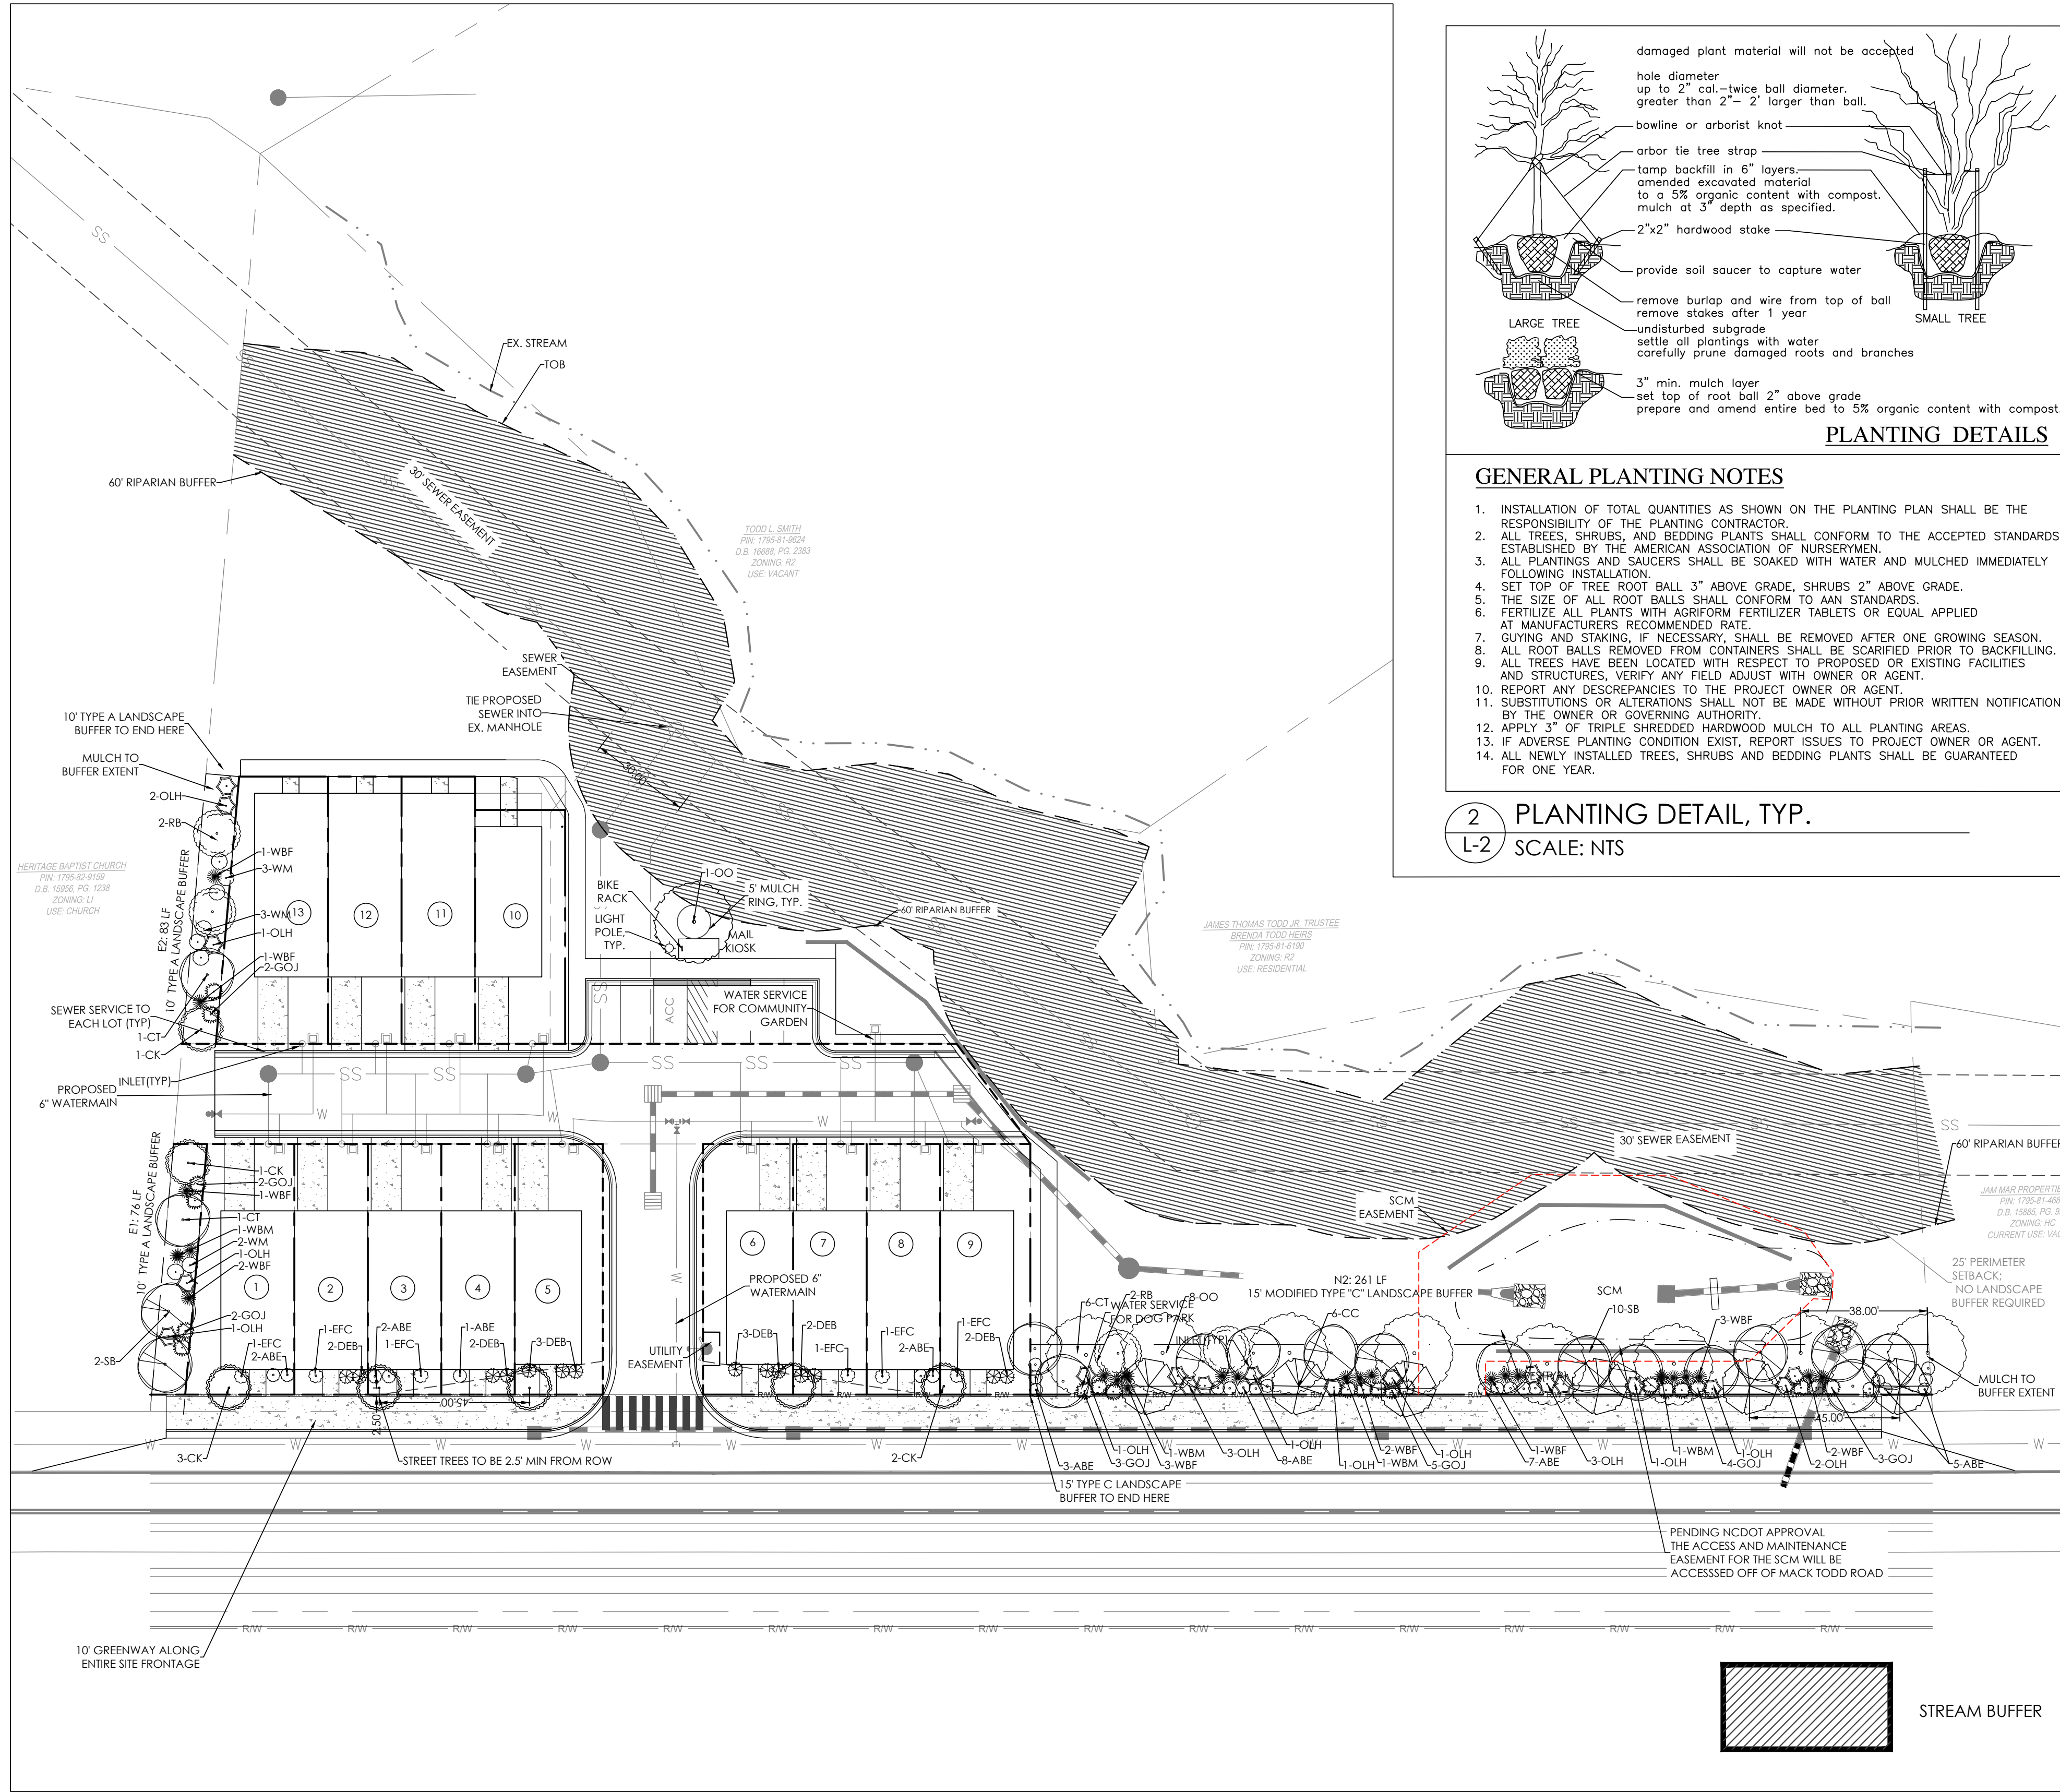

PLANT LEGEND

TREES	SHRUBS
CC CARPINUS CAROLINIANA 'CMTF2' CLARYNETTE (R) AMERICAN HORNBEEAM	ABE ABELIA X GRANDIFLORA 'ROSE CREEK' ROSE CREEK GLOSSY ABELIA
RB CERCIS CANADENSIS EASTERN REDBUD	DEB BUXUS SEMPERVIRENS 'SUFFRUTICOSA' DWARF ENGLISH BOXWOOD
CK CORNUS KOUSA 'NATIONAL' NATIONAL CHINESE DOGWOOD	OLF HYDRANGEA QUERCIFOLIA 'DOUGHLILL' GATSBY STAR (R) OAKLEAF HYDRANGEA
SB MAGNOLIA VIRGINIANA 'GREEN SHADOW' GREEN SHADOW SWEETBAY MAGNOLIA	EFC JUNIPERUS VIRGINIANA 'EMERALD FEATHER' (TM) EMERALD FEATHER DWARF EASTERN RED CEDAR
OO QUERCUS LYRATA 'QLF1B' HIGH-BEAM (R) OVERCUP OAK	GOJ JUNIPERUS VIRGINIANA 'GREY OWL' GREY OWL JUNIPER
CT VITEX AGNUS-CASTUS 'SHOAL CREEK' SHOAL CREEK CHASTE TREE	WBM ILEX VERTICILLATA 'SOUTHERN GENTLEMAN' MALE WINTERBERRY HOLLY
	WBF ILEX VERTICILLATA 'WINTER RED' WINTER RED FEMALE WINTERBERRY HOLLY
	WM MYRTICA CERIFERA WAX MYRTLE

PLANT SCHEDULE

TREES	BOTANICAL NAME	COMMON NAME	HT	CAL.	CONT.	QTY.	%	TYPE	LOCAL	COMMENTS
CC	CARPINUS CAROLINIANA 'CMTF2'	CLARYNETTE @ AMERICAN HORNBEEAM	8'	2.5"		6	14%	DEC	NATIVE	FASTIGIATE
RB	CERCIS CANADENSIS	EASTERN REDBUD	6'			4	9%	DEC	NATIVE	
CK	CORNUS KOUSA 'NATIONAL'	NATIONAL CHINESE DOGWOOD	6'			7	16%	DEC	LOCALLY-ADAPTED	
SB	MAGNOLIA VIRGINIANA 'GREEN SHADOW'	GREEN SHADOW SWEETBAY MAGNOLIA	6'			10	23%	SEMI-EVG	NATIVE	
OO	QUERCUS LYRATA 'QLF1B'	HIGH-BEAM @ OVERCUP OAK	8'	2.5"		9	20%	DEC	NATIVE	
CT	VITEX AGNUS-CASTUS 'SHOAL CREEK'	SHOAL CREEK CHASTE TREE	4'	1.5"		8	18%	DEC	LOCALLY-ADAPTED	MULTI-STEM
SHRUBS										
ABE	ABELIA GRANDIFLORA 'ROSE CREEK'	ROSE CREEK GLOSSY ABELIA	18"	3-GAL		26	22%	EVG	NATIVE	
DEB	BUXUS SEMPERVIRENS 'SUFFRUTICOSA'	DWARF ENGLISH BOXWOOD	18"	3-GAL		14	12%	EVG	LOCALLY-ADAPTED	
OLF	HYDRANGEA QUERCIFOLIA 'DOUGHLILL'	GATSBY STAR @ OAKLEAF HYDRANGEA	18"	3-GAL		19	16%	DEC	NATIVE	
EFC	JUNIPERUS VIRGINIANA 'EMERALD FEATHER'	EMERALD FEATHER @ DWARF EASTERN RED CEDAR	18"	3-GAL		6	5%	EVG	NATIVE	
GOJ	JUNIPERUS VIRGINIANA 'GREY OWL'	GREY OWL JUNIPER	18"	3-GAL		21	18%	EVG	NATIVE	
WBM	ILEX VERTICILLATA 'SOUTHERN GENTLEMAN'	SOUTHERN GENTLEMAN MALE WINTERBERRY HOLLY	18"	3-GAL		3	3%	DEC	NATIVE	
WBF	ILEX VERTICILLATA 'WINTER RED'	WINTER RED FEMALE WINTERBERRY HOLLY	18"	3-GAL		21	18%	DEC	NATIVE	
WM	MYRTICA CERIFERA	WAX MYRTLE	18"	3-GAL		8	7%	EVG	NATIVE	

LANDSCAPE SCOPE OF WORK

- FURNISH ALL LABOR, MATERIALS, AND EQUIPMENT REQUIRED OR INDICATED BY THE DRAWINGS AND SPECIFICATIONS TO COMPLETE THE WORK INCLUDING INSTALLATION OF ALL TREES, SHRUBS, GROUND COVER, ANNUALS, SEED, SOD AND MULCH.
- MATERIALS AND WORK: THE SELECTION OF ALL MATERIALS AND THE EXECUTION OF ALL WORK REQUIRED UNDER THE CONTRACT SHALL BE SUBJECT TO APPROVAL BY THE OWNER. THE OWNER SHALL HAVE THE RIGHT TO REJECT ANY AND ALL MATERIALS AND ANY AND ALL WORK, WHICH IN HIS OPINION, DOES NOT MEET THE REQUIREMENTS OF THE CONTRACT.
- PLANT MATERIALS: ALL PLANT MATERIALS SHALL BE NURSERY GROWN, FRESHLY DUG IN THE FIELD, NATURALLY SHAPED, WELL BRANCHED, FULLY FOLIATED WHEN IN LEAF WITH FULLY DEVELOPED ROOT SYSTEMS. TREES MUST BE SELF-SUPPORTING, WITH STRAIGHT TRUNKS AND LEADERS INTACT. ALL PLANTS MUST BE FREE OF DISEASE, INSECT INFESTATION OR THEIR EGGS AND SHALL HAVE BEEN GROWN IN CLIMATIC CONDITIONS SIMILAR TO THOSE OF THE PROJECT SITE.
- PLANT SIZE: SPECIFIED SIZES INDICATES THE MINIMUM ALLOWABLE SIZE AT PLANTING. WHERE CONTAINER AND HEIGHT/SPREADS ARE INDICATED FOR A SINGLE SPECIES, BOTH SIZE REQUIREMENTS SHALL BE MET WHEN ONLY PLANT HEIGHT OR SPREAD ARE INDICATED. CONTAINER SIZE SHALL BE BASED ON "AMERICAN STANDARDS FOR NURSERY STOCK" STANDARDS.
- ORGANIC MATTER: AGED MANURE, COMPOST OR PINE BARK FINES, AT THE OPTION OF THE CONTRACTOR. MATERIAL SHALL BE AIR DRIED, FINELY SHREDDED AND SUITABLE FOR HORTICULTURAL PURPOSES AND SHALL CONTAIN NO MORE THAN 35% MOISTURE CONTENT BY WEIGHT.
- PINE BARK MULCH: ALL PINE BARK MULCH SHALL BE CLEAN, DOUBLE GROUND, FINE TEXTURED NUGGET MULCH WITH MINIMAL AMOUNTS OF SAPWOOD CONTENT.
- TURF AREAS: PRIOR TO ANY SEEDING OR SOD APPLICATION, VERIFY ALL TRENCHING AND LAND DISTURBING ACTIVITIES HAVE BEEN COMPLETED. ENSURE ALL AREAS ARE FREE OF STONES, LARGE SOIL CLODS AND ANY OTHER CONSTRUCTION DEBRIS.

LANDSCAPE CALCULATIONS


STREET TREES
STREET TREES SHALL BE LOCATED WITHIN STREETYARDS AND PLANTED 45'-50' ON CENTER, SO THAT TRUNKS ARE AT LEAST 2.5' FROM BACK OF CURB AND EDGE OF PAVEMENT. STREET TREES SHALL BE 8" MIN AND 2.5" CALIPER AT PLANTING.

MACK TODD ROAD
LENGTH: 305 LF / 50 LF = 10.1 (11) REQUIRED/PROVIDED
STREET TREES LOCATED WITHIN DEVELOPER PER PLANNING DEPT.

PERIMETER BUFFERS
E1 - 10' TYPE A PERIMETER BUFFER
LENGTH: 76 LF
UNDERSTORY TREES: 76 LF / 100 = 0.76 X 4 = 3.04 (4) REQ/PROP.
SHRUBS: 76 LF / 100 LF = 0.76 X 15 = 11.4 (12) REQ/PROP.
(50% EVERGREEN = 6/12 REQ/PROP.)
E2 - 10' TYPE A PERIMETER BUFFER
LENGTH: 83 LF
UNDERSTORY TREES: 83 LF / 100 LF = 0.83 X 4 = 3.3 (4) REQ/PROP.
SHRUBS: 83 LF / 100 LF = 0.83 X 15 = 12.5 (13) REQ/PROP.
(50% EVERGREEN = 7/13 REQ. 8/13 PROP.)

STREETSCAPE BUFFERS
N1 - BUFFER ALTERNATIVE: FOUNDATION PLANTS FRONTING MACK TODD RD 3 EVERGREEN SHRUBS PER UNIT X 9 UNITS = 27 SHRUBS REQ/PROP.
NOTE: SHRUBS WITHIN SIGHT TRIANGLE TO BE MAINTAINED AT <18'
N2 - 15' MODIFIED TYPE C LANDSCAPE BUFFER
LENGTH: 261 LF
CANOPY TREES: 261 LF / 100 LF = 2.61 X 3 = 7.8 (8) REQ/PROP.
UNDERSTORY TREES: 261 LF / 100 LF = 2.61 X 6 = 15.7 (16) REQ/PROP.
SHRUBS: 261 LF / 100 LF = 2.61 X 25 = 65.3 (66) REQ/PROP.

PARKING LOT LANDSCAPING
ONE CANOPY TREE PER 12 OFF-STREET PARKING SPACES
NO SPACE MAY BE MORE THAN 50' FROM A CANOPY TREE
6 TOTAL PARKING SPACES = 1 TREE REQ/PROP.

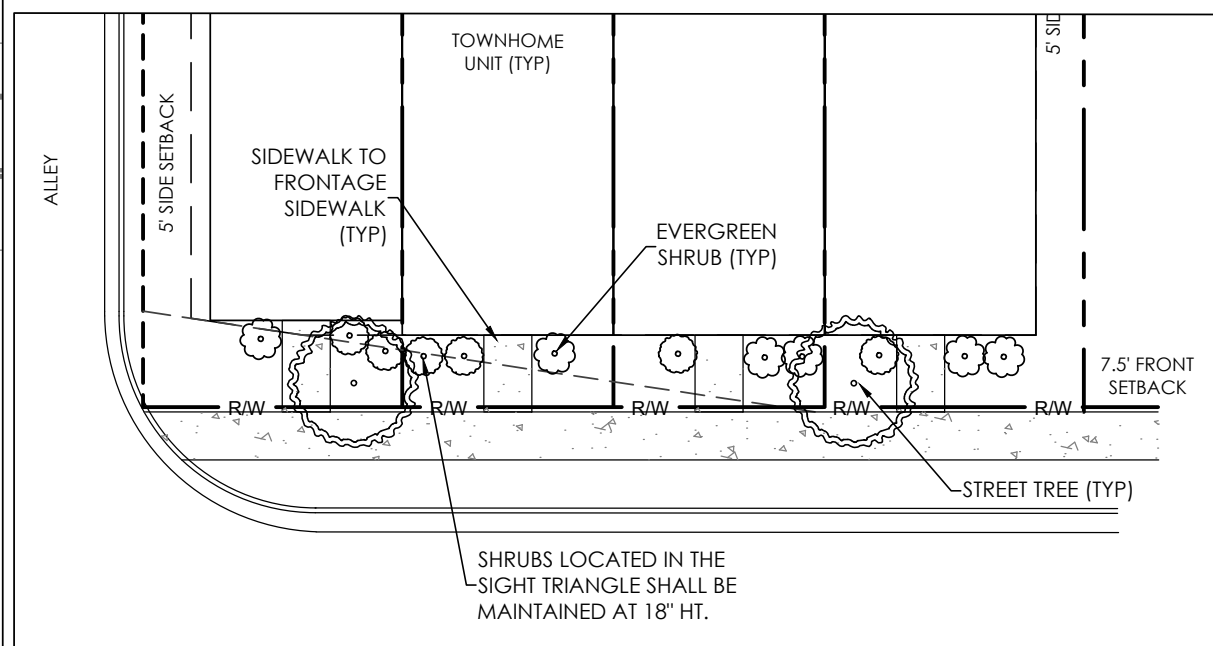



FOUNDATION LANDSCAPING TYP.

L-2 SCALE: 1"=20'

LANDSCAPE PLAN NOTES

- TOWN OF ZEBULON REQUIREMENTS:**
- CANOPY TREES SHALL BE MINIMUM 8' HEIGHT AND 2.5" CALIPER AT TIME OF PLANTING AND REACH 40' HEIGHT AND 30' SPREAD AT TIME OF MATURITY.
 - UNDERSTORY TREES SHALL BE MINIMUM 4' AND 1.5" CALIPER AT TIME OF PLANTING AND MATURE TO 15-40' HEIGHT (20' MAX UNDER POWERLINES).
 - SHRUBS SHALL BE MINIMUM 3 GAL AND 18" HEIGHT OR SPREAD AT TIME OF PLANTING AND MATURE TO 36" HEIGHT AND 30" SPREAD IN 3 YEARS.
 - PLANTED AREAS SHALL BE COVERED IN MULCH OR GROUND COVER, OR WHERE SLOPES ARE 15% OR MORE BY GROUND COVER FULLY ESTABLISHED AT COO.
 - SPECIES SHALL BE NATIVE OR LOCALLY-ADAPTED AND SHALL COMPLY WITH SPECIES DIVERSITY REQUIREMENTS IN UDO SECTION 5.6.7-E.
- GENERAL REQUIREMENTS:**
- ALL PLANT MATERIAL ON THIS SITE MUST MEET MINIMUM TOWN OF ZEBULON UDO REQUIREMENTS FOR SIZE, HEIGHT, AND SPACING. PLANT MATERIAL SHALL BE INSTALLED ACCORDING TO SOUND NURSERY PRACTICES AND IN CONFORMANCE WITH THE GENERAL PLANTING NOTES AND DETAILS WITHIN THIS PLAN SET.
 - PLANTING STOCK SHALL MEET ALL STANDARDS WITHIN THE LATEST EDITION OF "AMERICAN STANDARDS FOR NURSERY STOCK." ALL PLANTS SHALL BE VIGOROUS, HEALTHY MATERIAL FREE FROM PESTS AND DISEASE.
 - IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO REVIEW THE PROJECT SITE AND FAMILIARIZE WITH ACTUAL FIELD CONDITIONS PRIOR TO BIDDING AND COMMENCING WORK. THE CONTRACTOR SHALL ACCEPT ACTUAL CONDITIONS AT THE SITE AND PERFORM THE WORK SPECIFIED INCLUDING THE FINE GRADING AND INCORPORATION OF TOPSOIL INTO PLANTING AREAS, WITHOUT ADDITIONAL COMPENSATION FOR POSSIBLE VARIATIONS FROM GRADES AND CONDITIONS SHOWN WEATHER SURFACE OR SUBSURFACE. IF FIELD CONDITIONS ARE FOUND TO BE SIGNIFICANTLY DIFFERENT THE CONTRACTOR SHALL NOTIFY THE PROJECT LANDSCAPE ARCHITECT OR ENGINEER IMMEDIATELY AND PRIOR TO ORDERING MATERIALS.
 - CONTRACTOR IS RESPONSIBLE FOR ALL REQUIRED PERMITS TO PERFORM THE WORK.
 - CONTRACTOR SHALL VERIFY THE LOCATION OF ALL EXISTING UTILITIES ABOVE AND BELOW GROUND AND SHALL BE RESPONSIBLE FOR ANY DAMAGE RESULTING FROM THEIR ACTIVITIES. CONTRACTOR SHALL NOTIFY NORTH CAROLINA ONE CALL (1-800-632-4949) AT LEAST 48 HOURS PRIOR TO BEGINNING CONSTRUCTION OR EXCAVATION TO HAVE EXISTING UTILITIES LOCATED. CONTRACTOR TO CONTACT ANY LOCAL UTILITIES THAT PROVIDE THEIR OWN LOCATOR SERVICES INDEPENDENT OF NORTH CAROLINA ONE CALL. THE CONTRACTOR MAY ALSO NEED TO ENGAGE A PRIVATE UTILITY LOCATING FIRM AT THEIR OWN COST TO EFFICIENTLY HAVE ALL UTILITIES LOCATED.
 - ANY DAMAGE TO EXISTING IMPROVEMENTS OUTSIDE OF THE PROJECT LIMITS, INCLUDING CURB AND GUTTER, SIDEWALKS, PAVED OR TURF AREAS SHALL BE REPAIRED TO ORIGINAL CONDITIONS BY THE CONTRACTOR WITHOUT ADDITIONAL COST TO THE DEVELOPER.
 - PLANT QUANTITIES TO BE VERIFIED BY LANDSCAPE CONTRACTOR. IN THE EVENT OF A DISCREPANCY BETWEEN THE QUANTITY OF PLANTS SHOWN ON PLANS AS COMPARED TO PLANT LIST THE CONTRACTOR SHALL PROVIDE THE QUANTITY SHOWN ON PLANS.
 - CONTRACTOR SHALL OBTAIN WRITTEN AUTHORIZATION FROM THE LANDSCAPE ARCHITECT FOR ANY PLANT SUBSTITUTIONS OR MODIFICATIONS TO THE LANDSCAPE PLANS. THIS MAY REQUIRE A MODIFICATION TO THE APPROVED PLANS. NOTIFY THE LANDSCAPE ARCHITECT IMMEDIATELY OF ANY DISCREPANCIES ON THE PLANS.
 - ALL ABOVE GROUND MECHANICAL EQUIPMENT, ELECTRICAL TRANSFORMERS, DUMPSTERS, BACKFLOW PREVENTERS, AND VALVE BOXES SHALL BE SCREENED FROM VIEW OF ADJACENT PROPERTIES AND RIGHT-OF-WAY WHILE MAINTAINING REQUIRED ACCESS TO LOCAL CODE STANDARDS AND REQUIREMENTS.
 - WITHIN THE SIGHT TRIANGLES SHOWN ON THIS PLAN, NO OBSTRUCTIONS BETWEEN TWO FEET AND EIGHT FEET IN HEIGHT ABOVE THE NEAREST VEHICLE SURFACE OR ADJACENT CURB LINE SHALL BE ALLOWED.
 - ALL UNPAVED AREAS SHALL BE TOPSOILED AND SEED / SODDED OR MULCHED TO THE LIMITS OF CONSTRUCTION BASED ON ACTUAL FIELD CONDITIONS BEYOND THE APPROVED PLANS.
 - ALL SOD TO BE REBEL FESCUE IV, TURF GEM, LESCO OR EQUAL. ALL SEED TO BE REBEL FESCUE IV, TURF GEM, LESCO OR EQUAL @ 4 LBS. PER 1000 S.F. IN LAWN AREAS 3" TOPSOIL SHALL BE TILLED INTO THE TOP 6" OF GROUND PRIOR TO SEEDING.
 - SLOPES GREATER THAN 3:1 SHALL REQUIRE HYDRO-SEEDING. SLOPES GREATER THAN 2:1 SHALL BE SODDED WITH CENTIPEDE GRASS. ADDITIONAL STABILIZATION MEASURES MAY BE REQUIRED FOR SLOPES GREATER THAN 3:1 TO ENSURE SOIL STABILIZATION AND ESTABLISHMENT OF PERMANENT GROUND COVER.
 - INTERIOR MULCH SHALL BE DOUBLE GROUND PINE BARK TO A DEPTH OF 4". PERIMETER LANDSCAPE BUFFERS SHALL BE MULCHED WITH 4" PINE STRAW TO BED LINES SHOWN OR BUFFER LIMITS. BED LINES SHALL CONFORM TO CONFIGURATION SHOWN ON PLANS.
 - PINE STRAW MULCH TO FILL THE 15' PERIMETER LANDSCAPE BUFFER BETWEEN PLANTINGS. PINE STRAW SHALL NOT BE USED AS MULCH OR GROUND COVER WITHIN TEN FEET OF ANY STRUCTURES CONSISTING OF EXTERIOR COMBUSTIBLE CONSTRUCTION.
 - CONTRACTOR SHALL LEVEL AND SMOOTH ALL DISTURBED AREAS AND REMOVE ALL ROCKS AND CONSTRUCTION DEBRIS PRIOR TO SEEDING, SOD OR PLANT INSTALLATION.
 - NOTE THAT WITHIN LANDSCAPED AREAS SURROUNDING BUILDING, THE GRADES SHOWN ON THE GRADING SHEET ARE "TOP OF MULCH" OR "TOP OF TOPSOIL." CONTRACTOR SHALL ENSURE POSITIVE FINISHED DRAINAGE (MIN. 2%) AWAY FROM ALL BUILDINGS AND COORDINATE WITH THE LANDSCAPE PLAN TO LEAVE SUBGRADE LOW ENOUGH TO MAINTAIN THESE SPOTS AS FINISHED GRADE.
 - OWNER SHALL MAINTAIN ALL PLANT BEDS AND PLANT MATERIAL IN GOOD HEALTH, AND ANY DEAD, UNHEALTHY OR MISSING PLANTS SHALL BE REPLACED WITH THE SAME PLANT MATERIAL ORIGINALLY SPECIFIED ON THIS PLAN.
 - TREE PLANTING AND SITE LIGHT POLES SHALL BE SEPARATED BY AT LEAST 10'.
 - TREE PLANTING AND SITE DRIVEWAYS SHALL BE SEPARATED BY AT LEAST 10'.


- FOUNDATION LANDSCAPING NOTES:**
- THE FOUNDATION LANDSCAPING SHALL INCLUDE THREE SMALL EVERGREEN SHRUBS INSTALLED AT 12" HT. PER UNIT.
 - PLANT SELECTION DETERMINED AT SITE PLAN.
 - SHRUBS LOCATED IN THE SIGHT TRIANGLE SHALL BE MAINTAINED AT 18" HT.
 - FOUNDATION PLANTINGS ARE IN LIEU OF A STREETSCAPE BUFFER.
 - BUILDINGS SHOWN IN THIS DETAIL ARE ILLUSTRATIVE; ACTUAL BUILDING SHAPE/SIZE MAY VARY.

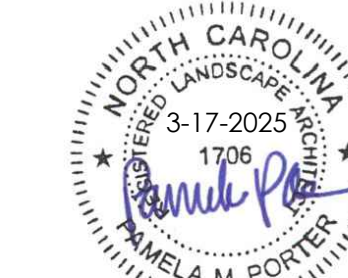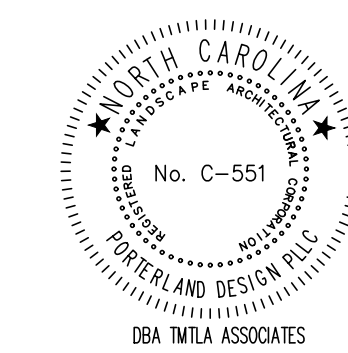

PRELIMINARY
NOT FOR
CONSTRUCTION

REVISIONS:

F:\Projects\CPMTRZ\Drawings\Site\CPMTRZ_Base.dwg - 5 UTILITY Mar 18, '25 - 10:22am

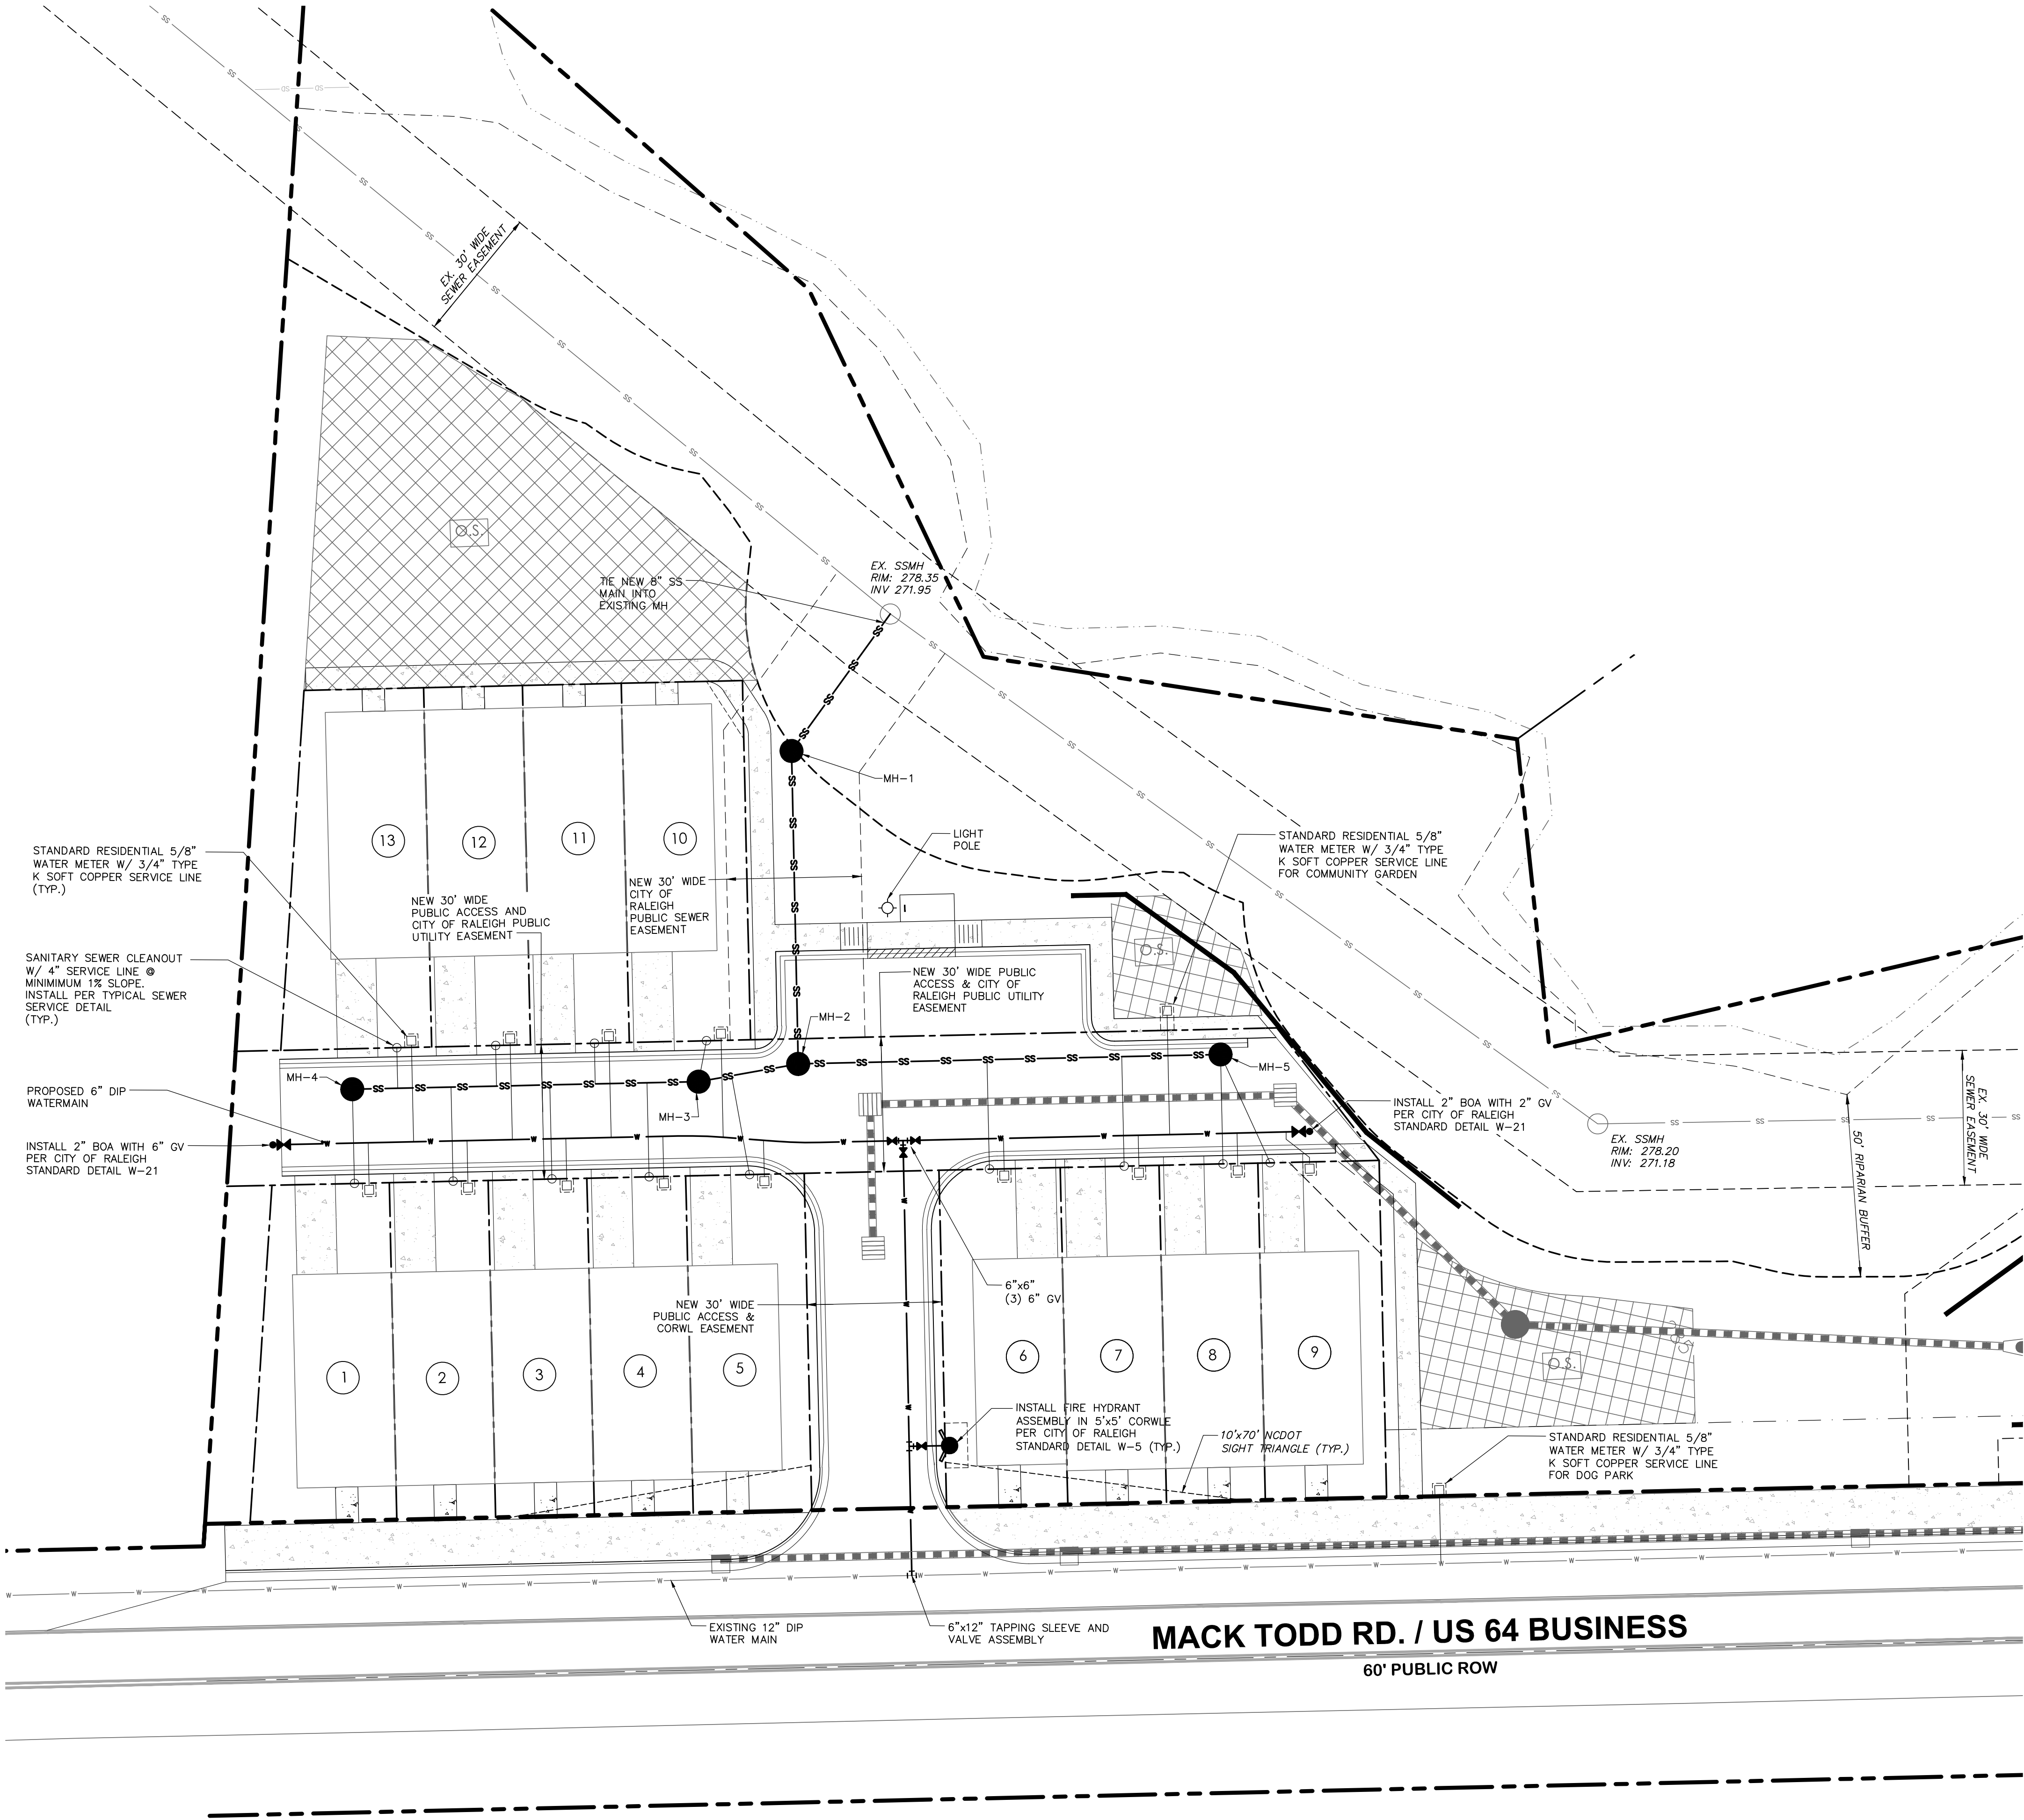

LIGHTING NOTES

FIXTURE TYPE: LED MITCHELL SERIES - 75 WATT (WITHOUT BANDING OR RIBBON)
8.19 FIXTURE, 2.71 POLE (16' FIBERGLASS)
TOTAL # OF FIXTURES = 19

STANDARD UTILITY NOTES

- All materials & construction methods shall be in accordance with City of Raleigh design standards, details & specifications (reference: CORPUD Handbook, current edition)
- Utility separation requirements:
 - A distance of 100' shall be maintained between sanitary sewer & any private or public water supply source such as an impounded reservoir used as a source of drinking water. If adequate lateral separation cannot be achieved, ferrous sanitary sewer pipe shall be specified & installed to wateline specifications. However, the minimum separation shall not be less than 25' from a private well or 50' from a public well.
 - When installing water &/or sewer mains, the horizontal separation between utilities shall be 10'. If this separation cannot be maintained due to existing conditions, the variation allowed is the water main in a separate trench with the elevation of the water main at least 18" above the top of the sewer & must be approved by the Public Utilities Director. All distances are measured from outside diameter to outside diameter.
 - Where it is impossible to obtain proper separation, or anytime a sanitary sewer passes over a watermain, DIP materials or steel encasement extended 10' on each side of crossing must be specified & installed to wateline specifications.
 - 5.0' minimum horizontal separation is required between all sanitary sewer & storm sewer facilities, unless DIP material is specified for sanitary sewer
 - Maintain 18" min. vertical separation at all watermain & RCP storm drain crossings; maintain 18" min. vertical separation at all sanitary sewer & RCP storm drain crossings. Where adequate separations cannot be achieved, specify DIP materials & a concrete cradle having 6" min. clearance (per CORPUD details W- 41 & S-49).
 - All other underground utilities shall cross water & sewer facilities with 18" min. vertical separation required.
- Any necessary field revisions are subject to review & approval of an amended plan &/or profile by the City of Raleigh Public Utilities Department prior to construction.
- Developer shall provide 30 days advance written notice to owner for any work required within an existing City of Raleigh Utility Easement traversing private property.
- Contractor shall maintain continuous water & sewer service to existing residences & businesses throughout construction of project. Any necessary service interruptions shall be preceded by a 24-hour advance notice to the City of Raleigh Public Utilities Department.
- SEWER BYPASS PUMPING - A bypass plan sealed by an NC Professional Engineer shall be provided to Raleigh Water prior to pumping operations for approval. The operations and equipment shall comply with the Public Utilities Handbook.
- 3.0' minimum cover is required on all water mains & sewer force mains. 4.0' minimum cover is required on all reuse mains.
- It is the developer's responsibility to abandon or remove existing water & sewer services not being used in redevelopment of a site unless otherwise directed by the City of Raleigh Public Utilities Department. This includes abandoning tap at main & removal of service from ROW or easement per CORPUD Handbook procedure.
- Install 3/4" copper* water services with meters located at ROW or within a 2'x2' Wateline Easement immediately adjacent. NOTE: it is the applicant's responsibility to properly size the water service for each connection to provide adequate flow & pressure
- Install 4" PVC* sewer services @ 1.0% minimum grade with cleanouts located at ROW or easement line & spaced every 75 linear feet maximum.
- Pressure reducing valves are required on all water services exceeding 80 psi; backwater valves are required on all sanitary sewer services having building drains lower than 1.0' above the next upstream manhole.
- All environmental permits applicable to the project must be obtained from NCDWQ, USACE &/or FEMA for any riparian buffer, wetland &/or floodplain impacts (respectively) prior to construction.
- NCDOT / Railroad Encroachment Agreements are required for any utility work (including main extensions & service taps) within state or railroad ROW prior to construction.
- Grease Interceptor / Oil Water Separator sizing calculations & installation specifications shall be approved by the RW FOG Program Coordinator prior to issuance of a UC and/or Building Permit. Contact (919) 996-4516 or fwg@raleighnc.gov for more information.
- Cross-connection control protection devices are required based on the degree of health hazard involved as listed in Appendix B of the Rules Governing Public Water Systems in North Carolina.
- The devices shall meet the American Society of Sanitary Engineering (SAAE) standards and be on the University of Southern California approval list.
- The device and installation shall meet the guidelines of Appendix A - Guidelines and Requirements for the Cross Connection Program in Raleigh's Service Area.
- The devices shall be installed and tested (both, initial and periodic testing thereafter) in accordance with the manufacturer's recommendations or the local cross connection control program, whichever is more stringent. Contact Crossconnection@raleighnc.gov for more information.
- NOTICE for projects that involve an oversized main or urban main replacement. Any City reimbursement greater than \$250,000.00 must undergo the public bidding process.
- Any water meter installed outside of the ROW will need a CORWLE dedicated with the plat.

GENERAL NOTES

- ALL MATERIALS AND METHODS OF CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE TOWN OF ZEBULON STANDARDS AND SPECIFICATIONS, AND CITY OF RALEIGH FOR WATER AND SANITARY SEWER.
- CONTRACTOR SHALL HAVE NORTH CAROLINA ONE CALL (1-800-632-4949) LOCATE ALL EXISTING UTILITIES PRIOR TO BEGINNING CONSTRUCTION.
- CONTRACTOR SHALL VERIFY THE LOCATION AND DEPTH OF ALL EXISTING UTILITIES AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES OR CONFLICTS PRIOR TO BEGINNING CONSTRUCTION.
- CONTRACTOR IS RESPONSIBLE FOR REMOVING OR RELOCATING ALL UTILITIES IN CONFLICT WITH NEW CONSTRUCTION. CONTRACTOR SHALL COORDINATE WITH UTILITY COMPANIES PRIOR TO DISTURBANCE.
- AN INDIVIDUAL BOOSTER PUMP TANK SHALL BE INSTALLED ON ANY LOT HAVING WATER SERVICE PRESSURES BELOW 40 PSI.
- ALL SANITARY SEWER SHOWN ON PLAN IS 8" DIAMETER UNLESS OTHERWISE NOTED.

ATTENTION CONTRACTORS

The Contractor responsible for the extension of water, sewer, and/or reuse, as approved in these plans, is responsible for contacting the Public Utilities Inspector at 919-996-3245 or <https://cityworks.raleighnc.gov/pucontractors/New> and schedule a Pre-construction meeting prior to beginning any construction. Raleigh Water must be contacted at (919) 996-4540 at least twenty-four hours prior to beginning any work activity around critical water and sewer infrastructure.

Failure to notify the Divisions in advance of beginning construction, will result in the issuance of monetary fines, and require reinstallation of any water or sewer facilities not inspected as a result of this notification failure.

Failure to call for Inspection, install a downstream plug, have permitted plans on the jobsite, or any other violation of City of Raleigh Standards will result in a fine and possible exclusion from future work in the City of Raleigh.

Public

Water Distribution / Extension System

The City of Raleigh consents to the connection and extension of the City's public water system as shown on this plan. The material and Construction methods used for this project shall conform to the standards and specifications of the City's Public Utilities Handbook.

City of Raleigh
Public Utilities Department Permit #
Authorization to Construct See digital signature

Public

Sewer Collection / Extension System

The City of Raleigh consents to the connection and extension of the City's public sewer system as shown on this plan. The material and Construction methods used for this project shall conform to the standards and specifications of the City's Public Utilities Handbook.

City of Raleigh
Public Utilities Department Permit #
Authorization to Construct See digital signature

INFRASTRUCTURE CONSTRUCTION PLAN APPROVAL

CITY OF RALEIGH - PLANS AUTHORIZED FOR CONSTRUCTION

All Construction must be in accordance with all Local, State, and Federal Rules and Regulations.

PUBLIC UTILITIES

PUD
HELMUTH&DESIGN HLC
8522-204 SIX FORKS ROAD
RALEIGH, NORTH CAROLINA 27615
919.845.7600 PHONE
919.845.7703 FAX
ENGR. FIRM LICENSE NO. F-0843



MADISON RIDGE TOWNHOMES

901 MACK TODD ROAD
ZEBULON, NORTH CAROLINA

ISSUED: 04 FEB 2025

REVISIONS:


DRAWN BY: MLS

CHECKED BY: MLS


PROJECT: CPMTRZ

UTILITY PLAN

DWG. NO. SITE 5

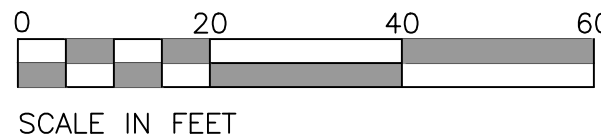

F:\Projects\CPMTRZ\Drawings\Site\CPMTRZ_Base.dwg -- 6-7 EROSION Mor 18, '25 -- 10:23am

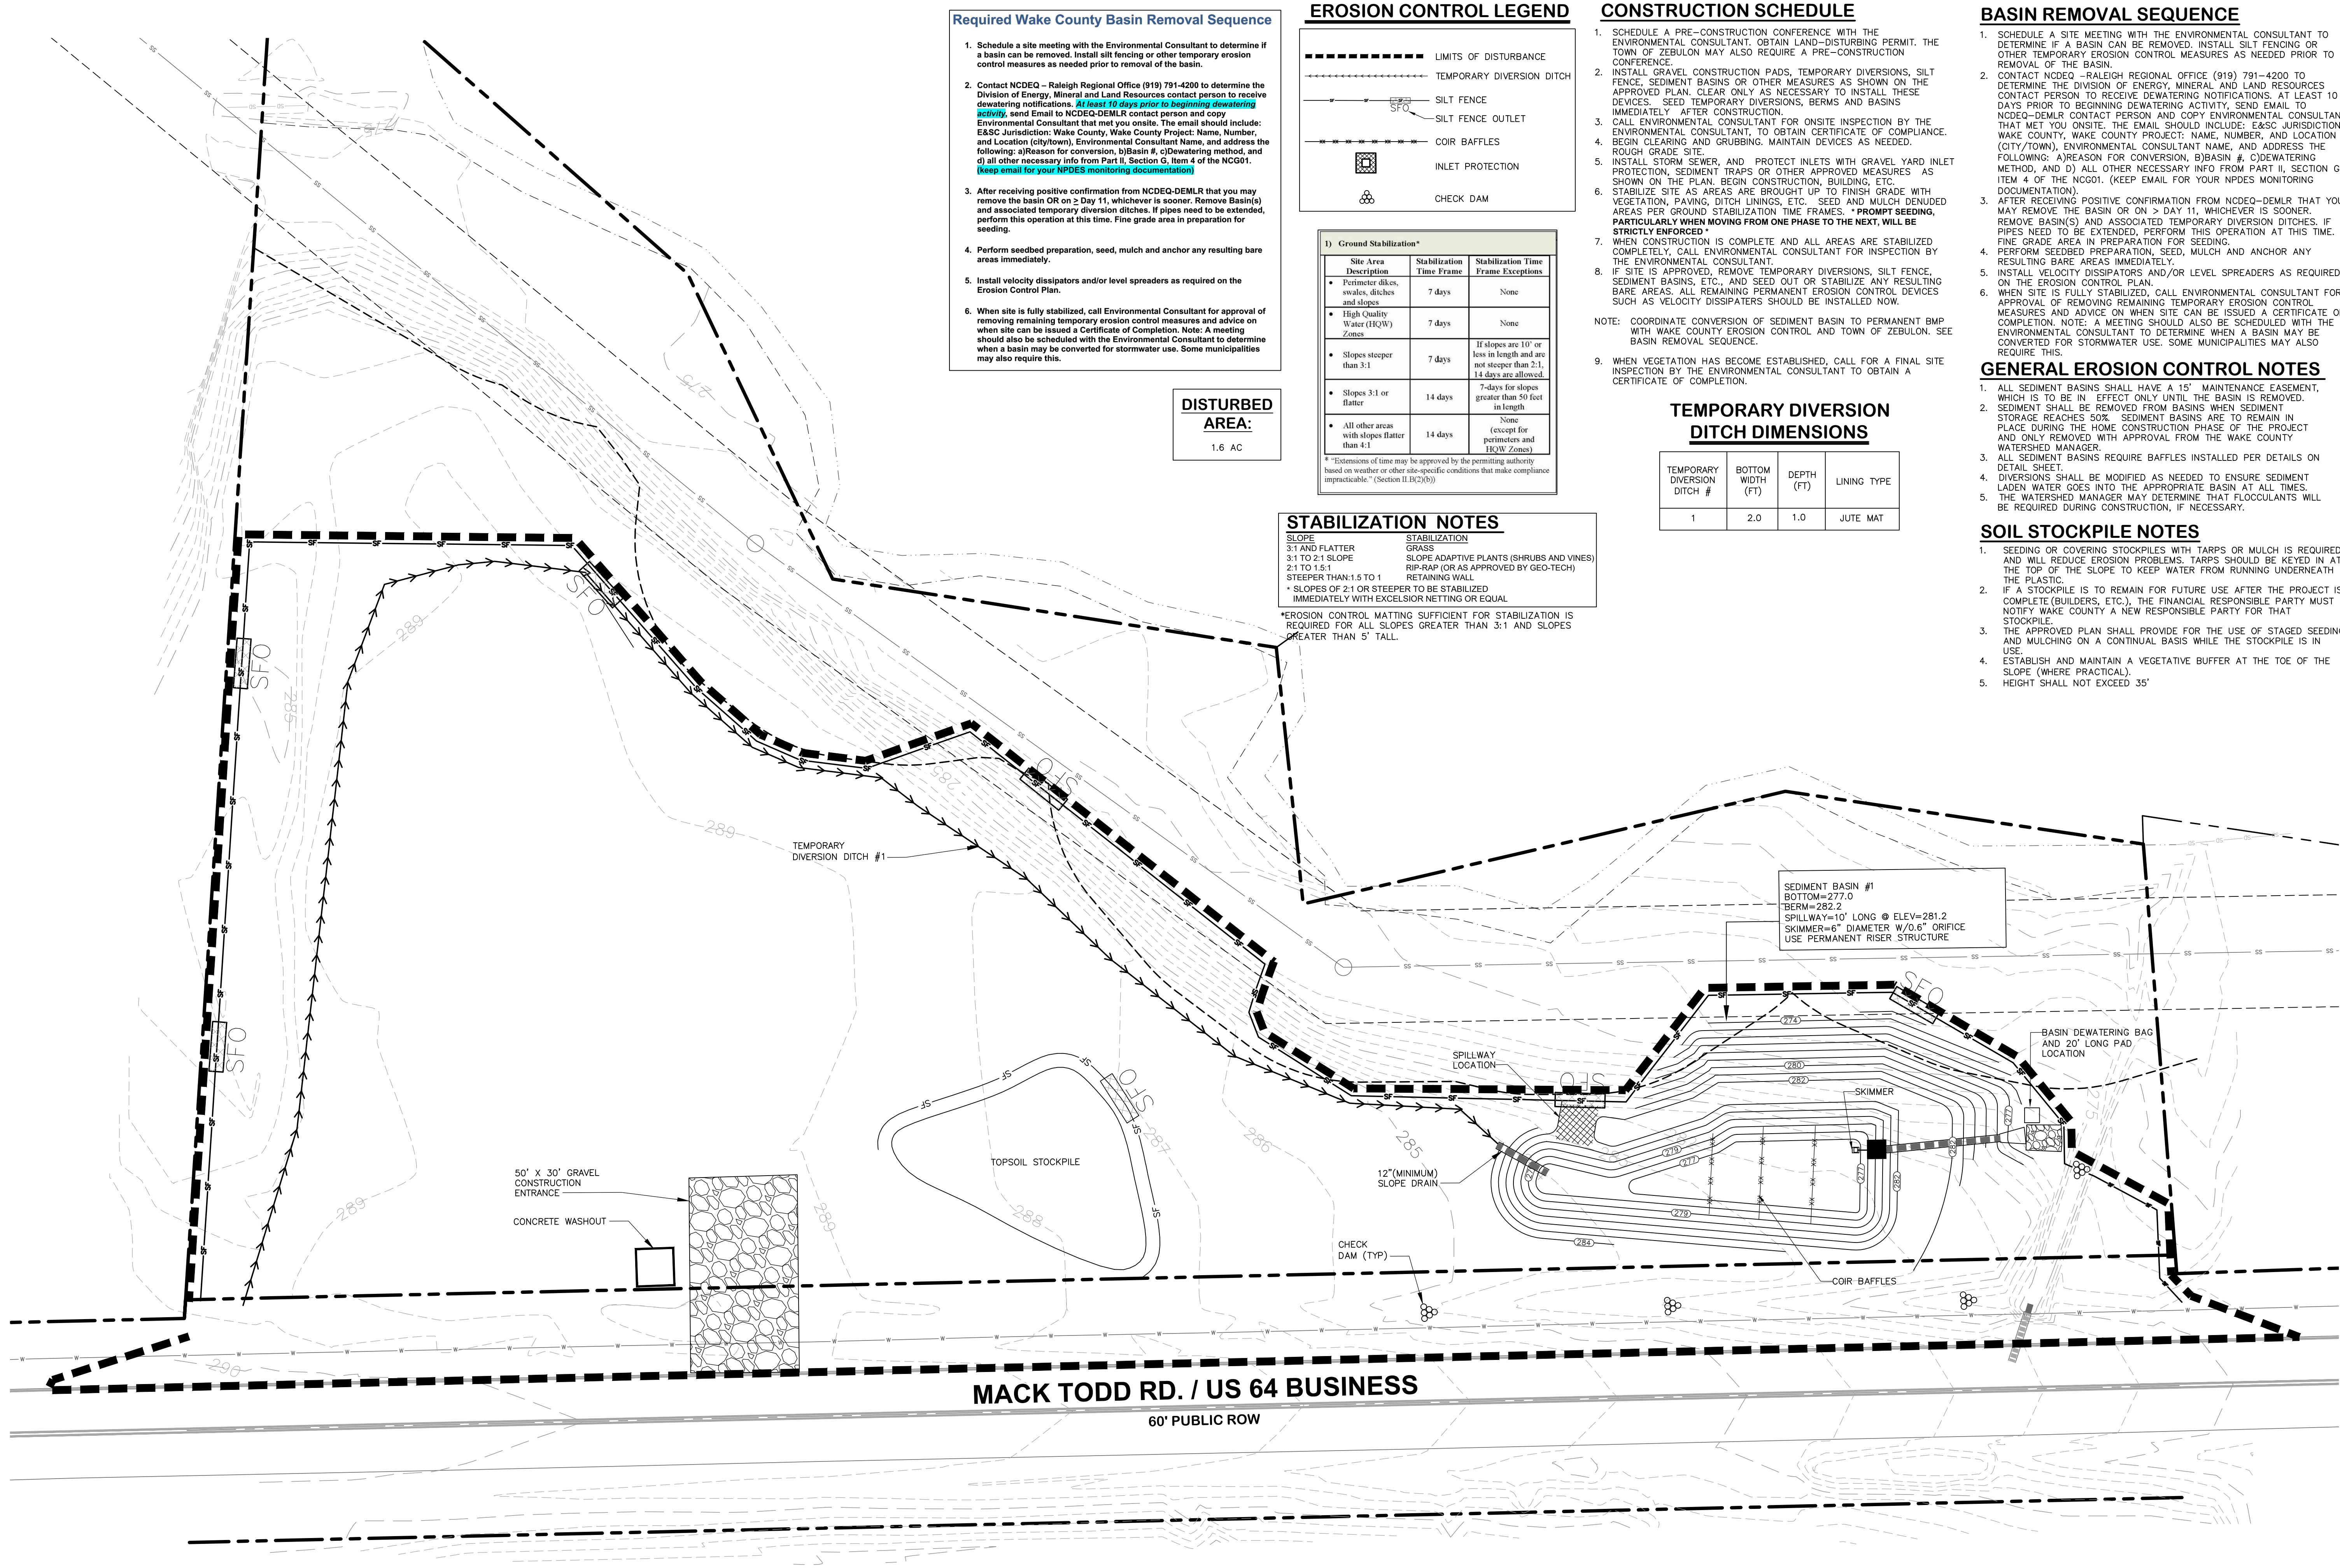


Required Wake County Basin Removal Sequence

- Schedule a site meeting with the Environmental Consultant to determine if a basin can be removed. Install silt fencing or other temporary erosion control measures as needed prior to removal of the basin.
- Contact NCDEQ – Raleigh Regional Office (919) 791-4200 to determine the Division of Energy, Mineral and Land Resources contact person to receive dewatering notifications. **At least 10 days prior to beginning dewatering activities**, send Email to NCDEQ-DEMLR contact person and copy Environmental Consultant that met you onsite. The email should include: E&SC Jurisdiction: Wake County, Wake County Project: Name, Number, and Location (city/town), Environmental Consultant Name, and address the following: a) Reason for conversion, b) Basin #, c) Dewatering method, and d) all other necessary info from Part II, Section G, Item 4 of the NCG01. **Keep email for your NPDES monitoring documentation**
- After receiving positive confirmation from NCDEQ-DEMLR that you may remove the basin OR on ≥ Day 11, whichever is sooner. Remove Basin(s) and associated temporary diversion ditches. If pipes need to be extended, perform this operation at this time. Fine grade area in preparation for seeding.
- Perform seedbed preparation, seed, mulch and anchor any resulting bare areas immediately.
- Install velocity dissipators and/or level spreaders as required on the Erosion Control Plan.
- When site is fully stabilized, call Environmental Consultant for approval of removing remaining temporary erosion control measures and advice on when site can be issued a Certificate of Completion. Note: A meeting should also be scheduled with the Environmental Consultant to determine when a basin may be converted for stormwater use. Some municipalities may also require this.

DISTURBED AREA:
1.6 AC

EROSION CONTROL LEGEND

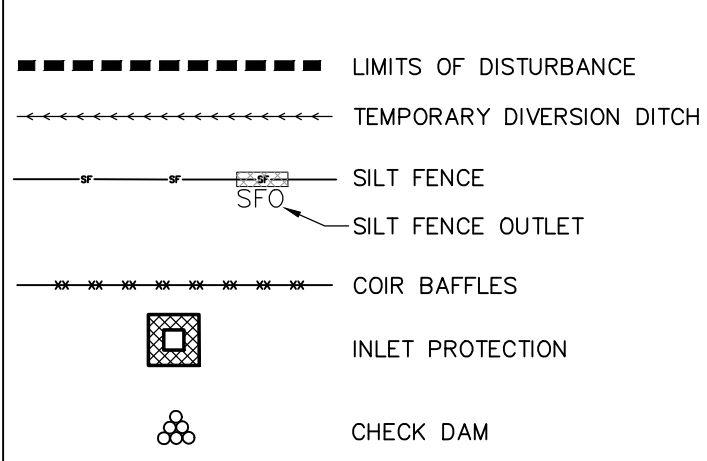

1) Ground Stabilization*		
Site Area Description	Stabilization Time Frame	Stabilization Time Frame Exceptions
• Perimeter dikes, swales, ditches and slopes	7 days	None
• High Quality Water (HQW) Zones	7 days	None
• Slopes steeper than 3:1	7 days	If slopes are 10' or less in length and are not steeper than 2:1, 14 days are allowed.
• Slopes 3:1 or flatter	14 days	7-days for slopes greater than 50 feet in length.
• All other areas with slopes flatter than 4:1	14 days	None (except for perimeters and HQW Zones)

* Extensions of time may be approved by the permitting authority based on weather or other site-specific conditions that make compliance impracticable. (Section II.B(2)(b))

STABILIZATION NOTES	
SLOPE	STABILIZATION
3:1 AND FLATTER	GRASS
3:1 TO 2:1 SLOPE	SLOPE ADAPTIVE PLANTS (SHRUBS AND VINES)
2:1 TO 1.5:1	RETAINING WALL
STEEPER THAN 1.5 TO 1	RIP-RAP (OR AS APPROVED BY GEO-TECH)
* SLOPES OF 2:1 OR STEEPER TO BE STABILIZED IMMEDIATELY WITH EXCELSIOR NETTING OR EQUAL	

* EROSION CONTROL MATTING SUFFICIENT FOR STABILIZATION IS REQUIRED FOR ALL SLOPES GREATER THAN 3:1 AND SLOPES GREATER THAN 5' TALL.

CONSTRUCTION SCHEDULE

- SCHEDULE A PRE-CONSTRUCTION CONFERENCE WITH THE ENVIRONMENTAL CONSULTANT. OBTAIN LAND-DISTURBING PERMIT. THE TOWN OF ZEBULON MAY ALSO REQUIRE A PRE-CONSTRUCTION CONFERENCE.
 - INSTALL GRAVEL CONSTRUCTION PADS, TEMPORARY DIVERSIONS, SILT FENCE, SEDIMENT BASINS OR OTHER MEASURES AS SHOWN ON THE APPROVED PLAN. CLEAR ONLY AS NECESSARY TO INSTALL THESE DEVICES. SEED TEMPORARY DIVERSIONS, BERMS AND BASINS IMMEDIATELY AFTER CONSTRUCTION.
 - CALL ENVIRONMENTAL CONSULTANT FOR ONSITE INSPECTION BY THE ENVIRONMENTAL CONSULTANT, TO OBTAIN CERTIFICATE OF COMPLIANCE.
 - BEGIN CLEARING AND GRUBBING. MAINTAIN DEVICES AS NEEDED. ROUGH GRADE SITE.
 - INSTALL STORM SEWER, AND PROTECT INLETS WITH GRAVEL YARD INLET PROTECTION, SEDIMENT TRAPS OR OTHER APPROVED MEASURES AS SHOWN ON THE PLAN. BEGIN CONSTRUCTION, BUILDING, ETC.
 - STABILIZE SITE AS AREAS ARE BROUGHT UP TO FINISH GRADE WITH VEGETATION, PAVING, DITCH LININGS, ETC. SEED AND MULCH DENUDATED AREAS PER GROUND STABILIZATION TIME FRAMES. *** PROMPT SEEDING, PARTICULARLY WHEN MOVING FROM ONE PHASE TO THE NEXT, WILL BE STRICTLY ENFORCED ***
 - WHEN CONSTRUCTION IS COMPLETE AND ALL AREAS ARE STABILIZED COMPLETELY, CALL ENVIRONMENTAL CONSULTANT FOR INSPECTION BY THE ENVIRONMENTAL CONSULTANT.
 - IF SITE IS APPROVED, REMOVE TEMPORARY DIVERSIONS, SILT FENCE, SEDIMENT BASINS, ETC., AND SEED OUT OR STABILIZE ANY RESULTING BARE AREAS. ALL REMAINING PERMANENT EROSION CONTROL DEVICES SUCH AS VELOCITY DISSIPATORS SHOULD BE INSTALLED NOW.
- NOTE: COORDINATE CONVERSION OF SEDIMENT BASIN TO PERMANENT BMP WITH WAKE COUNTY EROSION CONTROL AND TOWN OF ZEBULON. SEE BASIN REMOVAL SEQUENCE.
- WHEN VEGETATION HAS BECOME ESTABLISHED, CALL FOR A FINAL SITE INSPECTION BY THE ENVIRONMENTAL CONSULTANT TO OBTAIN A CERTIFICATE OF COMPLETION.

TEMPORARY DIVERSION DITCH DIMENSIONS

TEMPORARY DIVERSION DITCH #	BOTTOM WIDTH (FT)	DEPTH (FT)	LINING TYPE
1	2.0	1.0	JUTE MAT

BASIN REMOVAL SEQUENCE


- SCHEDULE A SITE MEETING WITH THE ENVIRONMENTAL CONSULTANT TO DETERMINE IF A BASIN CAN BE REMOVED. INSTALL SILT FENCING OR OTHER TEMPORARY EROSION CONTROL MEASURES AS NEEDED PRIOR TO REMOVAL OF THE BASIN.
- CONTACT NCDEQ –RALEIGH REGIONAL OFFICE (919) 791-4200 TO DETERMINE THE DIVISION OF ENERGY, MINERAL AND LAND RESOURCES CONTACT PERSON TO RECEIVE DEWATERING NOTIFICATIONS. AT LEAST 10 DAYS PRIOR TO BEGINNING DEWATERING ACTIVITY, SEND EMAIL TO NCDEQ-DEMLR CONTACT PERSON AND COPY ENVIRONMENTAL CONSULTANT THAT MET YOU ONSITE. THE EMAIL SHOULD INCLUDE: E&SC JURISDICTION WAKE COUNTY, WAKE COUNTY PROJECT: NAME, NUMBER, AND LOCATION (CITY/TOWN), ENVIRONMENTAL CONSULTANT NAME, AND ADDRESS THE FOLLOWING: A) REASON FOR CONVERSION, B) BASIN #, C) DEWATERING METHOD, AND D) ALL OTHER NECESSARY INFO FROM PART II, SECTION G, ITEM 4 OF THE NCG01. (KEEP EMAIL FOR YOUR NPDES MONITORING DOCUMENTATION).
- AFTER RECEIVING POSITIVE CONFIRMATION FROM NCDEQ-DEMLR THAT YOU MAY REMOVE THE BASIN OR ON ≥ DAY 11, WHICHEVER IS SOONER, REMOVE BASIN(S) AND ASSOCIATED TEMPORARY DIVERSION DITCHES. IF PIPES NEED TO BE EXTENDED, PERFORM THIS OPERATION AT THIS TIME. FINE GRADE AREA IN PREPARATION FOR SEEDING.
- PERFORM SEEDBED PREPARATION, SEED, MULCH AND ANCHOR ANY RESULTING BARE AREAS IMMEDIATELY.
- INSTALL VELOCITY DISSIPATORS AND/OR LEVEL SPREADERS AS REQUIRED ON THE EROSION CONTROL PLAN.
- WHEN SITE IS FULLY STABILIZED, CALL ENVIRONMENTAL CONSULTANT FOR APPROVAL OF REMOVING REMAINING TEMPORARY EROSION CONTROL MEASURES AND ADVICE ON WHEN SITE CAN BE ISSUED A CERTIFICATE OF COMPLETION. NOTE: A MEETING SHOULD ALSO BE SCHEDULED WITH THE ENVIRONMENTAL CONSULTANT TO DETERMINE WHEN A BASIN MAY BE CONVERTED FOR STORMWATER USE. SOME MUNICIPALITIES MAY ALSO REQUIRE THIS.

GENERAL EROSION CONTROL NOTES

- ALL SEDIMENT BASINS SHALL HAVE A 15' MAINTENANCE EASEMENT, WHICH IS TO BE IN EFFECT ONLY UNTIL THE BASIN IS REMOVED.
 - SEDIMENT SHALL BE REMOVED FROM BASINS WHEN SEDIMENT STORAGE REACHES 50%. SEDIMENT BASINS ARE TO REMAIN IN PLACE DURING THE HOME CONSTRUCTION PHASE OF THE PROJECT AND ONLY REMOVED WITH APPROVAL FROM THE WAKE COUNTY WATERSHED MANAGER.
 - ALL SEDIMENT BASINS REQUIRE BAFFLES INSTALLED PER DETAILS ON DETAIL SHEET.
 - DIVERSIONS SHALL BE MODIFIED AS NEEDED TO ENSURE SEDIMENT LADEN WATER GOES INTO THE APPROPRIATE BASIN AT ALL TIMES.
 - THE WATERSHED MANAGER MAY DETERMINE THAT FLOCCULANTS WILL BE REQUIRED DURING CONSTRUCTION, IF NECESSARY.
- SOIL STOCKPILE NOTES**
- SEEDING OR COVERING STOCKPILES WITH TARPS OR MULCH IS REQUIRED AND WILL REDUCE EROSION PROBLEMS. TARPS SHOULD BE KEVED IN AT THE TOP OF THE SLOPE TO KEEP WATER FROM RUNNING UNDERNEATH THE PLASTIC.
 - IF A STOCKPILE IS TO REMAIN FOR FUTURE USE AFTER THE PROJECT IS COMPLETE (BUILDERS, ETC.), THE FINANCIAL RESPONSIBLE PARTY MUST NOTIFY WAKE COUNTY A NEW RESPONSIBLE PARTY FOR THAT STOCKPILE.
 - THE APPROVED PLAN SHALL PROVIDE FOR THE USE OF STAGED SEEDING AND MULCHING ON A CONTINUAL BASIS WHILE THE STOCKPILE IS IN USE.
 - ESTABLISH AND MAINTAIN A VEGETATIVE BUFFER AT THE TOE OF THE SLOPE (WHERE PRACTICAL).
 - HEIGHT SHALL NOT EXCEED 35'



8522-204 SIX FORKS ROAD
RALEIGH, NORTH CAROLINA 27615
919.845.7600 PHONE
919.845.7703 FAX
ENGR. FIRM LICENSE NO. F-0843

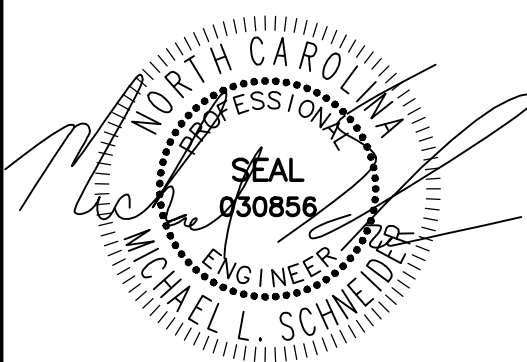

2/04/25

MADISON RIDGE TOWNHOMES

901 MACK TODD ROAD
ZEBULON, NORTH CAROLINA

ISSUED: 04 FEB 2025


REVISIONS:

DRAWN BY: MLS

CHECKED BY: MLS


PROJECT: CPMTRZ

STAGE ONE
EROSION CONTROL
PLAN

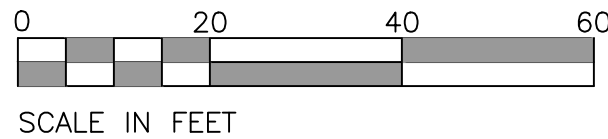

DWG. NO. SITE 6

F:\Projects\CPMTRZ\Drawings\Site\CPMTRZ_Base.dwg -- 6-7 EROSION -- Mar 18, '25 -- 11:36am

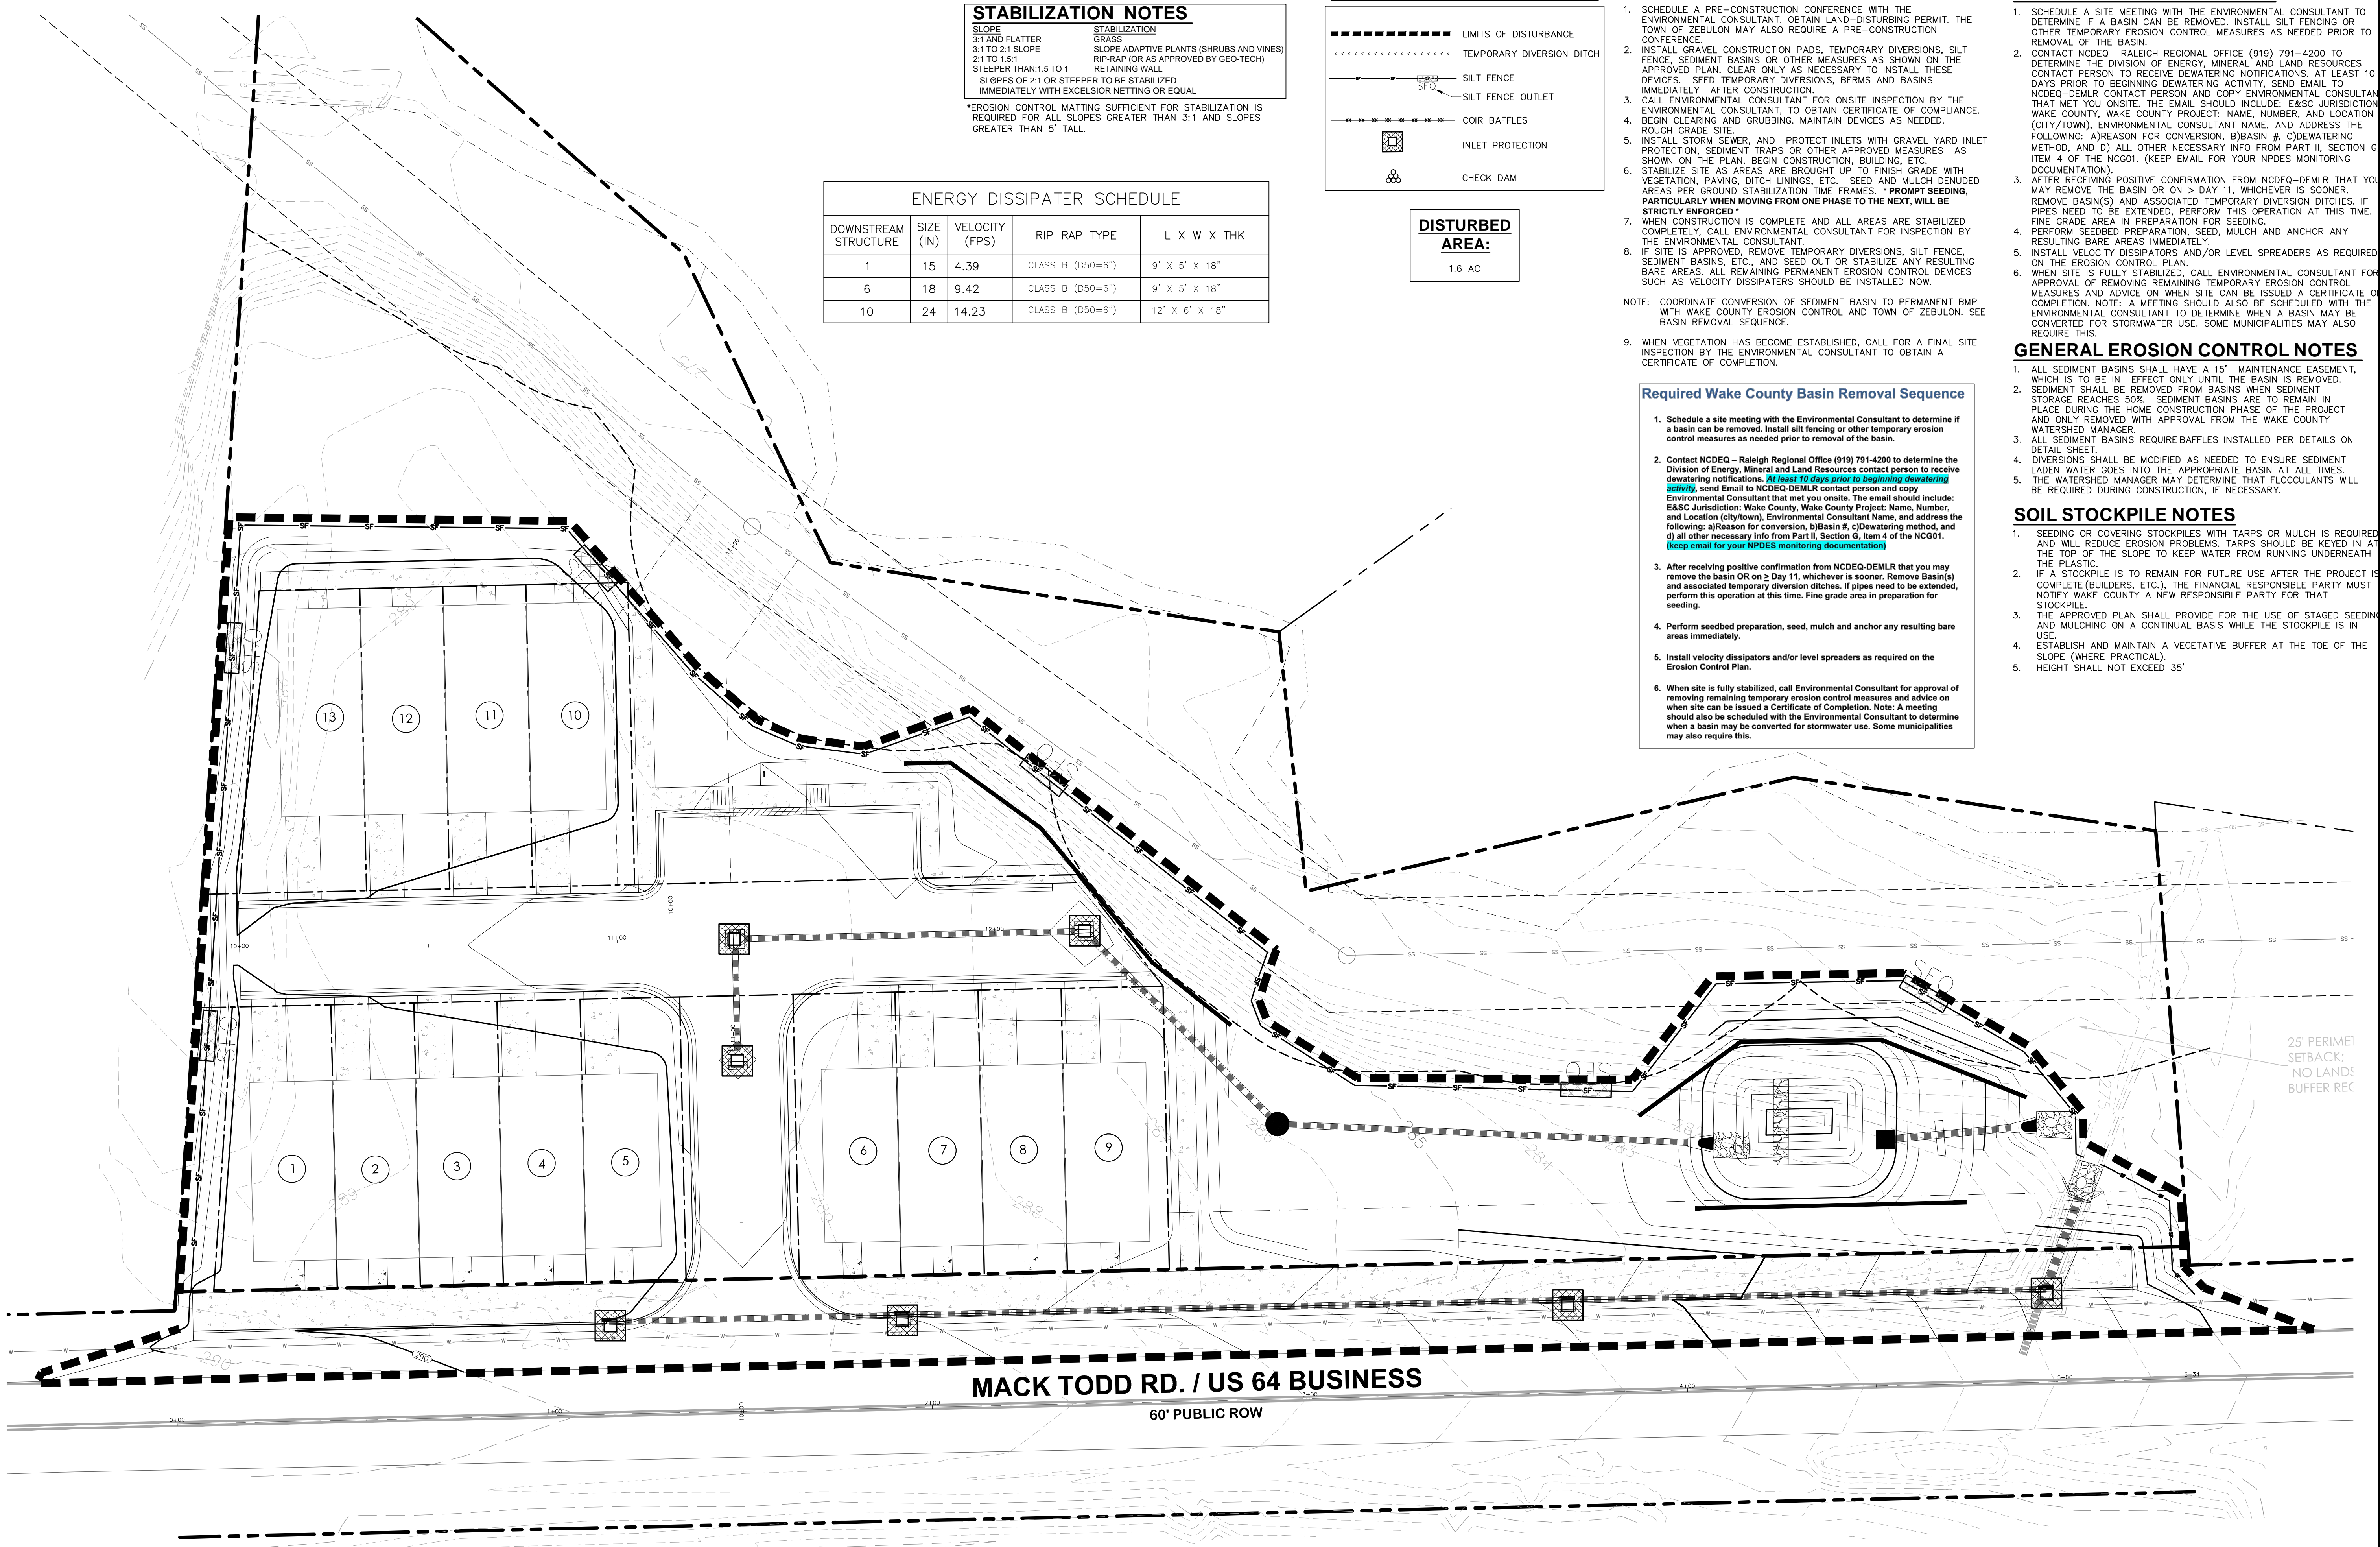

STABILIZATION NOTES


SLOPE	STABILIZATION
3:1 AND FLATTER	GRASS
3:1 TO 2:1 SLOPE	SLOPE ADAPTIVE PLANTS (SHRUBS AND VINES)
2:1 TO 1.5:1	RIP-RAP (OR AS APPROVED BY GEO-TECH)
STEEPER THAN 1.5 TO 1	RETAINING WALL
SLOPES OF 2:1 OR STEEPER TO BE STABILIZED IMMEDIATELY WITH EXCELSIOR NETTING OR EQUAL.	

*EROSION CONTROL MATTING SUFFICIENT FOR STABILIZATION IS REQUIRED FOR ALL SLOPES GREATER THAN 3:1 AND SLOPES GREATER THAN 5' TALL.

ENERGY DISSIPATER SCHEDULE

DOWNSTREAM STRUCTURE	SIZE (IN)	VELOCITY (FPS)	RIP RAP TYPE	L X W X THK
1	15	4.39	CLASS B (D50=6")	9' X 5' X 18"
6	18	9.42	CLASS B (D50=6")	9' X 5' X 18"
10	24	14.23	CLASS B (D50=6")	12' X 6' X 18"

EROSION CONTROL LEGEND

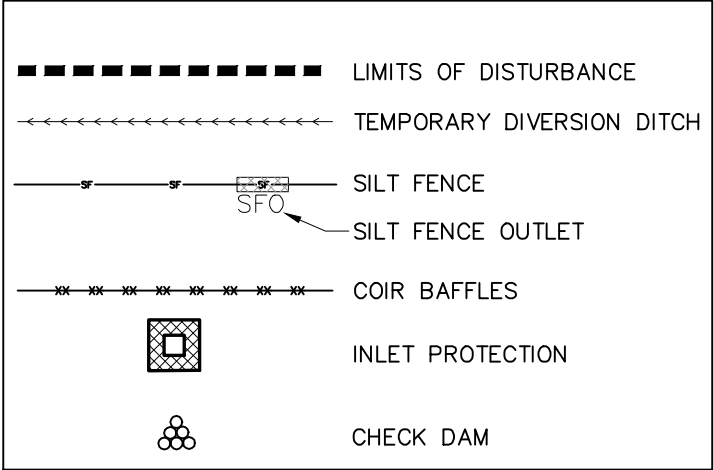

DISTURBED AREA:

1.6 AC

CONSTRUCTION SCHEDULE

- SCHEDULE A PRE-CONSTRUCTION CONFERENCE WITH THE ENVIRONMENTAL CONSULTANT. OBTAIN LAND-DISTURBING PERMIT. THE TOWN OF ZEBULON MAY ALSO REQUIRE A PRE-CONSTRUCTION CONFERENCE.
- INSTALL GRAVEL CONSTRUCTION PADS, TEMPORARY DIVERSIONS, SILT FENCE, SEDIMENT BASINS OR OTHER MEASURES AS SHOWN ON THE APPROVED PLAN. CLEAR ONLY AS NECESSARY TO INSTALL THESE DEVICES. SEED TEMPORARY DIVERSIONS, BERMS AND BASINS IMMEDIATELY AFTER CONSTRUCTION.
- CALL ENVIRONMENTAL CONSULTANT FOR ONSITE INSPECTION BY THE ENVIRONMENTAL CONSULTANT, TO OBTAIN CERTIFICATE OF COMPLIANCE.
- BEGIN CLEARING AND GRUBBING. MAINTAIN DEVICES AS NEEDED. ROUGH GRADE SITE.
- INSTALL STORM SEWER, AND PROTECT INLETS WITH GRAVEL YARD INLET PROTECTION, SEDIMENT TRAPS OR OTHER APPROVED MEASURES AS SHOWN ON THE PLAN. BEGIN CONSTRUCTION, BUILDING, ETC.
- STABILIZE SITE AS AREAS ARE BROUGHT UP TO FINISH GRADE WITH VEGETATION, PAVING, DITCH LININGS, ETC. SEED AND MULCH DENUDED AREAS PER GROUND STABILIZATION TIME FRAMES. *PROMPT SEEDING, PARTICULARLY WHEN MOVING FROM ONE PHASE TO THE NEXT, WILL BE STRICTLY ENFORCED.*
- WHEN CONSTRUCTION IS COMPLETE AND ALL AREAS ARE STABILIZED COMPLETELY, CALL ENVIRONMENTAL CONSULTANT FOR INSPECTION BY THE ENVIRONMENTAL CONSULTANT.
- IF SITE IS APPROVED, REMOVE TEMPORARY DIVERSIONS, SILT FENCE, SEDIMENT BASINS, ETC., AND SEED OUT OR STABILIZE ANY RESULTING BARE AREAS. ALL REMAINING PERMANENT EROSION CONTROL DEVICES SUCH AS VELOCITY DISSIPATERS SHOULD BE INSTALLED NOW.

NOTE: COORDINATE CONVERSION OF SEDIMENT BASIN TO PERMANENT BMP WITH WAKE COUNTY EROSION CONTROL AND TOWN OF ZEBULON. SEE BASIN REMOVAL SEQUENCE.

- WHEN VEGETATION HAS BECOME ESTABLISHED, CALL FOR A FINAL SITE INSPECTION BY THE ENVIRONMENTAL CONSULTANT TO OBTAIN A CERTIFICATE OF COMPLETION.

Required Wake County Basin Removal Sequence

- Schedule a site meeting with the Environmental Consultant to determine if a basin can be removed. Install silt fencing or other temporary erosion control measures as needed prior to removal of the basin.
- Contact NCDEQ - Raleigh Regional Office (919) 791-4200 to determine the Division of Energy, Mineral and Land Resources contact person to receive dewatering notifications. **At least 10 days prior to beginning dewatering activity**, send Email to NCDEQ-DEMLR contact person and copy Environmental Consultant that met you onsite. The email should include: EASC Jurisdiction: Wake County, Wake County Project: Name, Number, and Location (city/town), Environmental Consultant Name, and address the following: a)Reason for conversion, b)Basin #, c)Dewatering method, and d) all other necessary info from Part II, Section G, Item 4 of the NCG01. **(Keep email for your NPDES monitoring documentation)**
- After receiving positive confirmation from NCDEQ-DEMLR that you may remove the basin OR on > Day 11, whichever is sooner, Remove Basin(s) and associated temporary diversion ditches. If pipes need to be extended, perform this operation at this time. Fine grade area in preparation for seeding.
- Perform seedbed preparation, seed, mulch and anchor any resulting bare areas immediately.
- Install velocity dissipaters and/or level spreaders as required on the Erosion Control Plan.
- When site is fully stabilized, call Environmental Consultant for approval of removing remaining temporary erosion control measures and advice on when site can be issued a Certificate of Completion. Note: A meeting should also be scheduled with the Environmental Consultant to determine when a basin may be converted for stormwater use. Some municipalities may also require this.

BASIN REMOVAL SEQUENCE

- SCHEDULE A SITE MEETING WITH THE ENVIRONMENTAL CONSULTANT TO DETERMINE IF A BASIN CAN BE REMOVED. INSTALL SILT FENCING OR OTHER TEMPORARY EROSION CONTROL MEASURES AS NEEDED PRIOR TO REMOVAL OF THE BASIN.
- CONTACT NCDEQ - RALEIGH REGIONAL OFFICE (919) 791-4200 TO DETERMINE THE DIVISION OF ENERGY, MINERAL AND LAND RESOURCES CONTACT PERSON TO RECEIVE DEWATERING NOTIFICATIONS. AT LEAST 10 DAYS PRIOR TO BEGINNING DEWATERING ACTIVITY, SEND EMAIL TO NCDEQ-DEMLR CONTACT PERSON AND COPY ENVIRONMENTAL CONSULTANT THAT MET YOU ONSITE. THE EMAIL SHOULD INCLUDE: EASC JURISDICTION WAKE COUNTY, WAKE COUNTY PROJECT: NAME, NUMBER, AND LOCATION (CITY/TOWN), ENVIRONMENTAL CONSULTANT NAME, AND ADDRESS THE FOLLOWING: A)REASON FOR CONVERSION, b)BASIN #, c)DEWATERING METHOD, AND d) ALL OTHER NECESSARY INFO FROM PART II, SECTION G, ITEM 4 OF THE NCG01. (KEEP EMAIL FOR YOUR NPDES MONITORING DOCUMENTATION).
- AFTER RECEIVING POSITIVE CONFIRMATION FROM NCDEQ-DEMLR THAT YOU MAY REMOVE THE BASIN OR ON > DAY 11, WHICHEVER IS SOONER, REMOVE BASIN(S) AND ASSOCIATED TEMPORARY DIVERSION DITCHES. IF PIPES NEED TO BE EXTENDED, PERFORM THIS OPERATION AT THIS TIME. FINE GRADE AREA IN PREPARATION FOR SEEDING.
- PERFORM SEEDBED PREPARATION, SEED, MULCH AND ANCHOR ANY RESULTING BARE AREAS IMMEDIATELY.
- INSTALL VELOCITY DISSIPATORS AND/OR LEVEL SPREADERS AS REQUIRED ON THE EROSION CONTROL PLAN.
- WHEN SITE IS FULLY STABILIZED, CALL ENVIRONMENTAL CONSULTANT FOR APPROVAL OF REMOVING REMAINING TEMPORARY EROSION CONTROL MEASURES AND ADVICE ON WHEN SITE CAN BE ISSUED A CERTIFICATE OF COMPLETION. NOTE: A MEETING SHOULD ALSO BE SCHEDULED WITH THE ENVIRONMENTAL CONSULTANT TO DETERMINE WHEN A BASIN MAY BE CONVERTED FOR STORMWATER USE. SOME MUNICIPALITIES MAY ALSO REQUIRE THIS.

GENERAL EROSION CONTROL NOTES

- ALL SEDIMENT BASINS SHALL HAVE A 15' MAINTENANCE EASEMENT, WHICH IS TO BE IN EFFECT ONLY UNTIL THE BASIN IS REMOVED.
- SEDIMENT SHALL BE REMOVED FROM BASINS WHEN SEDIMENT STORAGE REACHES 50%. SEDIMENT BASINS ARE TO REMAIN IN PLACE DURING THE HOME CONSTRUCTION PHASE OF THE PROJECT AND ONLY REMOVED WITH APPROVAL FROM THE WAKE COUNTY WATERSHED MANAGER.
- ALL SEDIMENT BASINS REQUIRE BAFFLES INSTALLED PER DETAILS ON DETAIL SHEET.
- DIVERSIONS SHALL BE MODIFIED AS NEEDED TO ENSURE SEDIMENT LADEN WATER GOES INTO THE APPROPRIATE BASIN AT ALL TIMES.
- THE WATERSHED MANAGER MAY DETERMINE THAT FLOCCULANTS WILL BE REQUIRED DURING CONSTRUCTION, IF NECESSARY.


SOIL STOCKPILE NOTES

- SEEDING OR COVERING STOCKPILES WITH TARPS OR MULCH IS REQUIRED AND WILL REDUCE EROSION PROBLEMS. TARPS SHOULD BE KEYED IN AT THE TOP OF THE SLOPE TO KEEP WATER FROM RUNNING UNDERNEATH THE PLASTIC.
- IF A STOCKPILE IS TO REMAIN FOR FUTURE USE AFTER THE PROJECT IS COMPLETE (BUILDERS, ETC.), THE FINANCIAL RESPONSIBLE PARTY MUST NOTIFY WAKE COUNTY A NEW RESPONSIBLE PARTY FOR THAT STOCKPILE.
- THE APPROVED PLAN SHALL PROVIDE FOR THE USE OF STAGED SEEDING AND MULCHING ON A CONTINUAL BASIS WHILE THE STOCKPILE IS IN USE.
- ESTABLISH AND MAINTAIN A VEGETATIVE BUFFER AT THE TOE OF THE SLOPE (WHERE PRACTICAL).
- HEIGHT SHALL NOT EXCEED 35'

PLD

HEMONTIANDESIGN PLLC

8522-204 SIX FORKS ROAD
RALEIGH, NORTH CAROLINA 27615
919.845.7600 PHONE
919.845.7703 FAX
ENGR. FIRM LICENSE NO. F-0843

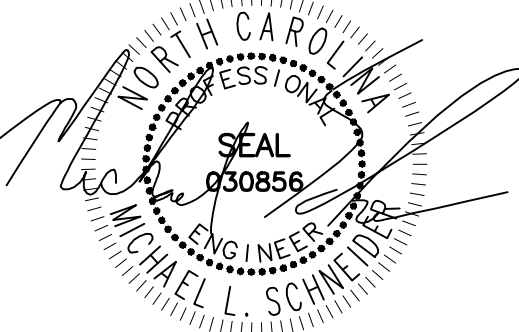

2/04/25

MADISON RIDGE TOWNHOMES

901 MACK TODD ROAD
ZEBULON, NORTH CAROLINA

ISSUED: 04 FEB 2025

REVISIONS:

DRAWN BY: MLS


CHECKED BY: MLS

PROJECT: CPMTRZ


STAGE TWO
EROSION CONTROL
PLAN

DWG. NO. SITE 7







NORTH

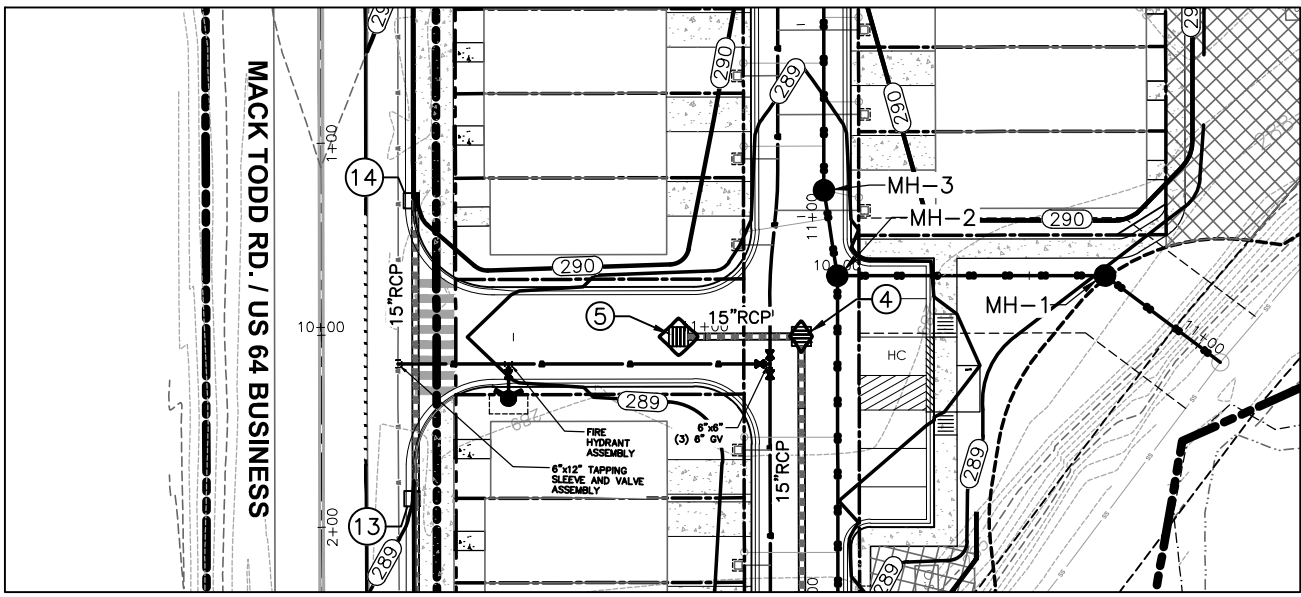


STREET A - PLAN VIEW

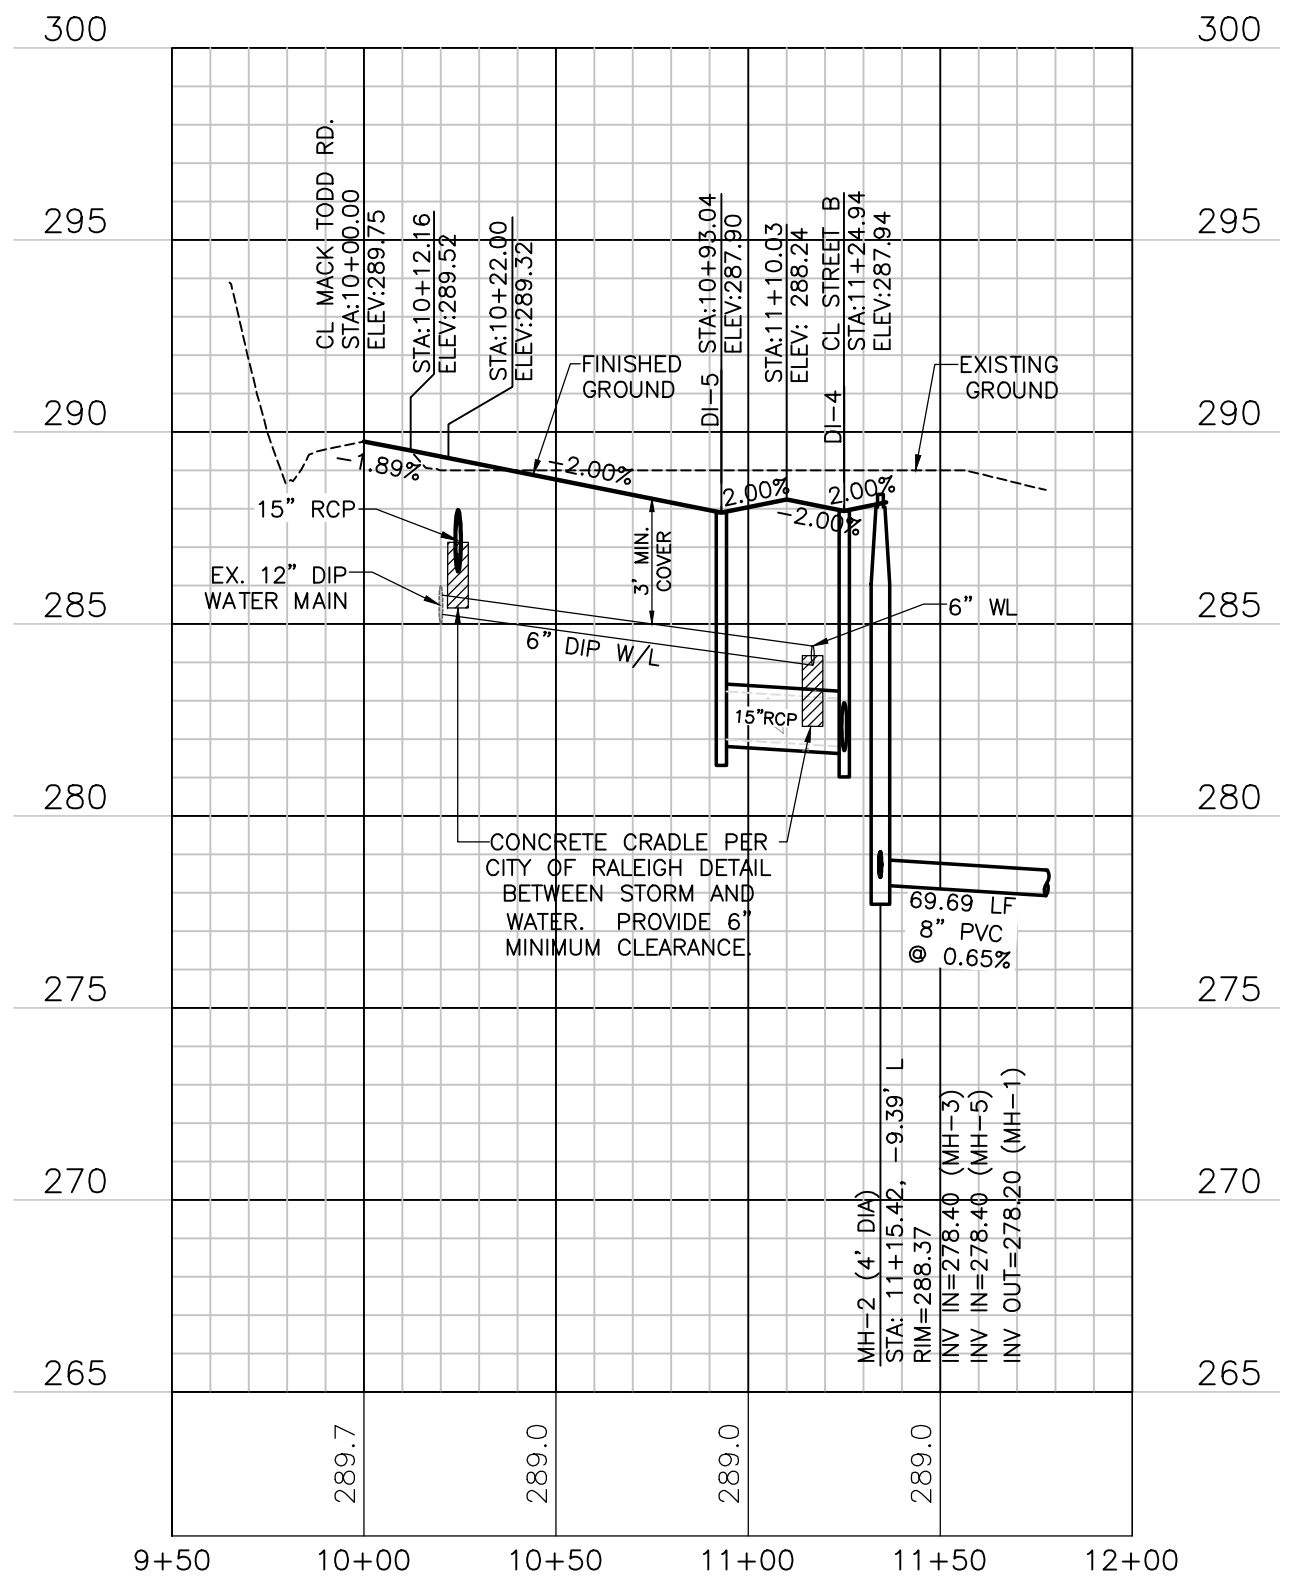


STREET A - PROFILE




NORTH

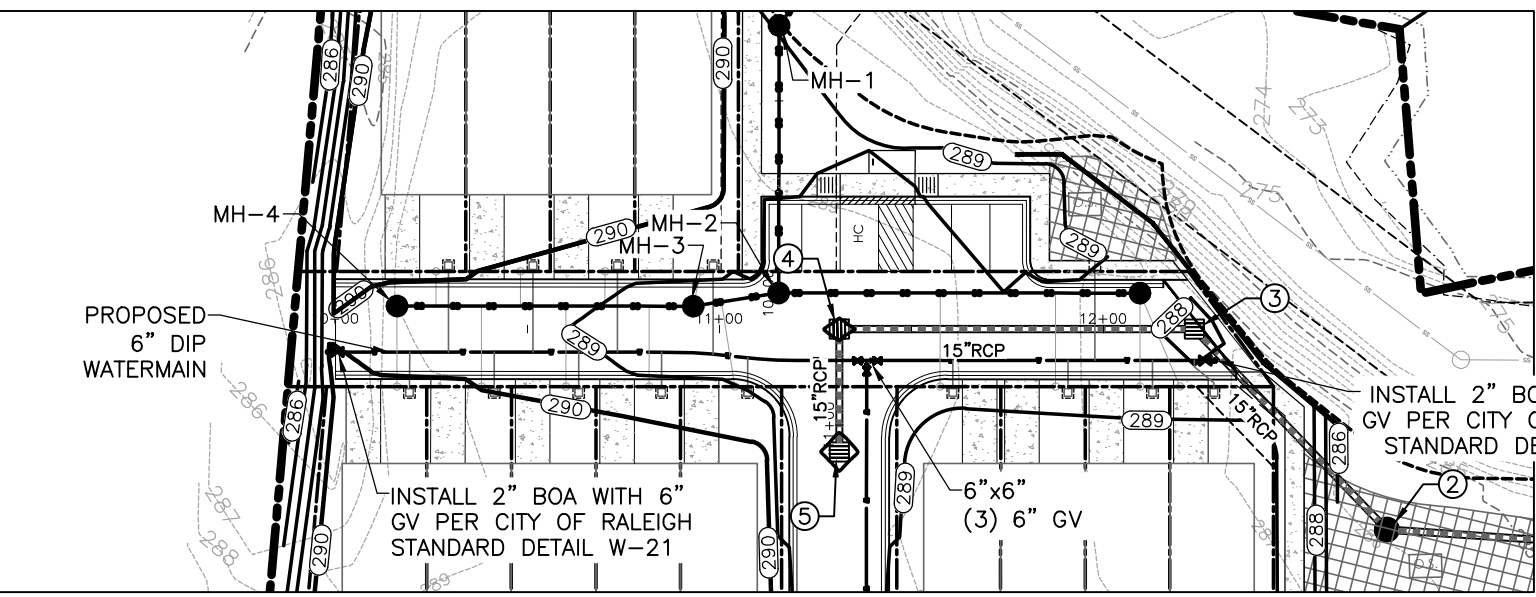


STREET B - PLAN VIEW

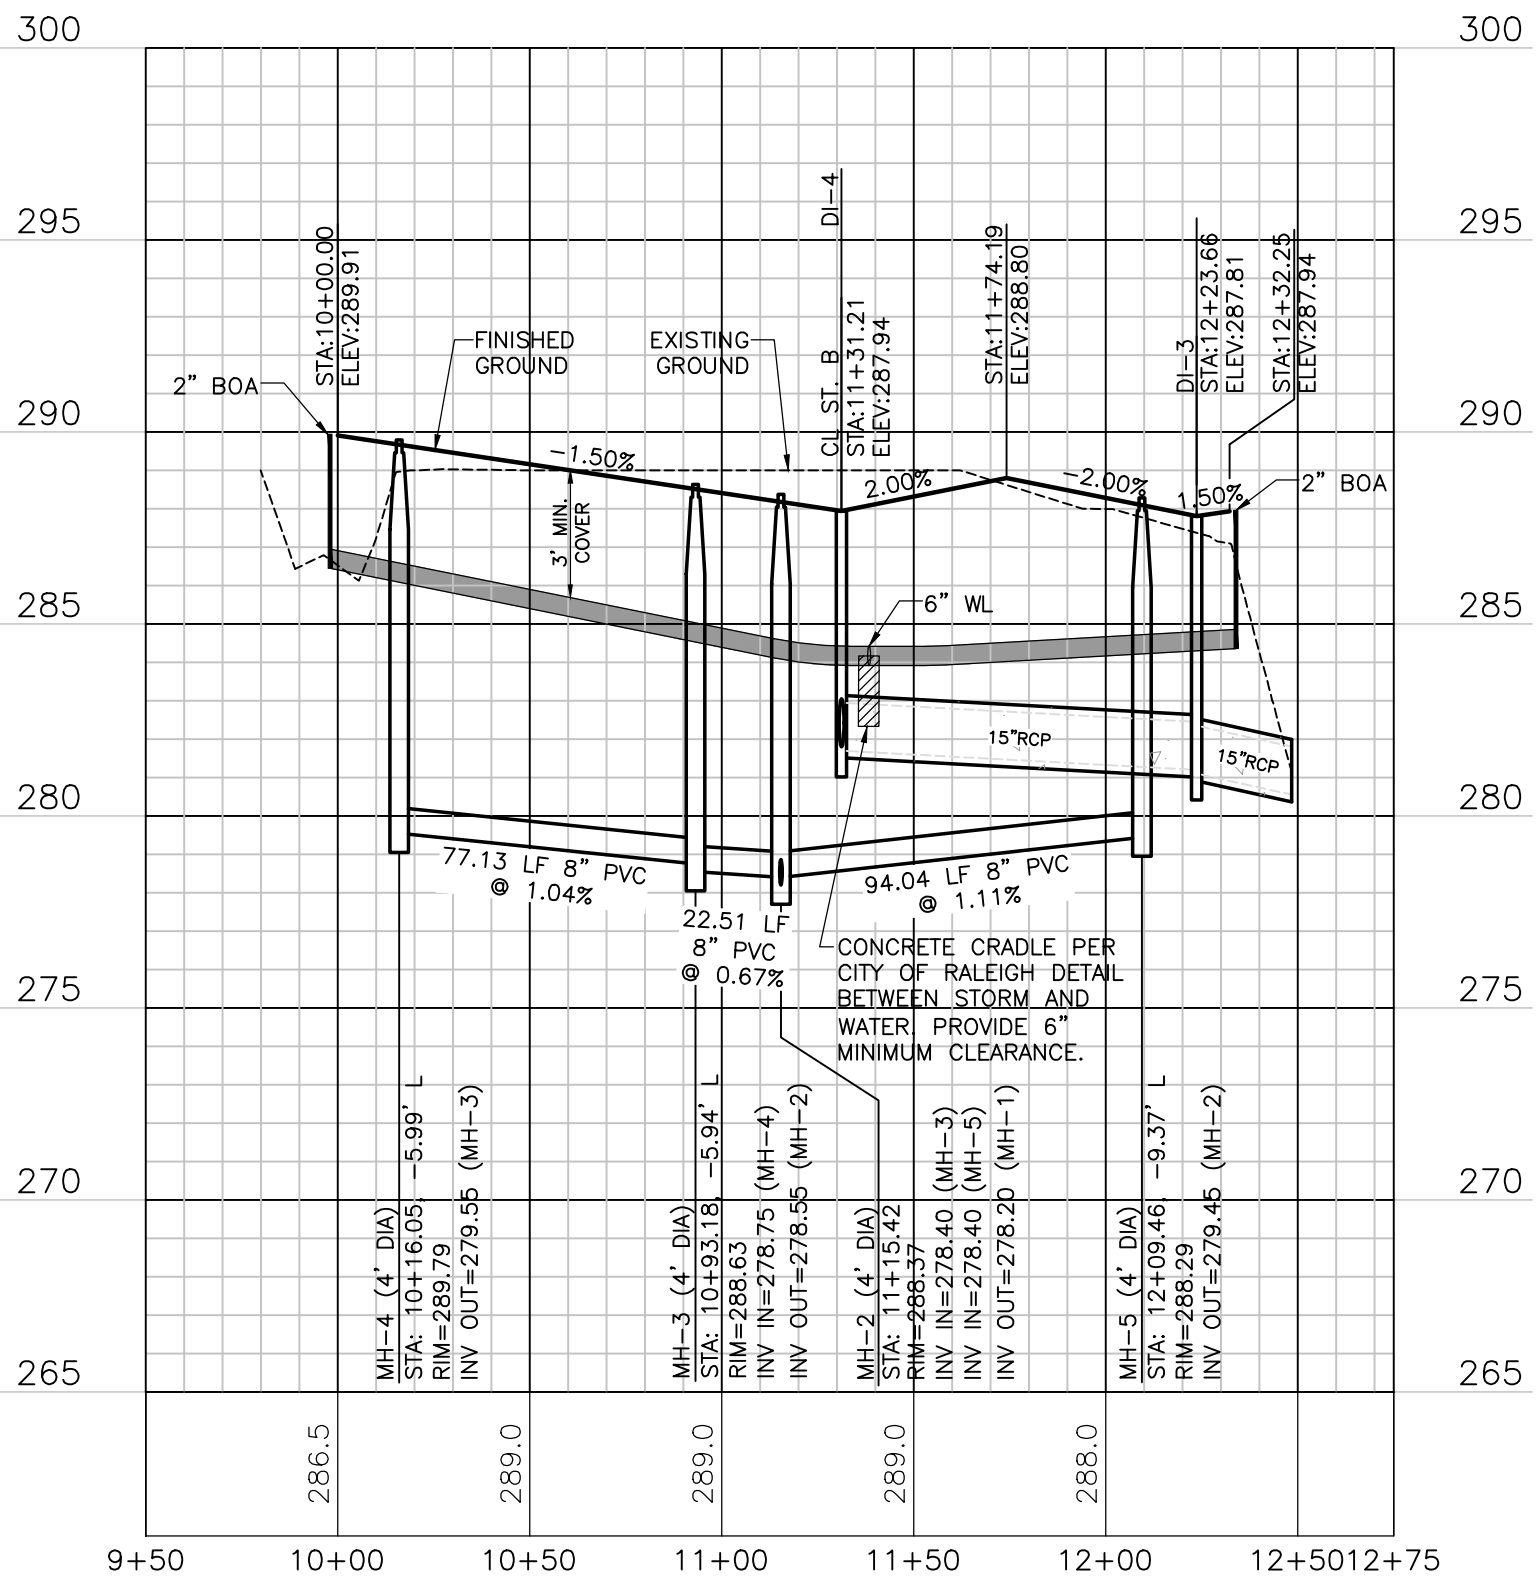


STREET B - PROFILE



NORTH

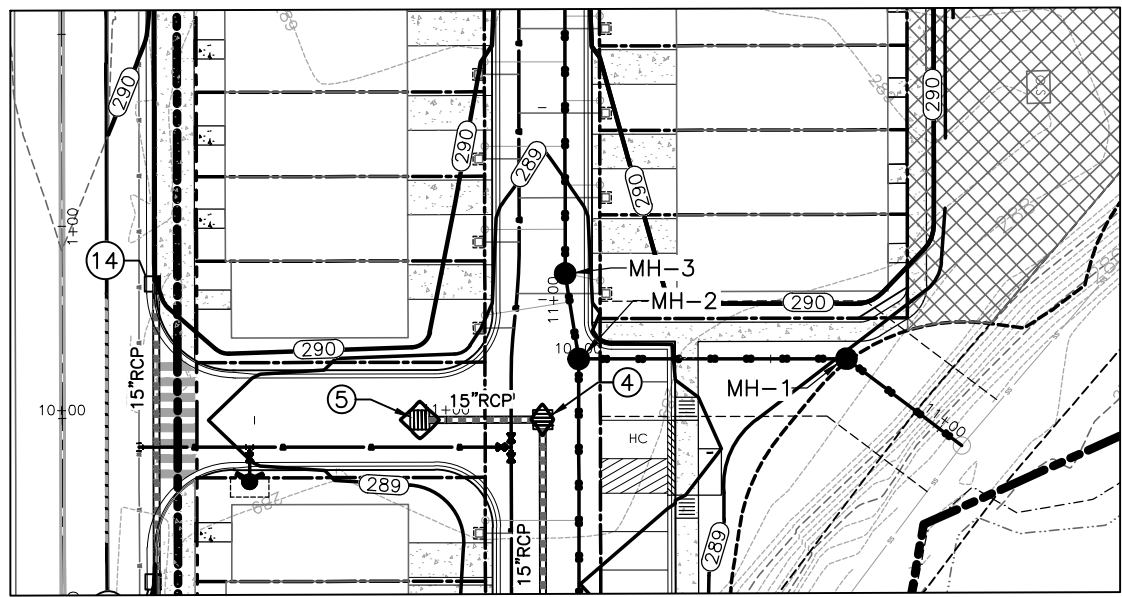

SANITARY SEWER OUTFALL - PLAN VIEW

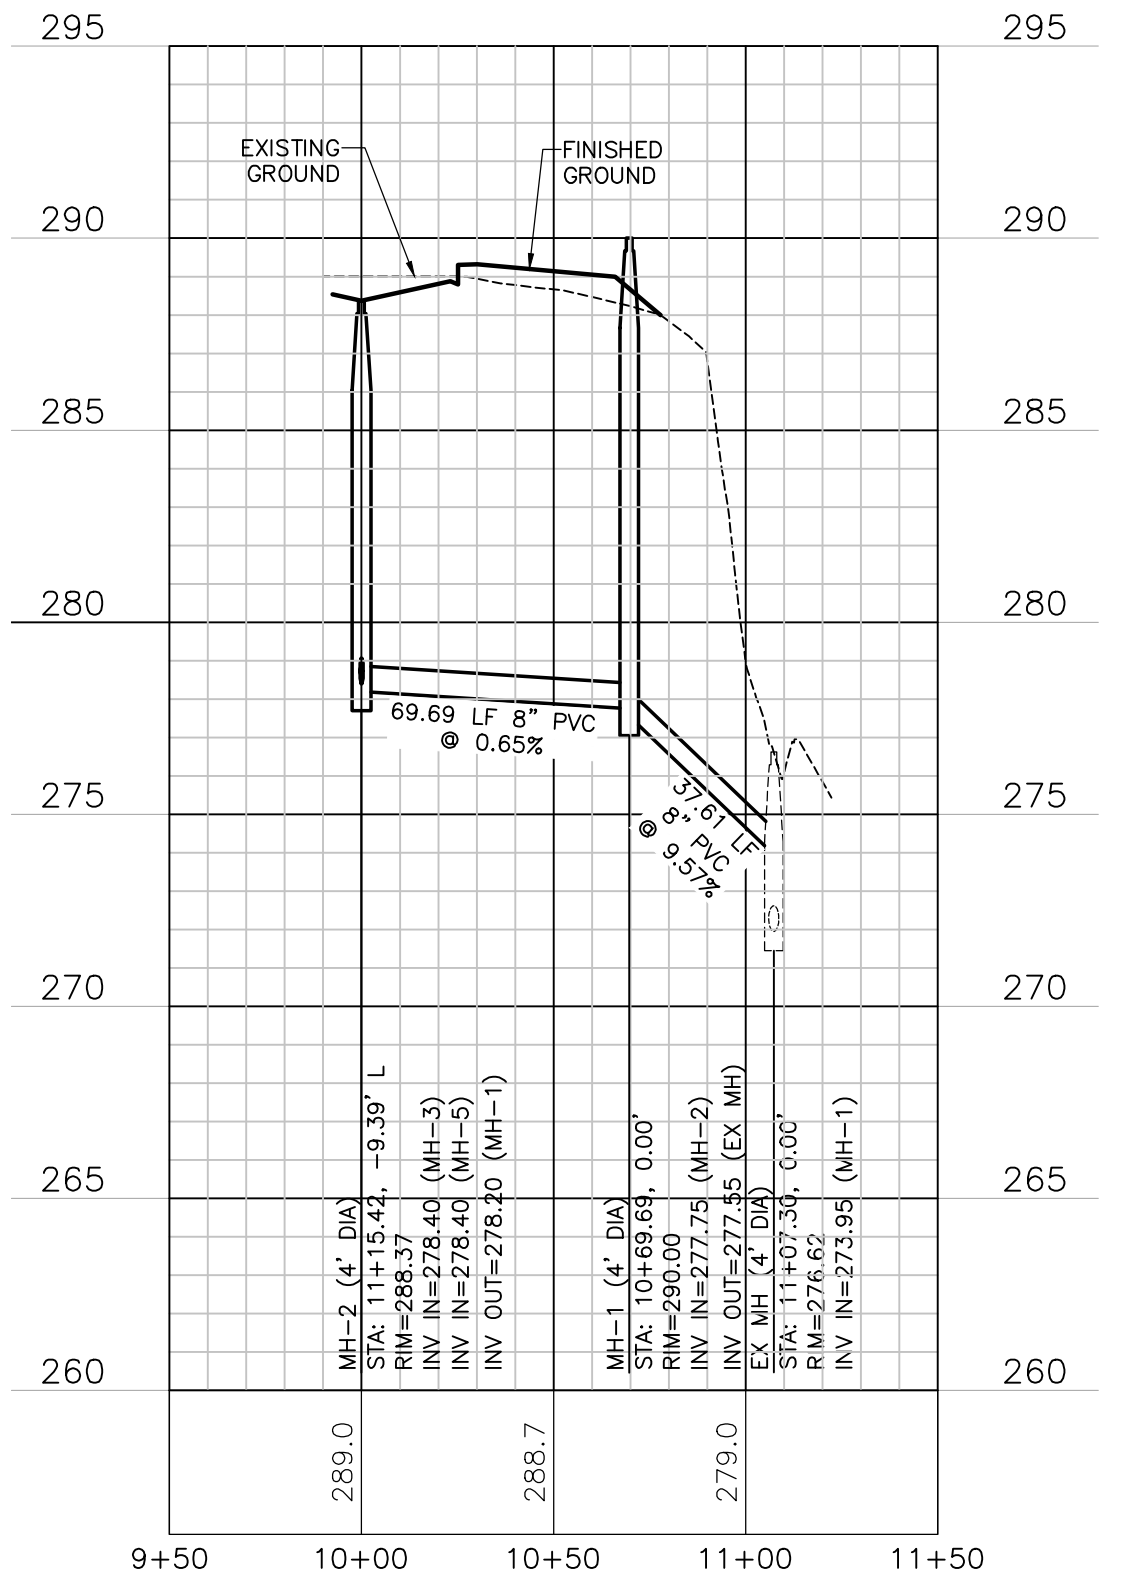


SANITARY SEWER OUTFALL - PROFILE

PID

HEMNTIANDSIGN P.C.

8522-204 SIX FORKS ROAD
RALEIGH, NORTH CAROLINA 27615
919.845.7600 PHONE
919.845.7703 FAX
ENGR. FIRM LICENSE NO. F-0843

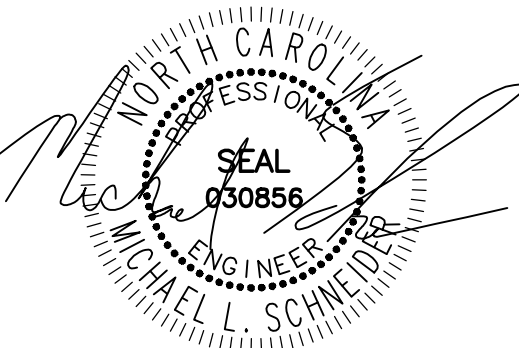

2/04/25

MADISON RIDGE TOWNHOMES

901 MACK TODD ROAD
ZEBULON, NORTH CAROLINA

ISSUED: 04 FEB 2025

REVISIONS:

DRAWN BY: MLS

CHECKED BY: MLS

PROJECT: CPMTRZ

STREETS A & B,
AND SS OUTFALL
PLAN & PROFILES

DWG. NO. SITE 8

ATTENTION CONTRACTORS

The Contractor responsible for the extension of water, sewer, and/or reuse, as approved in these plans, is responsible for contacting the Public Utilities Inspector at 919-996-3245 or <https://cityworks.raleighnc.gov/nucontractors/New> and schedule a Pre-construction meeting prior to beginning any construction. Raleigh Water must be contacted at (919) 996-4540 at least twenty-four hours prior to beginning any work activity around critical water and sewer infrastructure.

Failure to notify the Divisions in advance of beginning construction, will result in the issuance of monetary fines, and require reinstallation of any water or sewer facilities not inspected as a result of this notification failure.

Failure to call for Inspection, install a downstream plug, have permitted plans on the jobsite, or any other violation of City of Raleigh Standards will result in a fine and possible exclusion from future work in the City of Raleigh.

**Public
Water Distribution / Extension System**

The City of Raleigh consents to the connection and extension of the City's public water system as shown on this plan. The material and Construction methods used for this project shall conform to the standards and specifications of the City's Public Utilities Handbook.



City of Raleigh
Public Utilities Department Permit # _____
Authorization to Construct See digital signature

**Public
Sewer Collection / Extension System**

The City of Raleigh consents to the connection and extension of the City's public sewer system as shown on this plan. The material and Construction methods used for this project shall conform to the standards and specifications of the City's Public Utilities Handbook.

City of Raleigh
Public Utilities Department Permit # _____
Authorization to Construct See digital signature



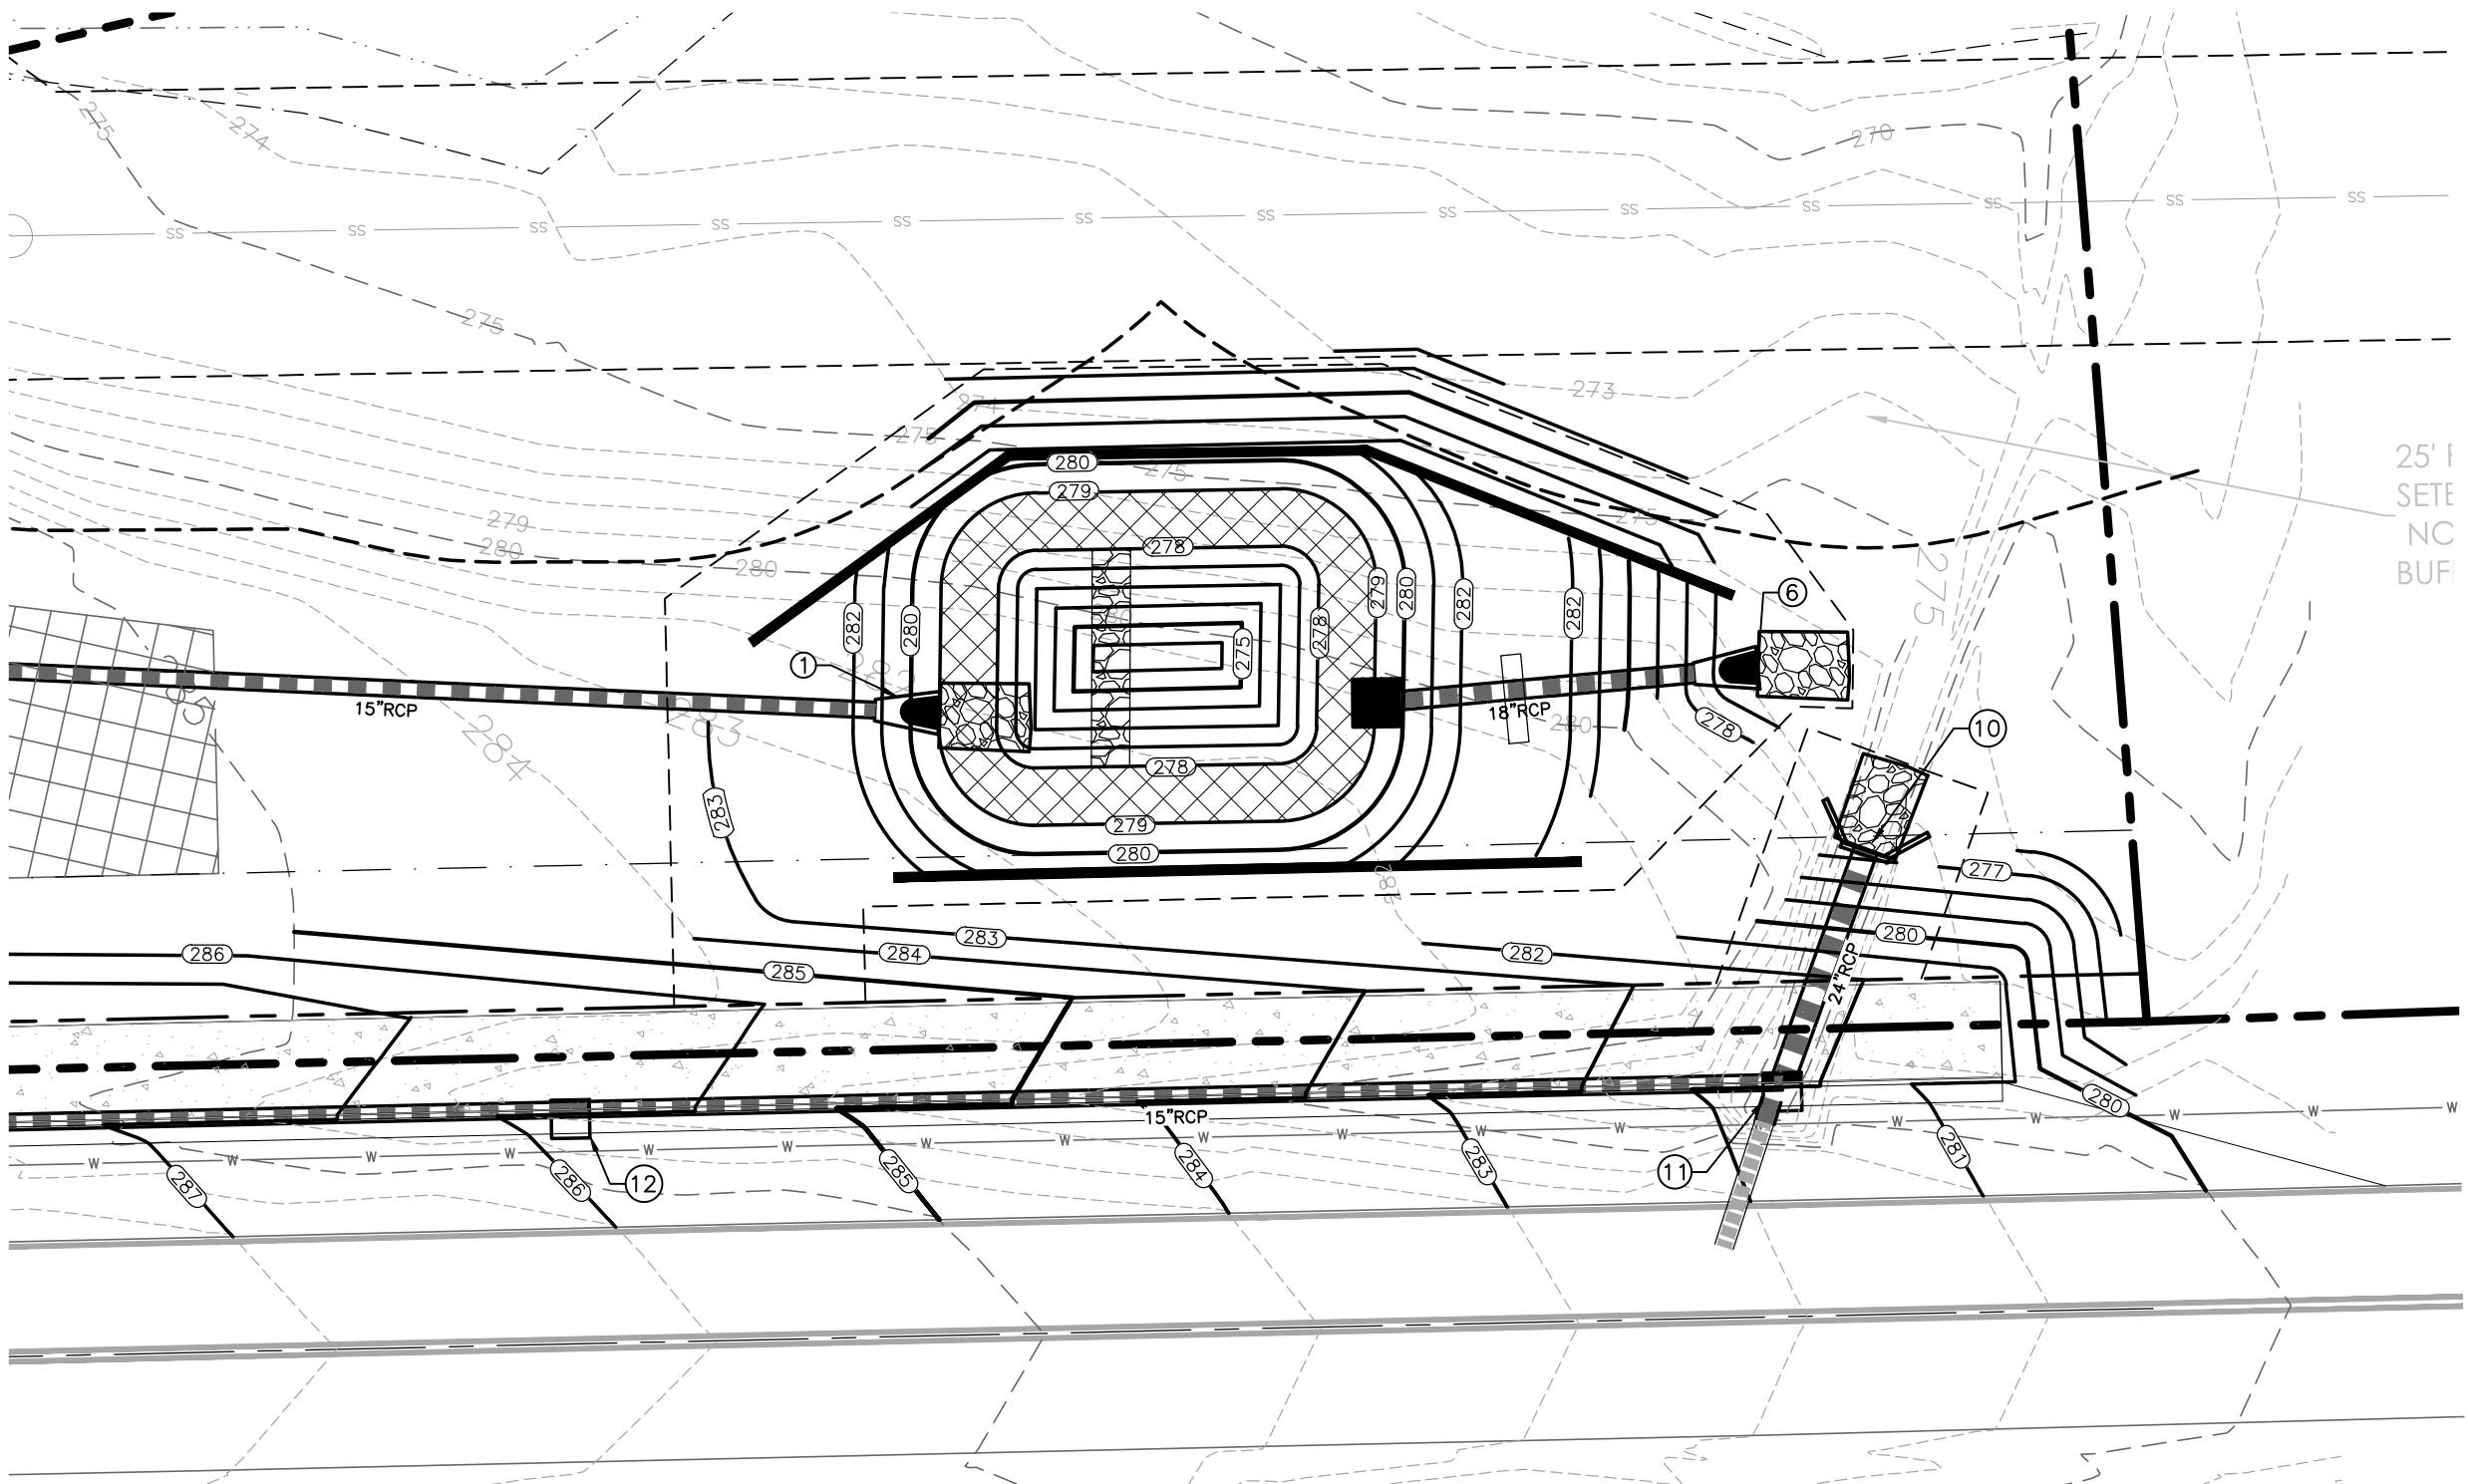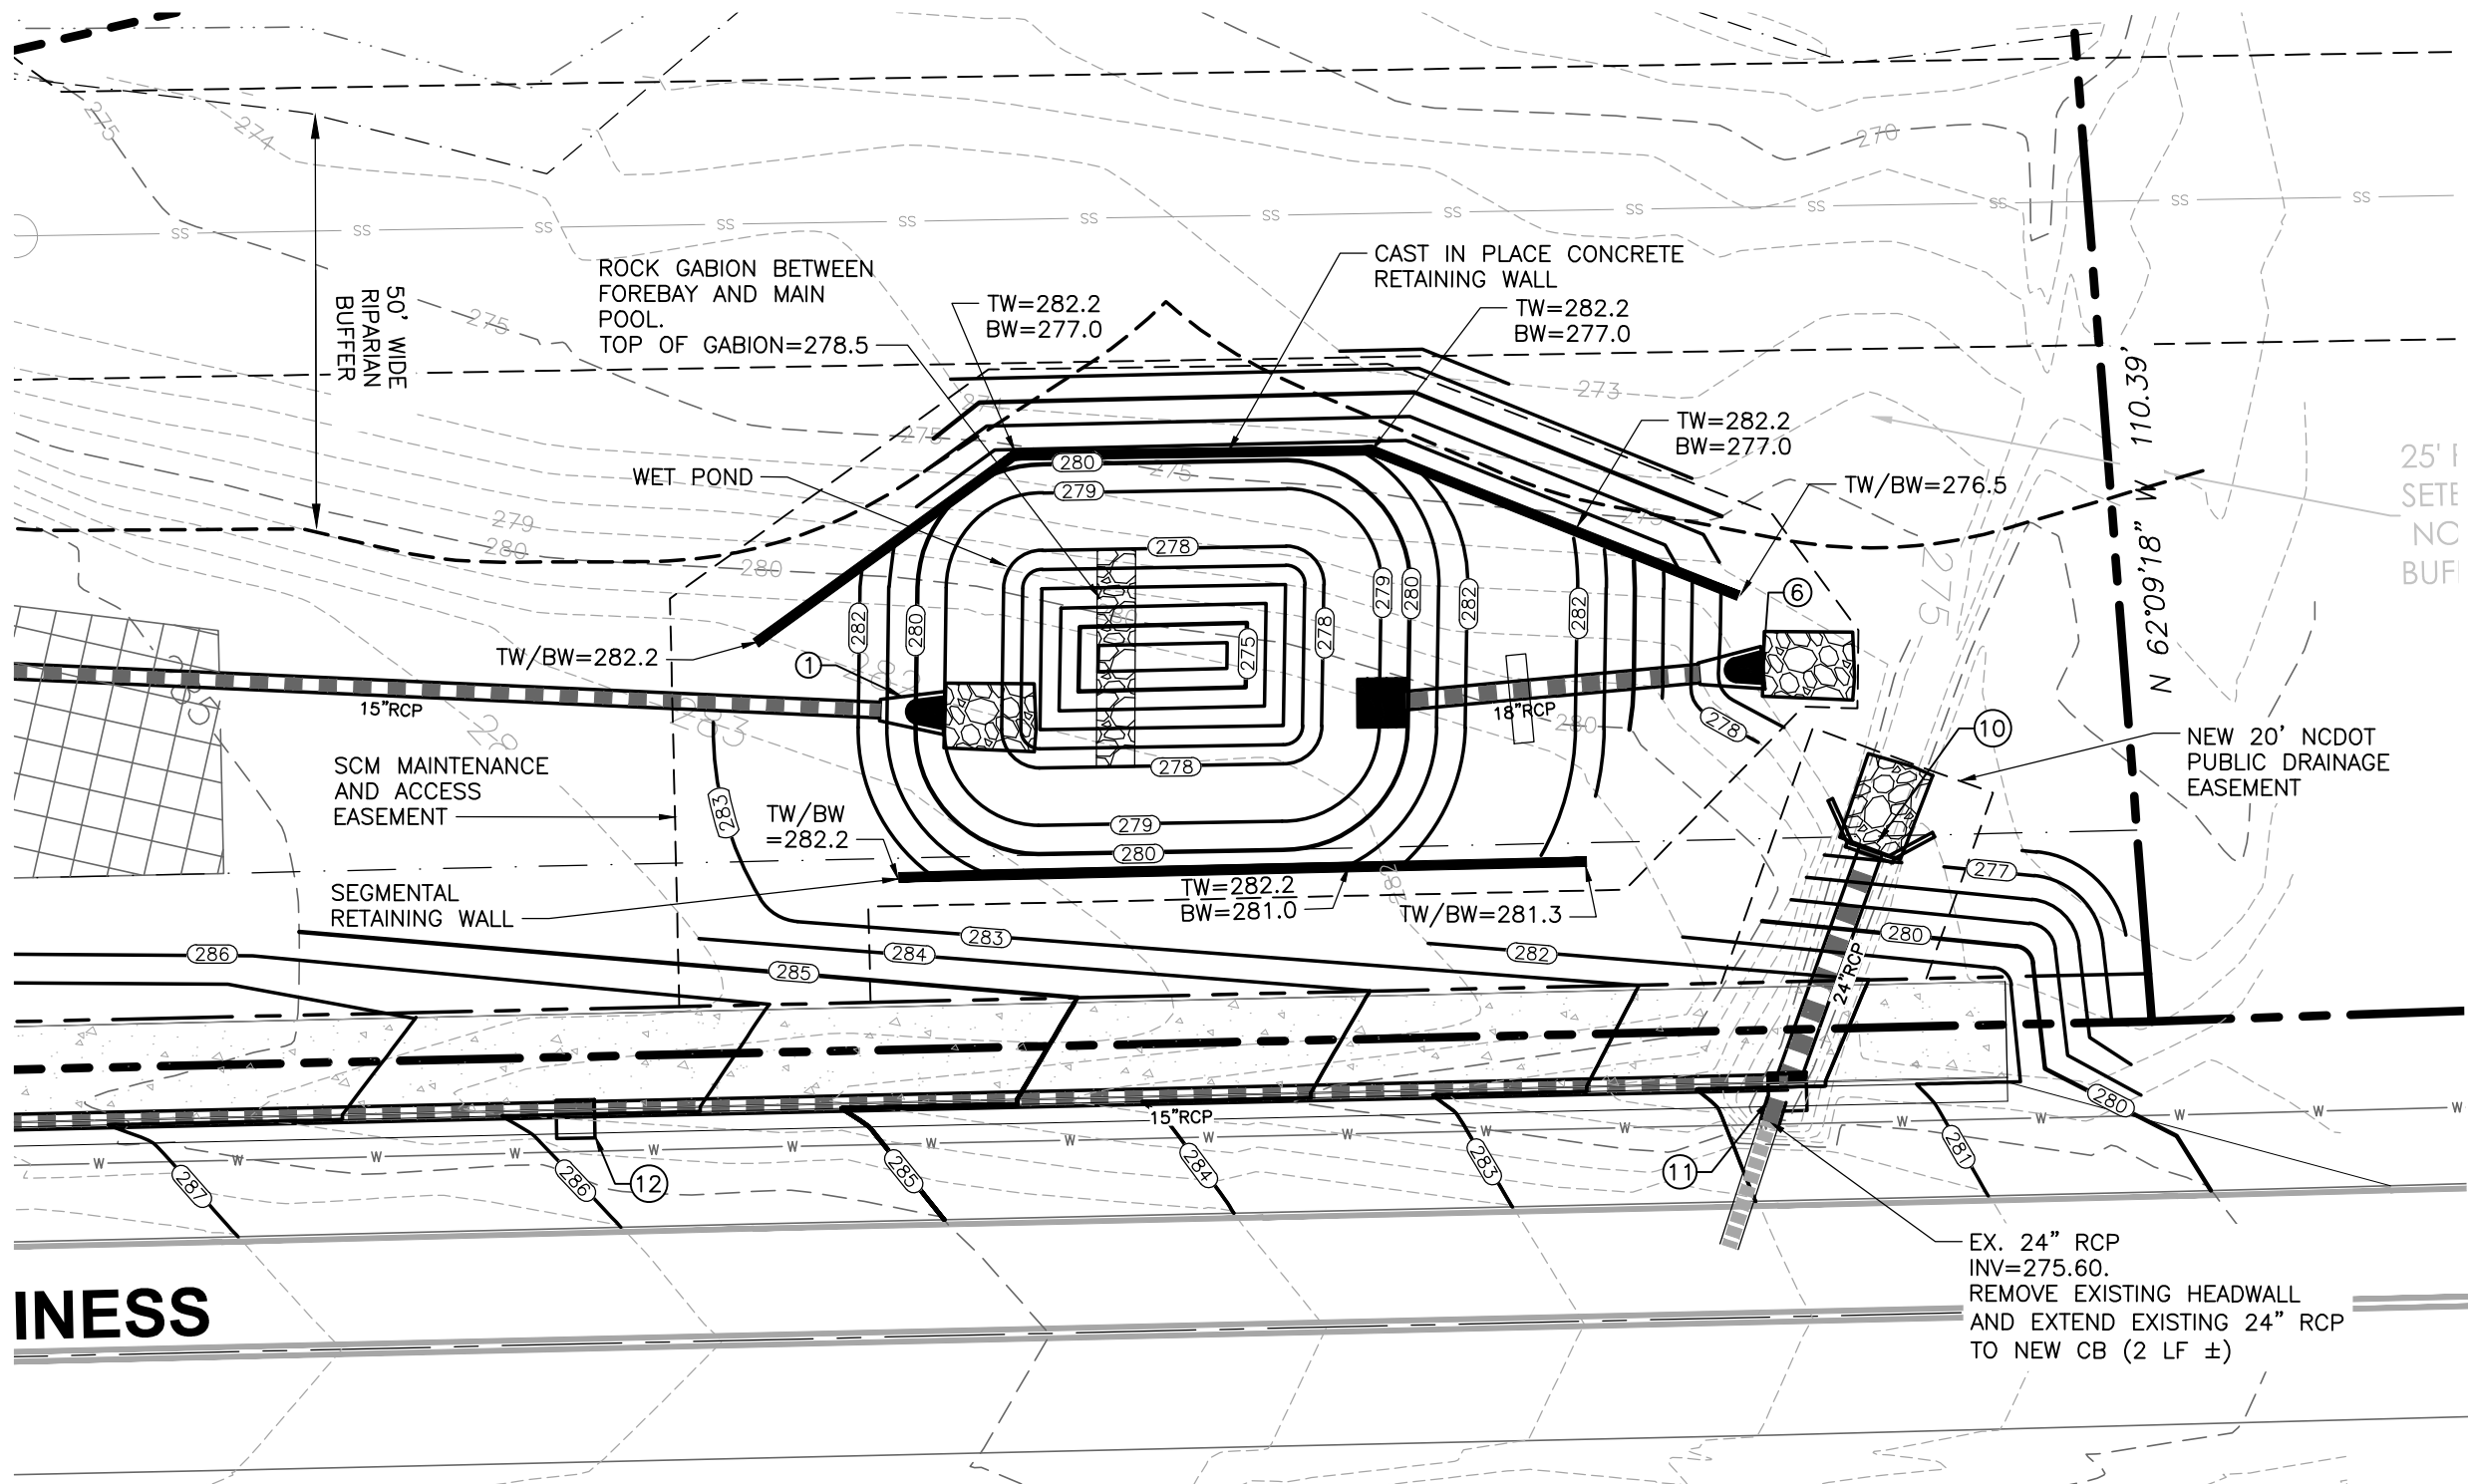


INESS

NOTES:


1. PRECAST BOX AND PIPE SHALL BE WATER TIGHT.
2. SUBGRADE SHALL BE COMPACTED TO 95% MAX DENSITY AS DETERMINED BY ASTM D-698 AT ITS OPTIMUM MOISTURE CONTENT \pm 2%.
3. STRUCTURAL SHOP DRAWINGS TO BE PREPARED AND SEALED BY STRUCTURAL ENGINEER AND SUBMITTED FOR APPROVAL.

NEW 6" PVC DRAWDOWN PIPE
INV. ELEV.=279.00
USE SCH 40 PVC PIPE AND TEE AND INSTALL TO EXTEND DRAWDOWN TO 6" BELOW AND ABOVE PERMANENT POOL ELEVATION. INSTALL SOLID SCREW CAP ON TOP AND SCREW CAP WITH 0.8" DRILLED HOLE ON BOTTOM.
* ATTACH TEMPORARY SKIMMER AT THIS LOCATION WHILE BASIN IS BEING USED AS A SEDIMENT BASIN

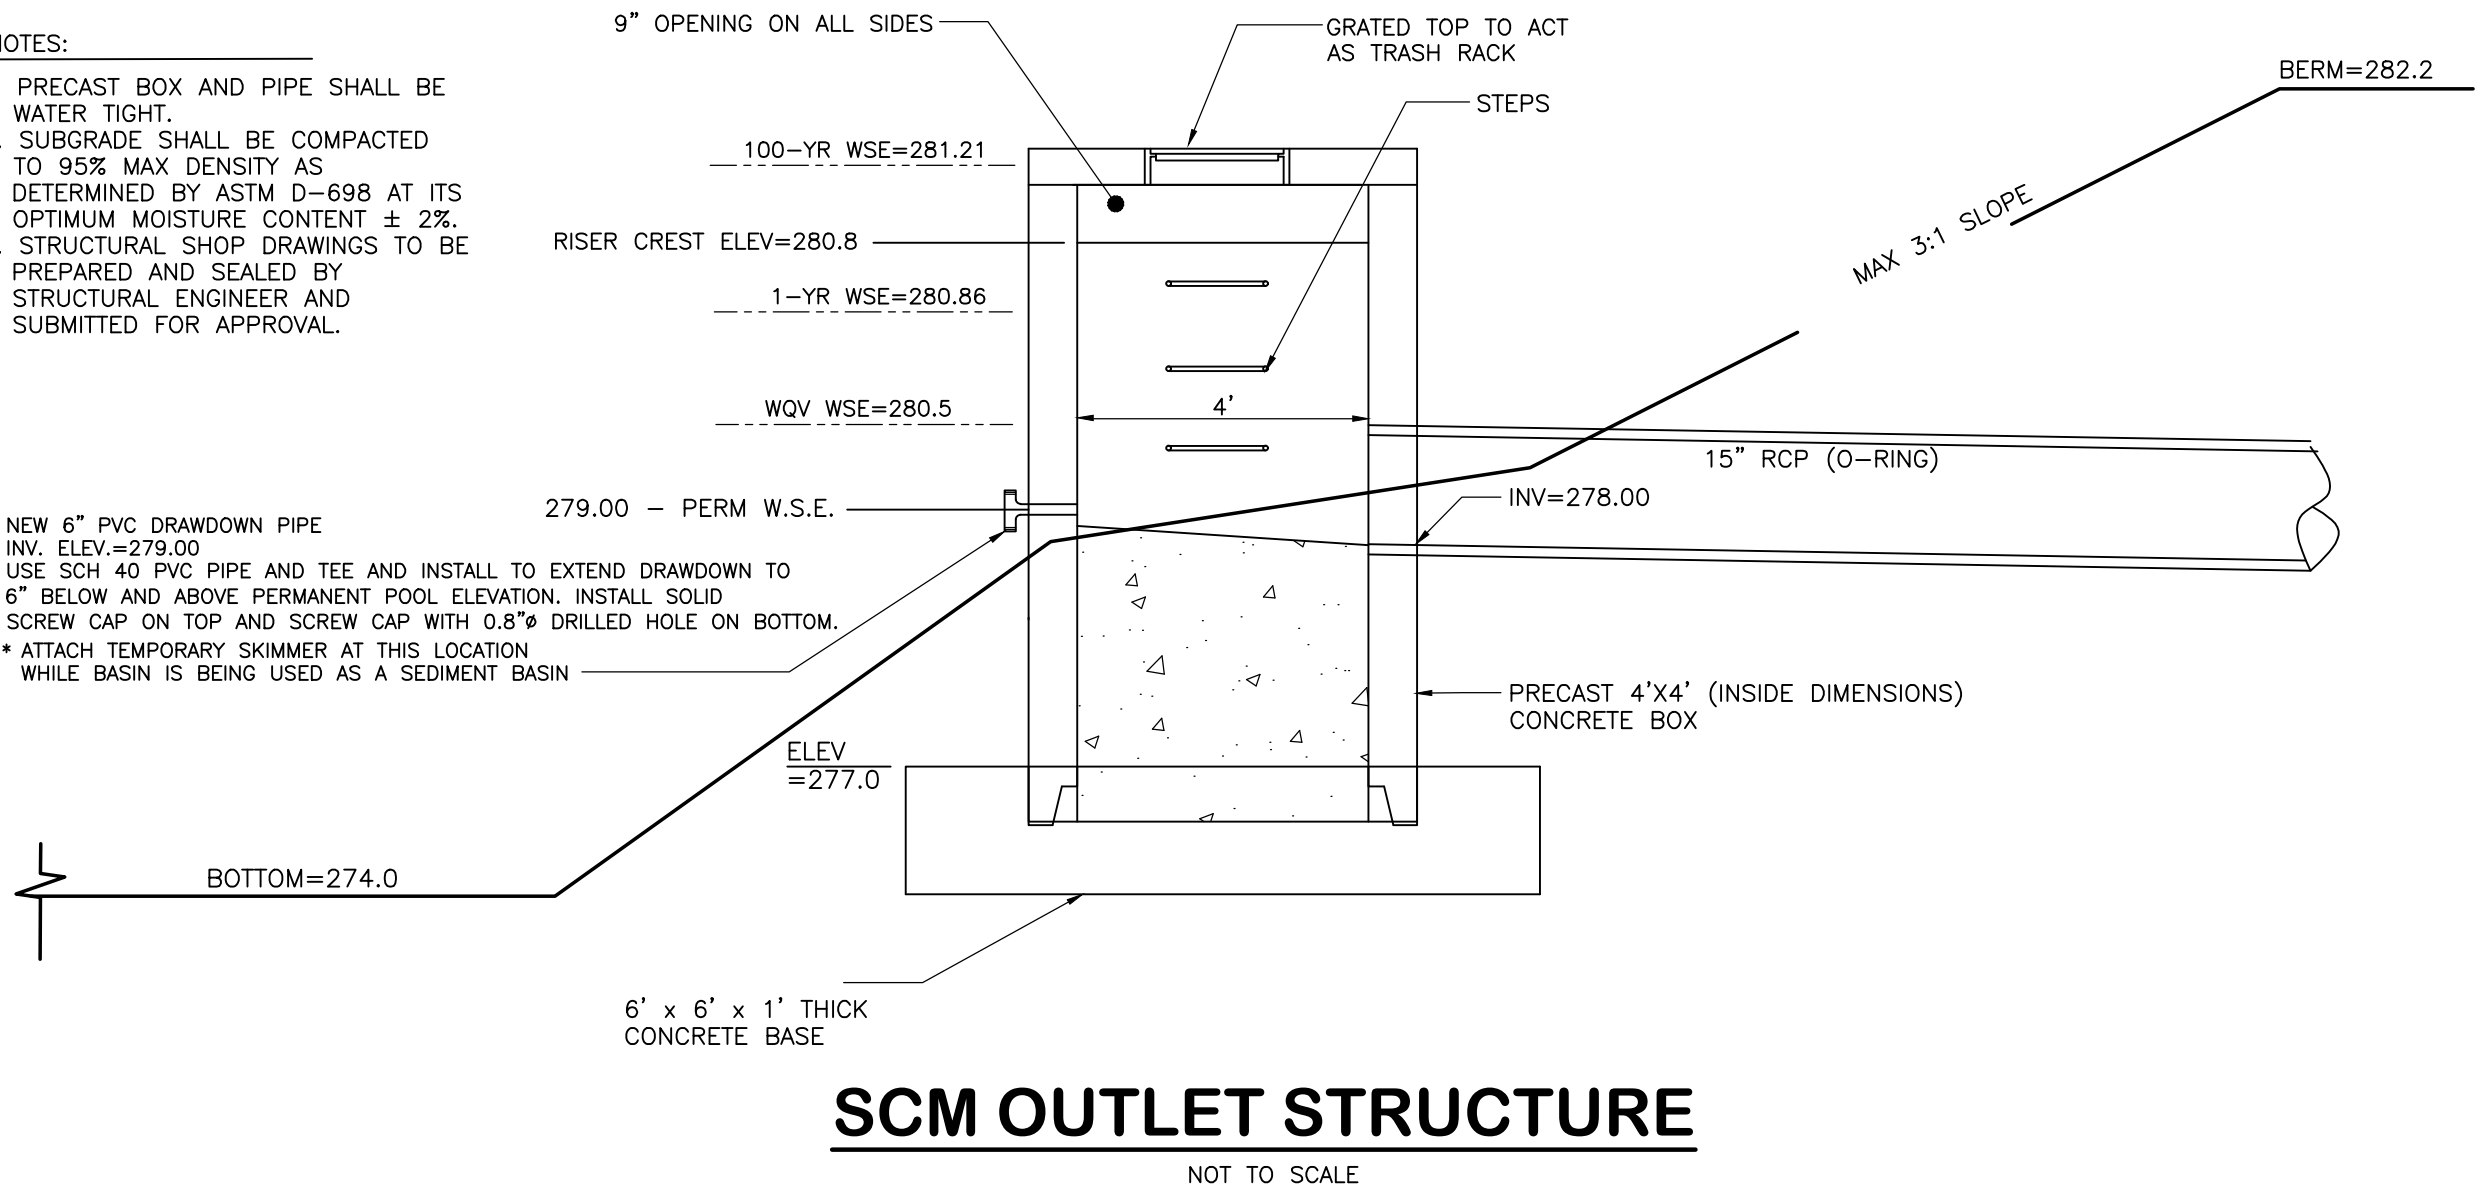


SCM OUTLET STRUCTURE

NOT TO SCALE

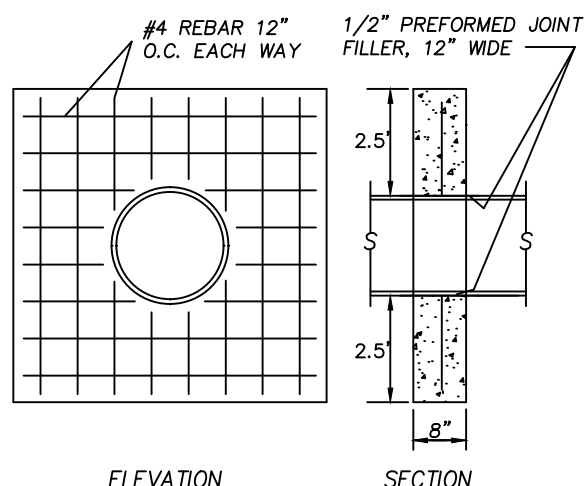


TYPICAL ANTI-SEEP COLLAR

REQUIRED PLANTS BASED ON 746 S.F. = 50 PLANTS / 200 S.F. (746 S.F.) = 187 PLANTS					
PLANT TYPE	QTY	BOTANICAL NAME	COMMON NAME	ROOT	SPACING
62	62	ASCLEPIAS INCARNATA	SWAMP MILKWEED	2" PLUG	2' O.C.
62	62	CAREX TENERA	QUILL SEDGE	2" PLUG	2' O.C.
63	63	CHELONE GLABRA	WHITE TURTLEHEAD	2" PLUG	2' O.C.

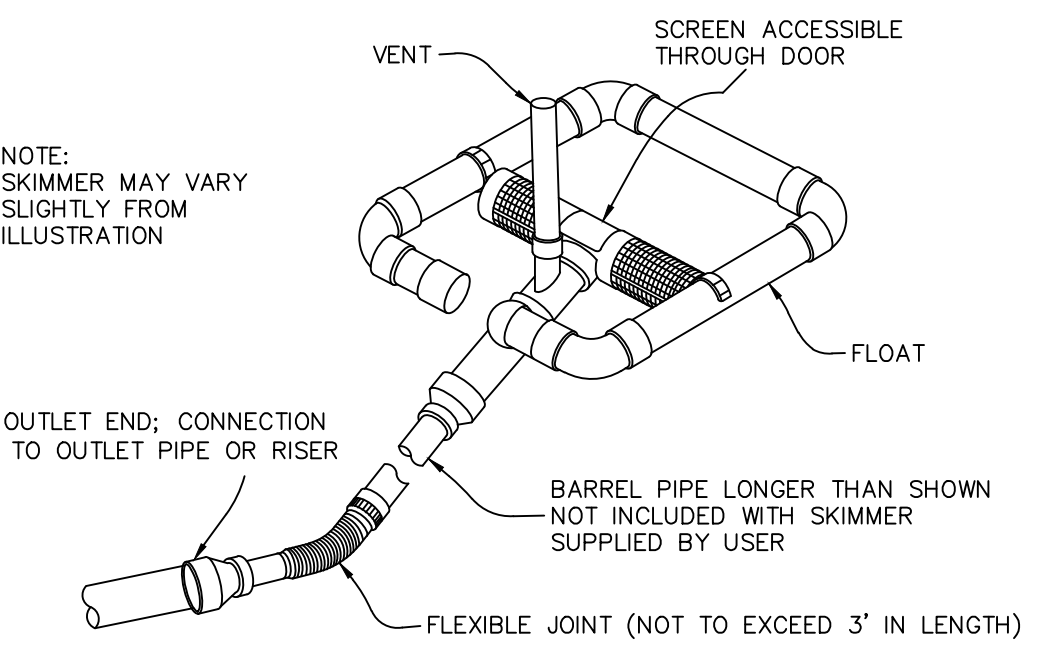



TEMPORARY SEDIMENT DEVICE DEWATERING SKIMMER DETAIL

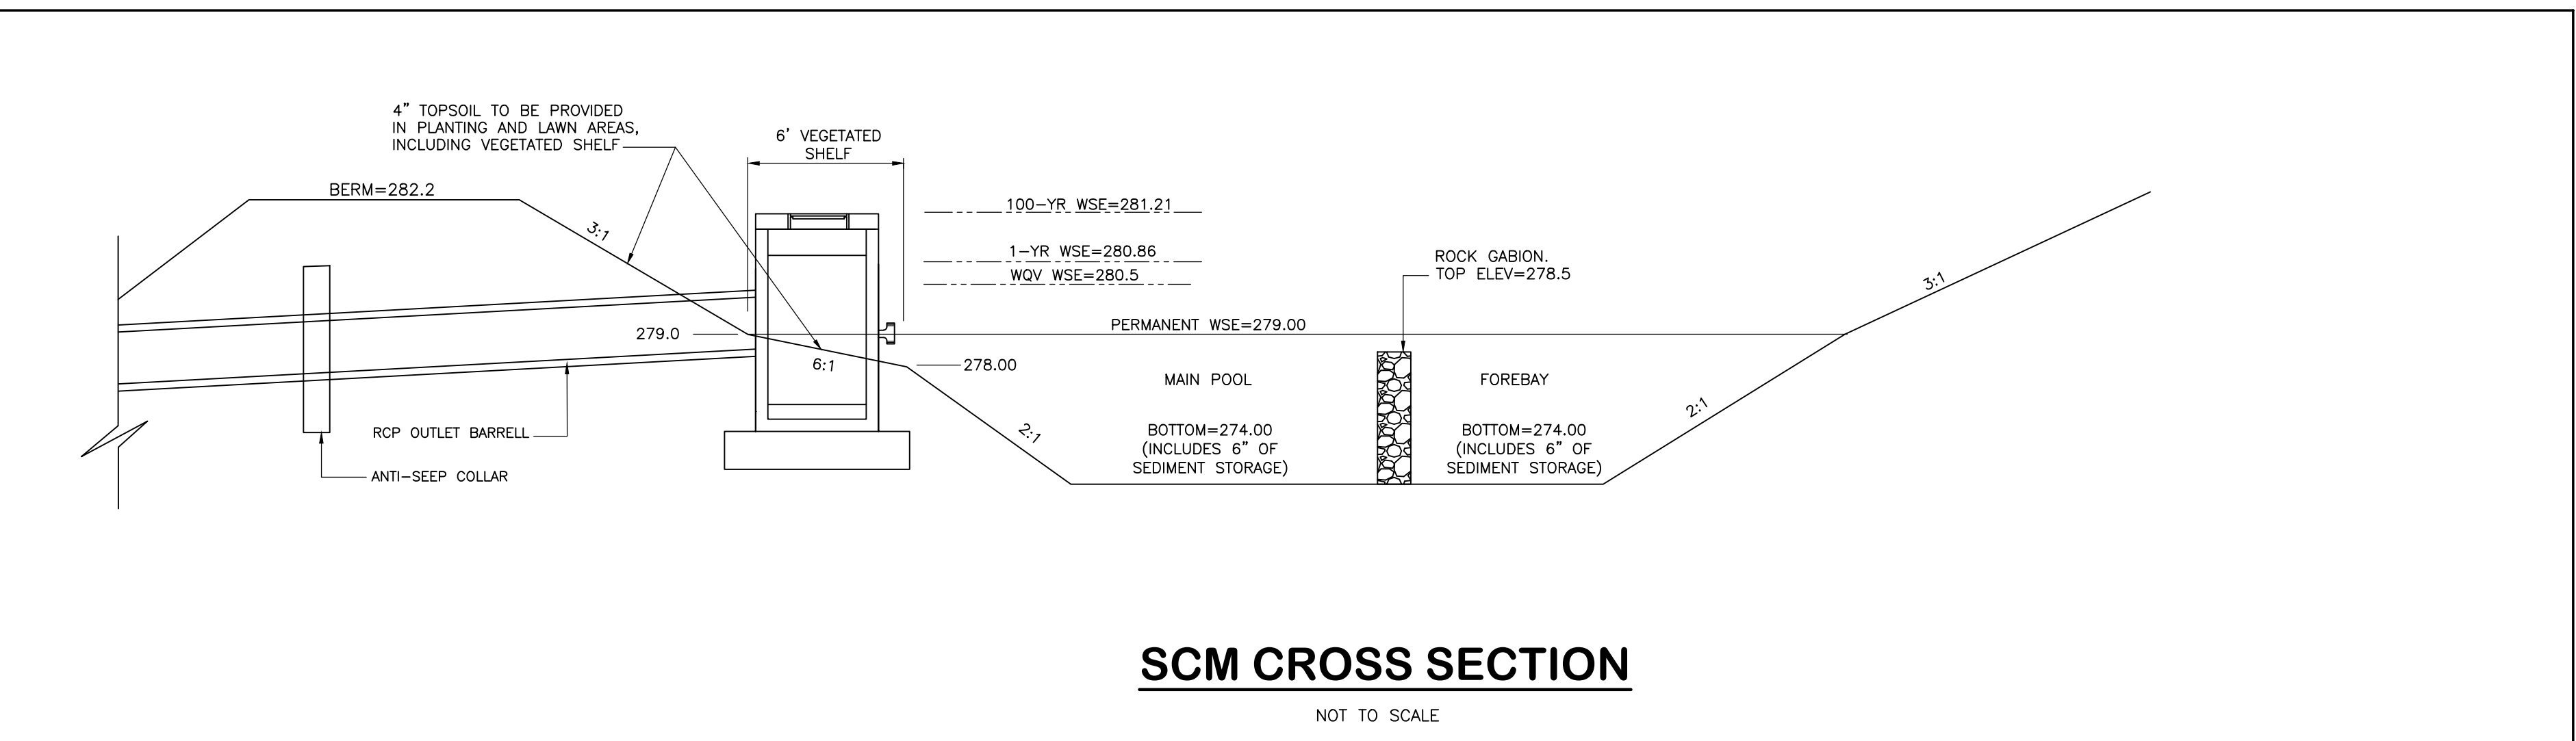


SCM CROSS SECTION

NOT TO SCALE

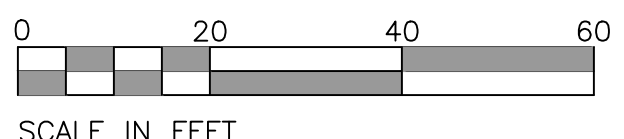


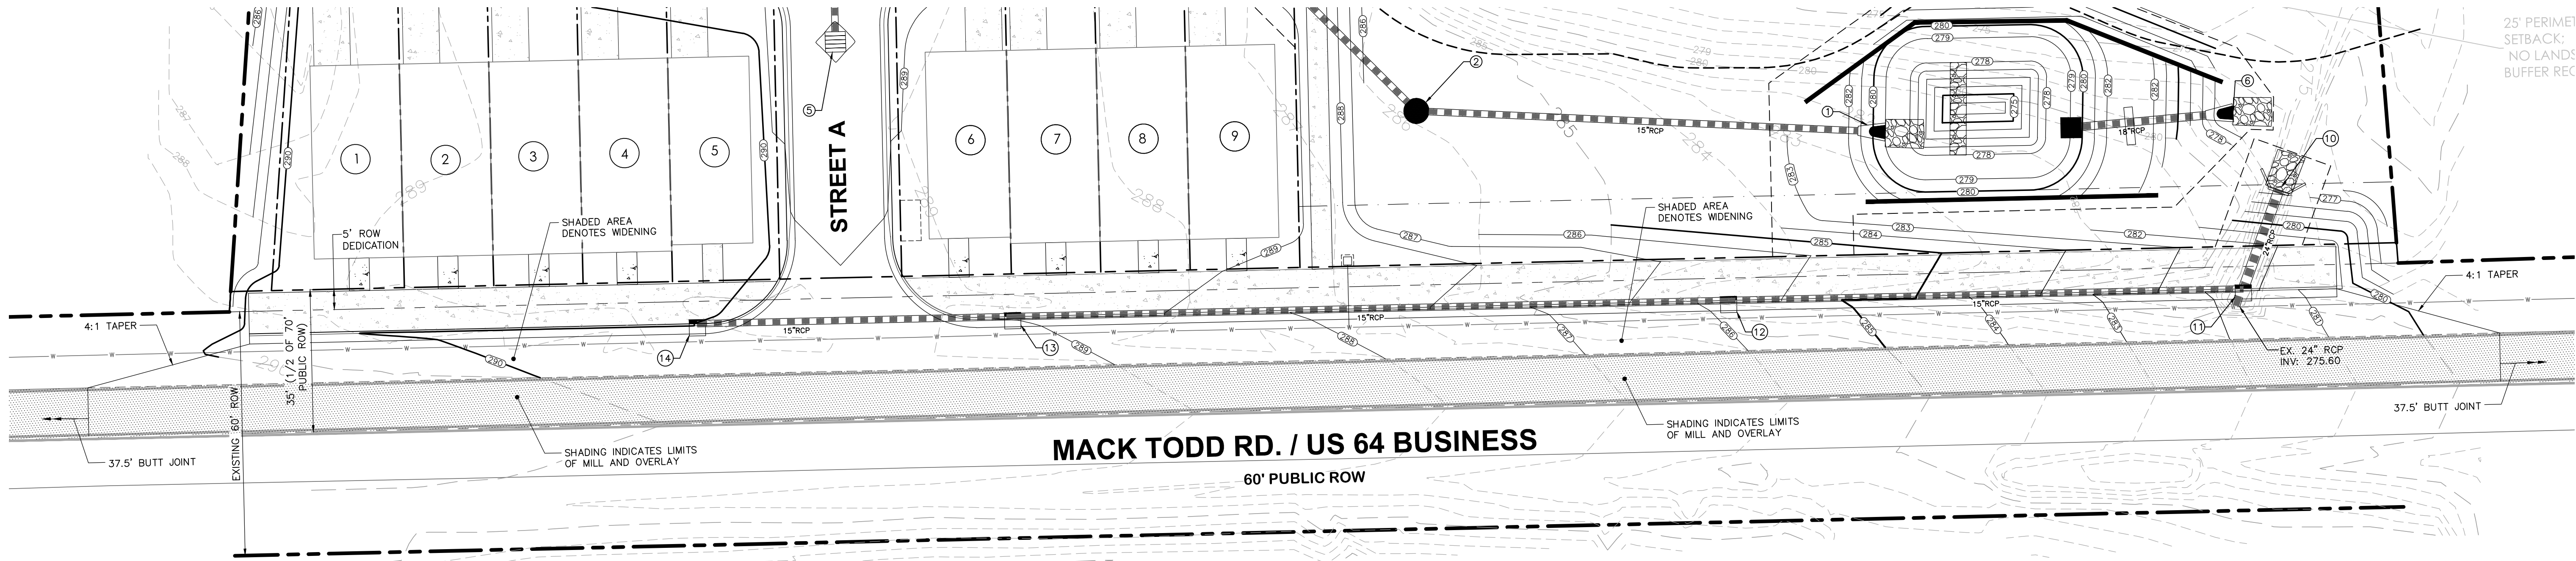

WIDENING PLAN

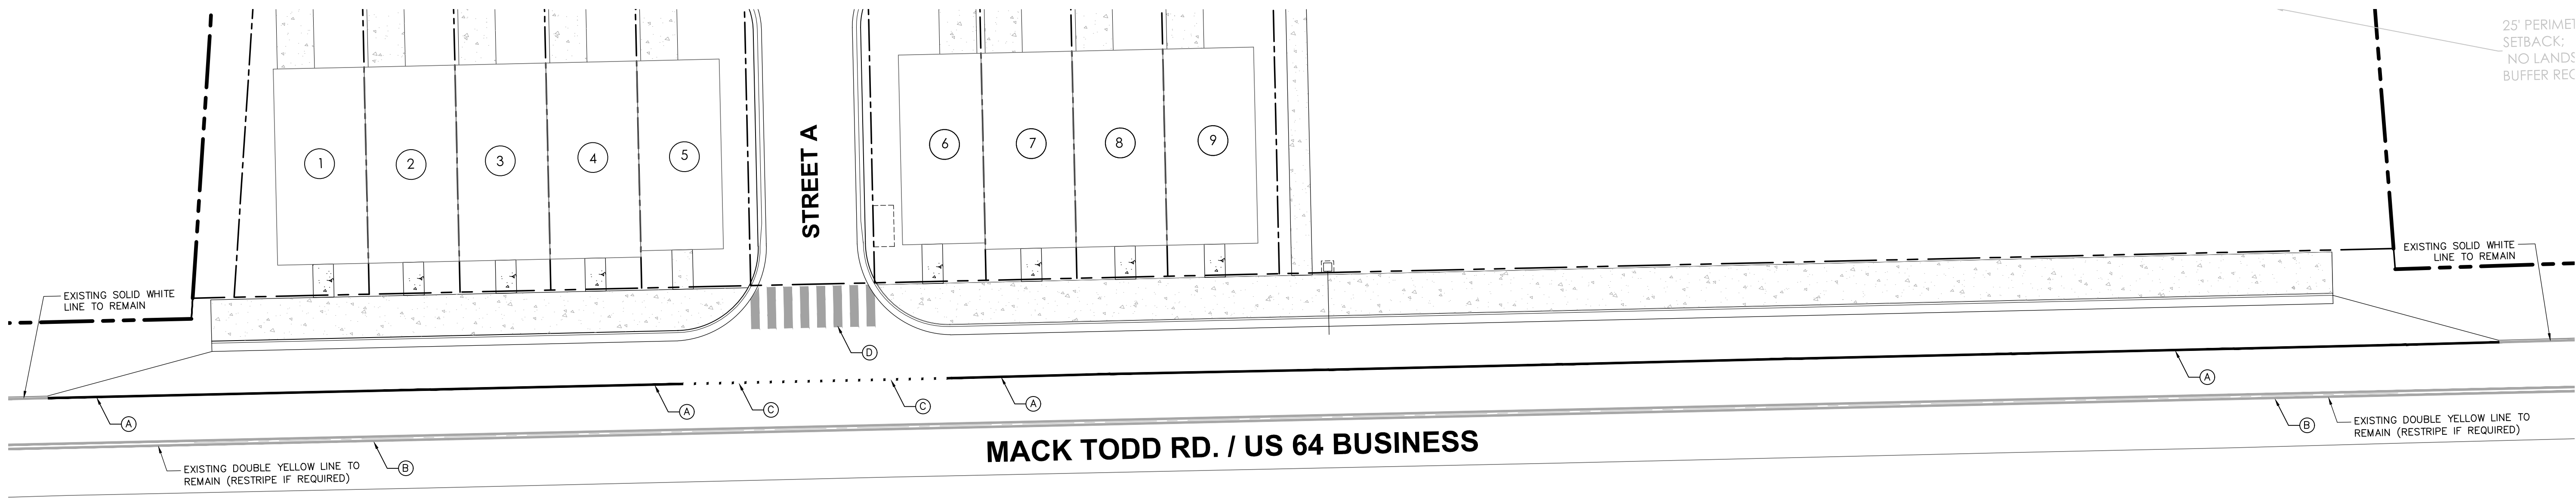

STRIPING PLAN

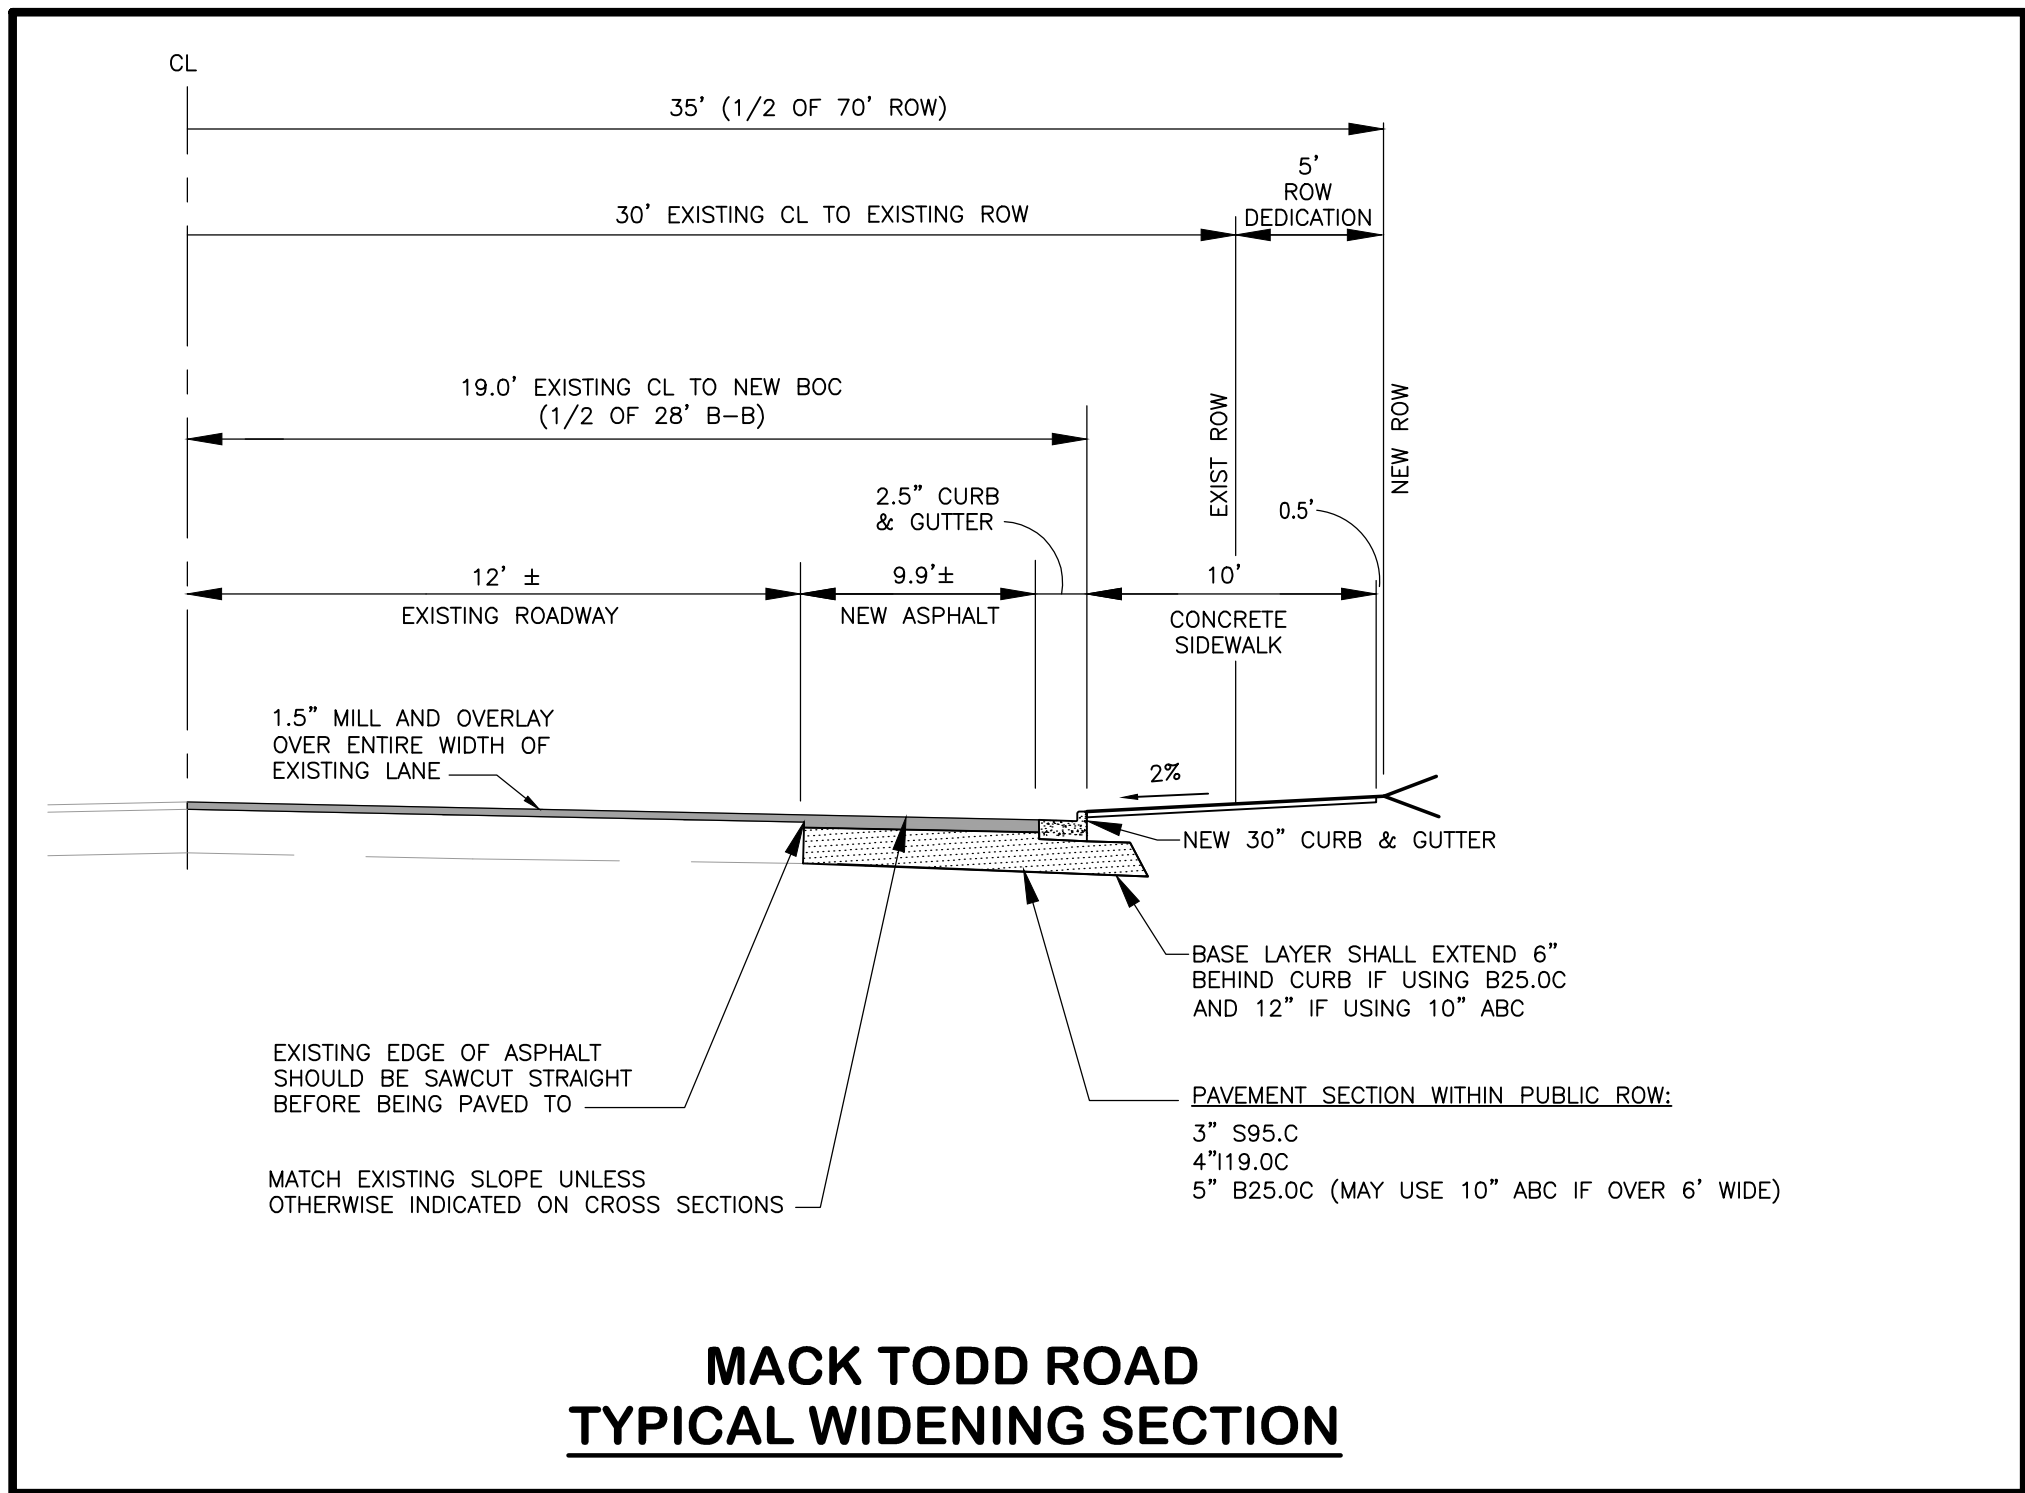

STRIPING NOTES











- ALL PAVEMENT MARKINGS SHALL BE THERMOPLASTIC
- ALL PAVEMENT MARKINGS SHALL BE CONSTRUCTED IN ACCORDANCE WITH NCDOT STANDARDS & SPECIFICATIONS
- PREMARKINGS SHALL BE APPROVED BY ENGINEER & NCDOT DIVISION TRAFFIC ENGINEER PRIOR TO COMPLETION
- EXISTING STRIPING TO BE MODIFIED AS REQUIRED BY GRINDING.

STRIPING LEGEND

- (A) 4" WIDE WHITE EDGE LINE
(B) 4" SOLID DOUBLE YELLOW LINES
(C) 4" WHITE MINI-SKIP LINE (2'-6"/SP)
(D) 10'x24" WHITE NCDOT HIGH VISIBILITY CROSSWALK (1205.7)



F:\Projects\CPMTRZ\Drawings\Site\CPMTRZ_Base.dwg -- 11 CROSS SECTIONS Feb 04, '25 -- 1:02pm

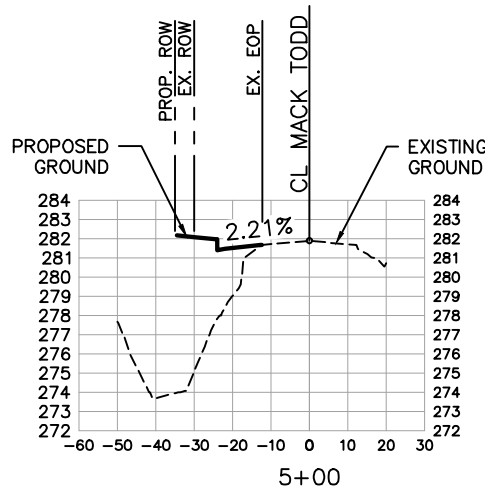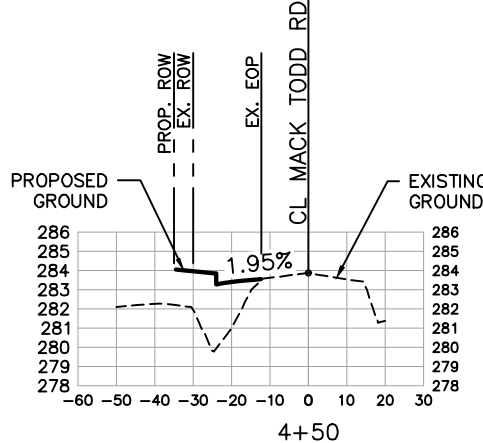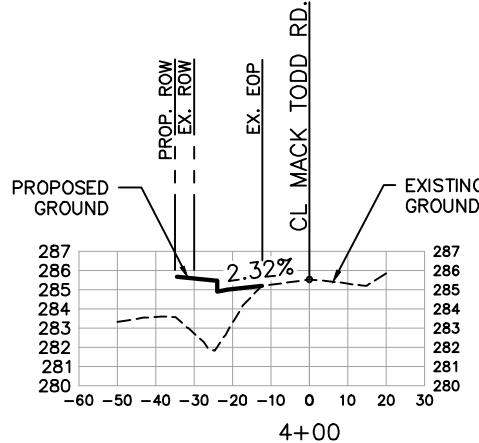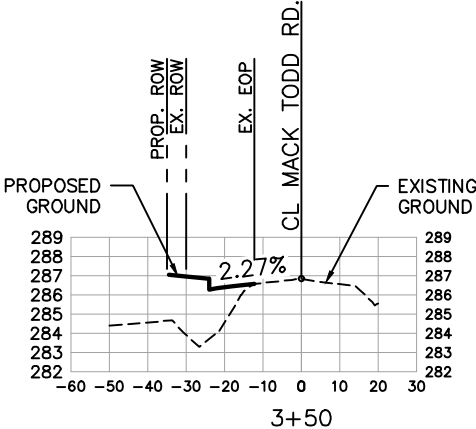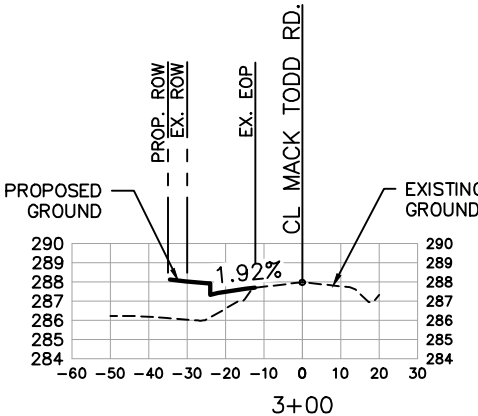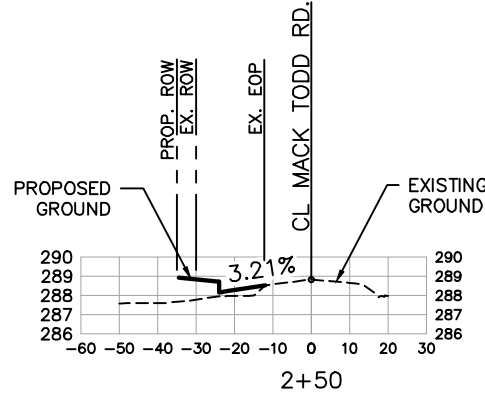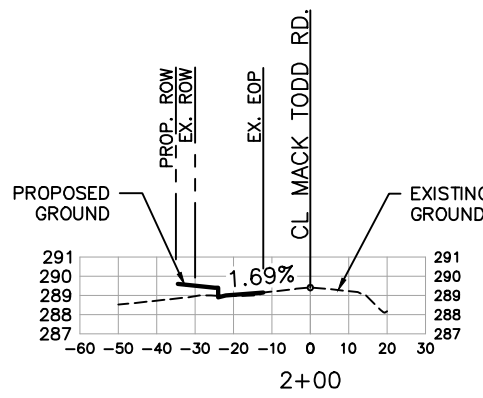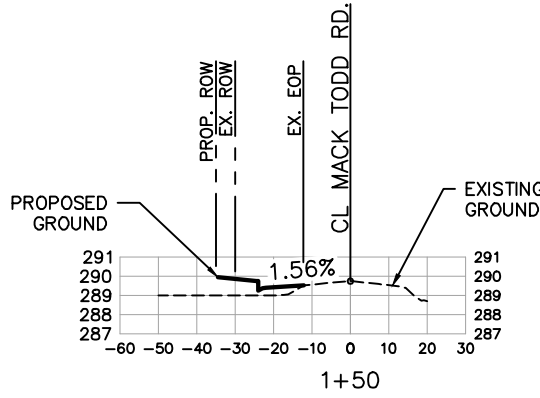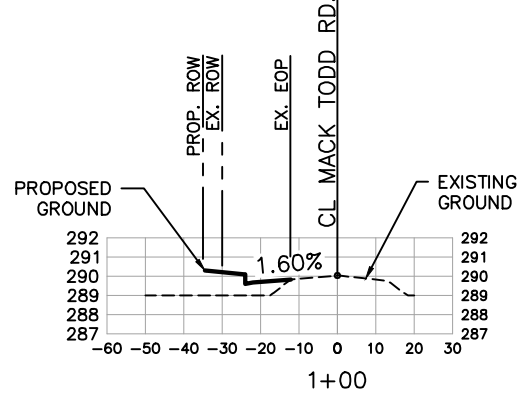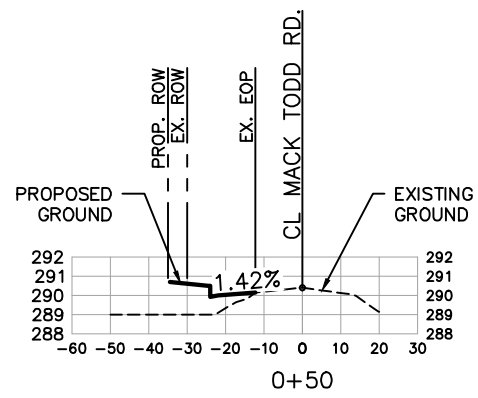

ATTENTION CONTRACTORS

The Contractor responsible for the extension of water, sewer, and/or reuse, as approved in these plans, is responsible for contacting the Public Utilities Inspector at 919-996-3245 or <https://cityworks.raleighnc.gov/pucontractors/New> and schedule a Pre-construction meeting prior to beginning any construction. Raleigh Water must be contacted at (919) 996-4540 at least twenty-four hours prior to beginning any work activity around critical water and sewer infrastructure.

Failure to notify the Divisions in advance of beginning construction, will result in the issuance of monetary fines, and require reinstallation of any water or sewer facilities not inspected as a result of this notification failure.

Failure to call for Inspection, install a downstream plug, have permitted plans on the jobsite, or any other violation of City of Raleigh Standards will result in a fine and possible exclusion from future work in the City of Raleigh.

**Public
Water Distribution / Extension System**


The City of Raleigh consents to the connection and extension of the City's public water system as shown on this plan. The material and Construction methods used for this project shall conform to the standards and specifications of the City's Public Utilities Handbook.

City of Raleigh
Public Utilities Department Permit # _____
Authorization to Construct See digital signature

**Public
Sewer Collection / Extension System**

The City of Raleigh consents to the connection and extension of the City's public sewer system as shown on this plan. The material and Construction methods used for this project shall conform to the standards and specifications of the City's Public Utilities Handbook.

City of Raleigh
Public Utilities Department Permit # _____
Authorization to Construct See digital signature

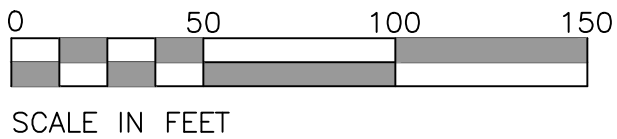

901 MACK TODD ROAD
901 MACK TODD ROAD
ZEBULON, NORTH CAROLINA

ISSUED: 04 FEB 2025

REVISIONS:

DRAWN BY: MLS















CHECKED BY: MLS

PROJECT: CPMTRZ

MACK TODD ROAD
CROSS SECTIONS

DWG. NO. **SITE 11**



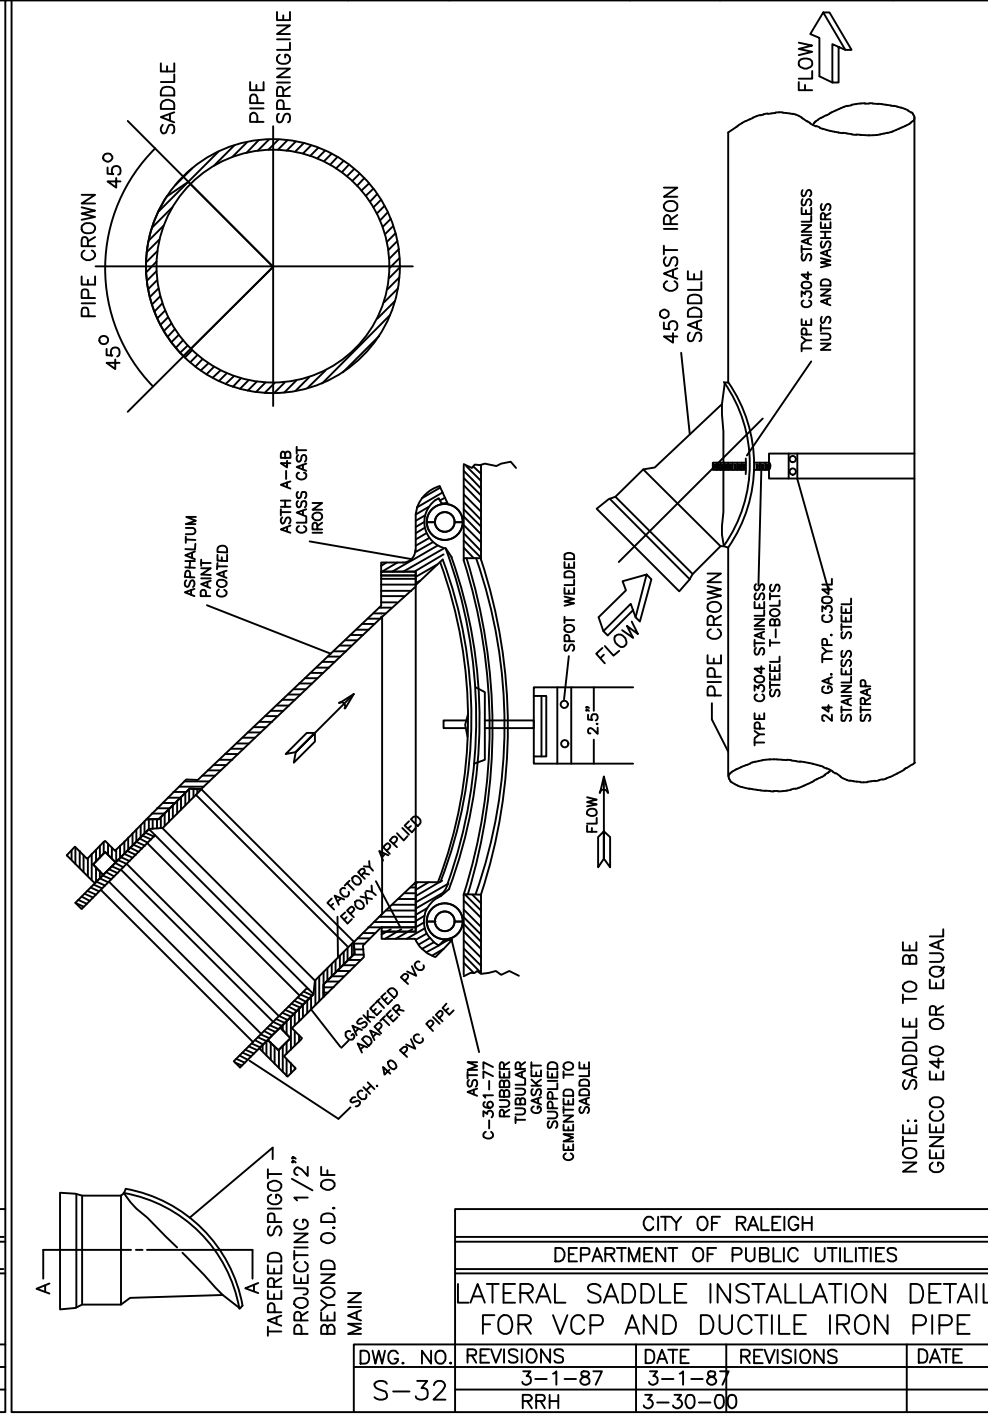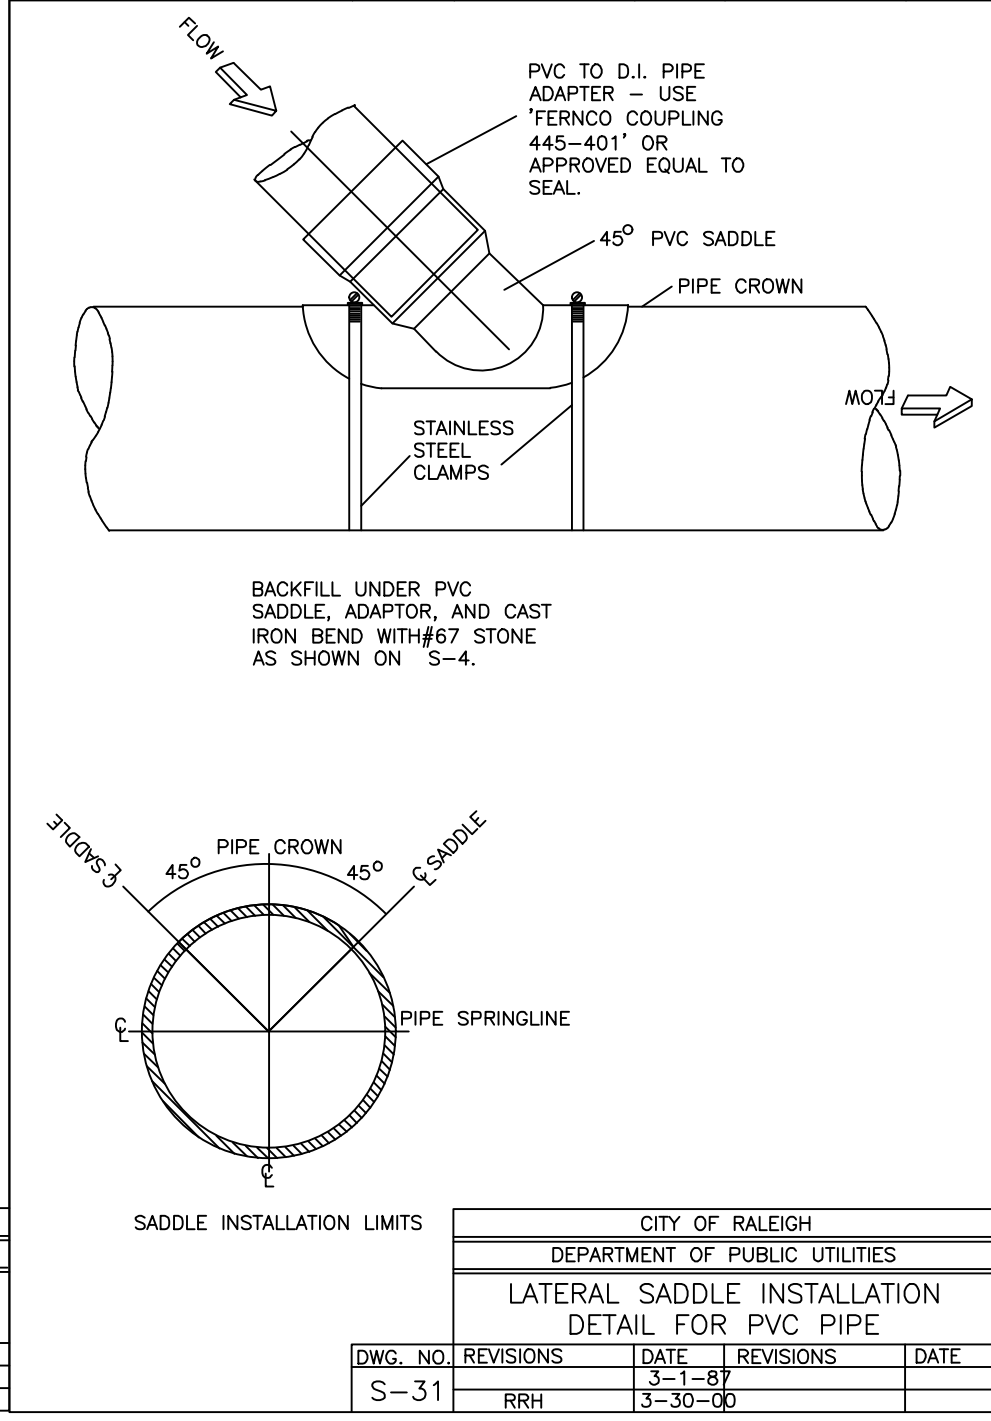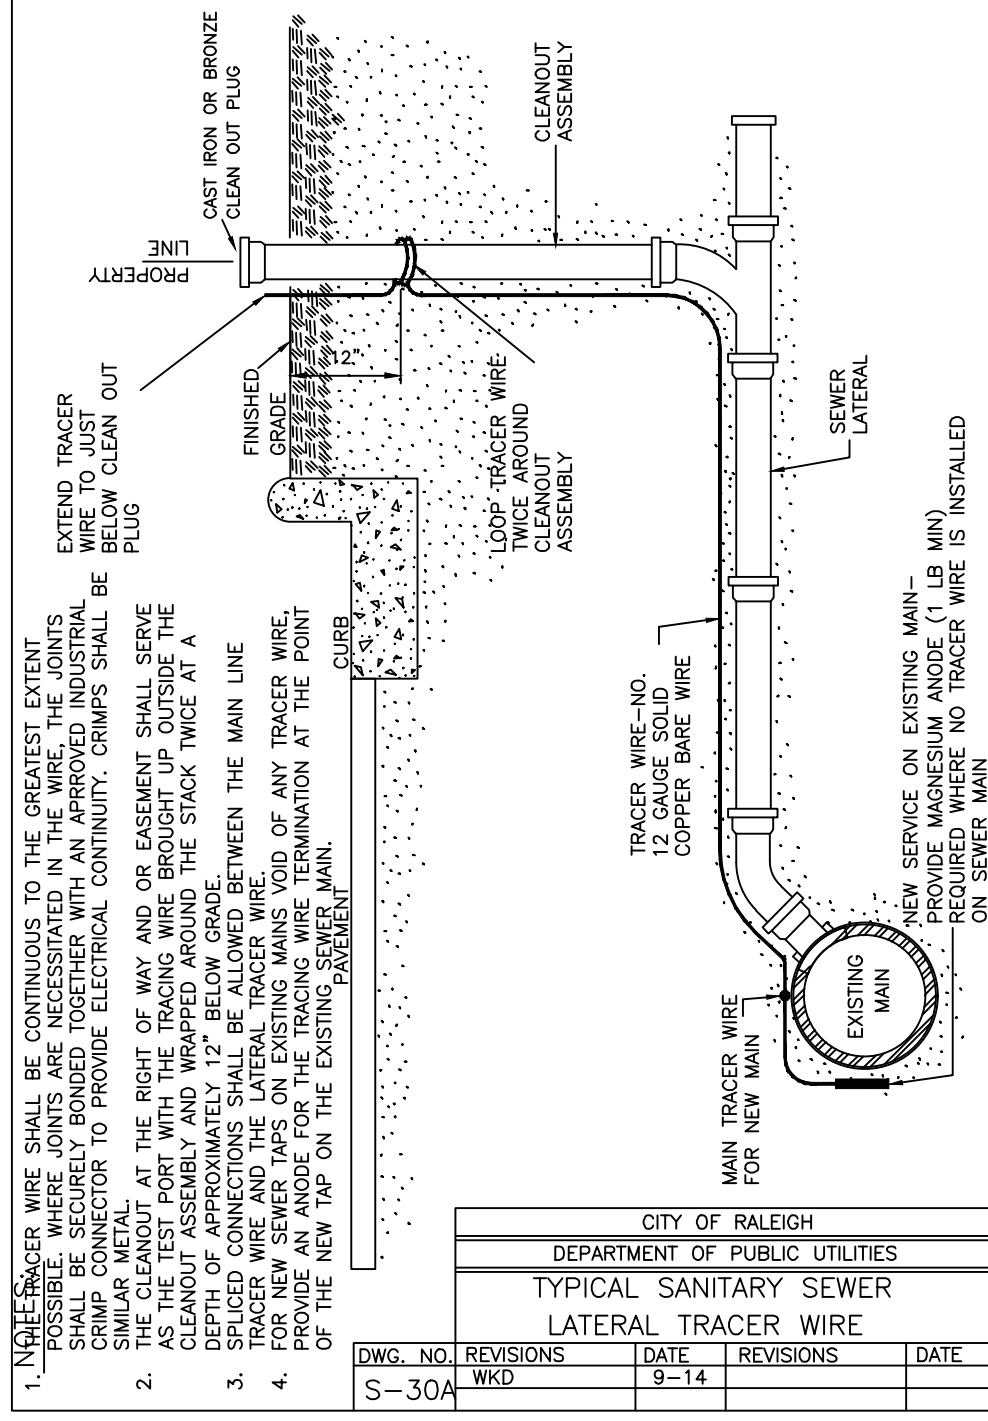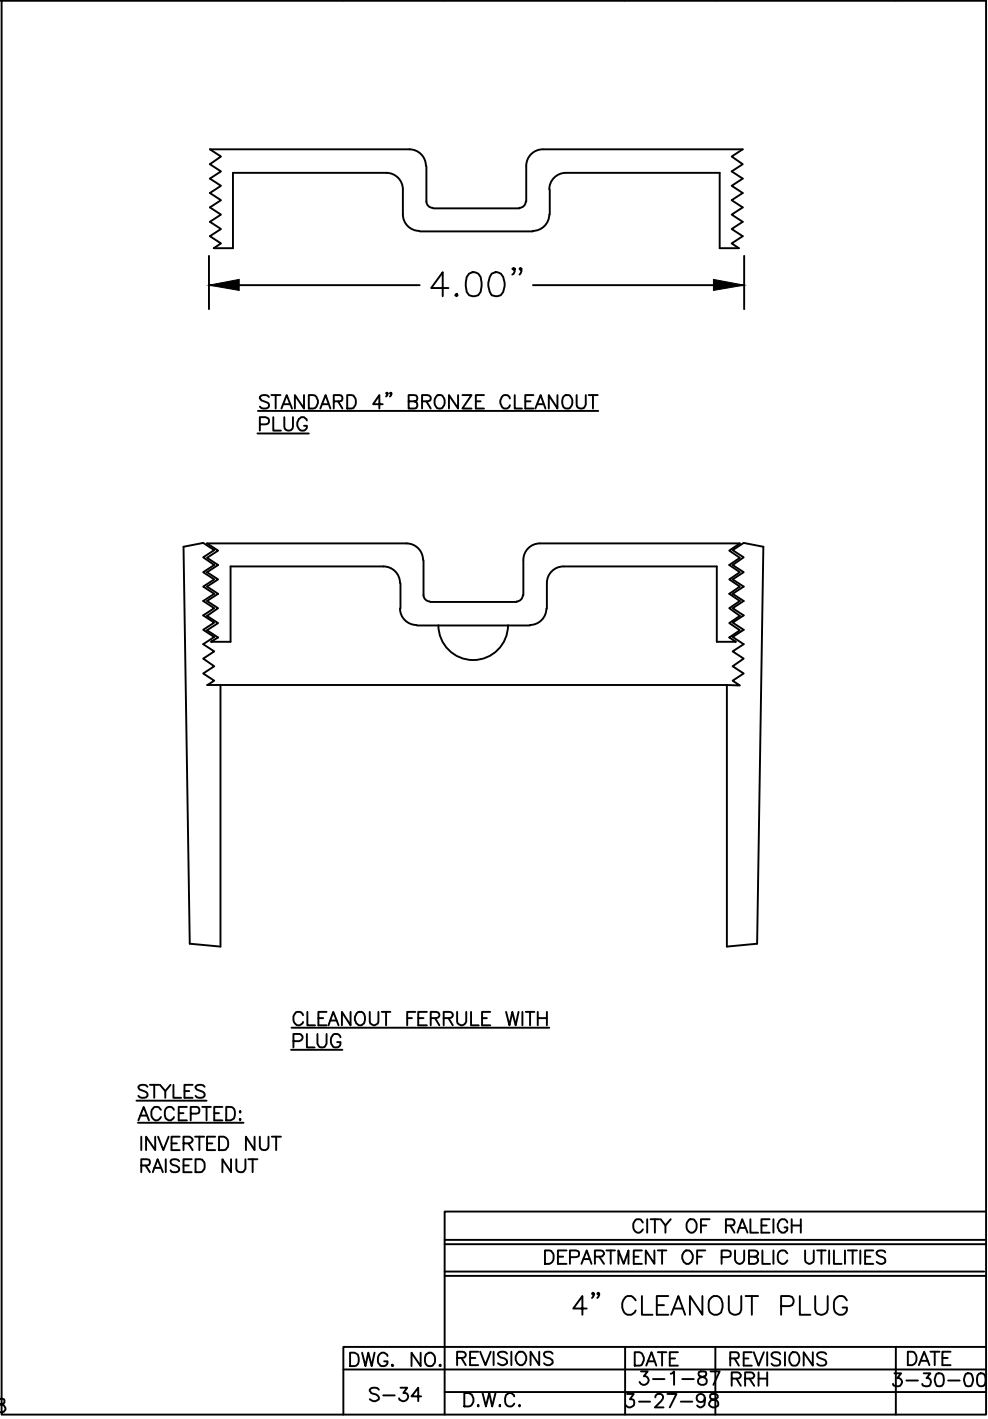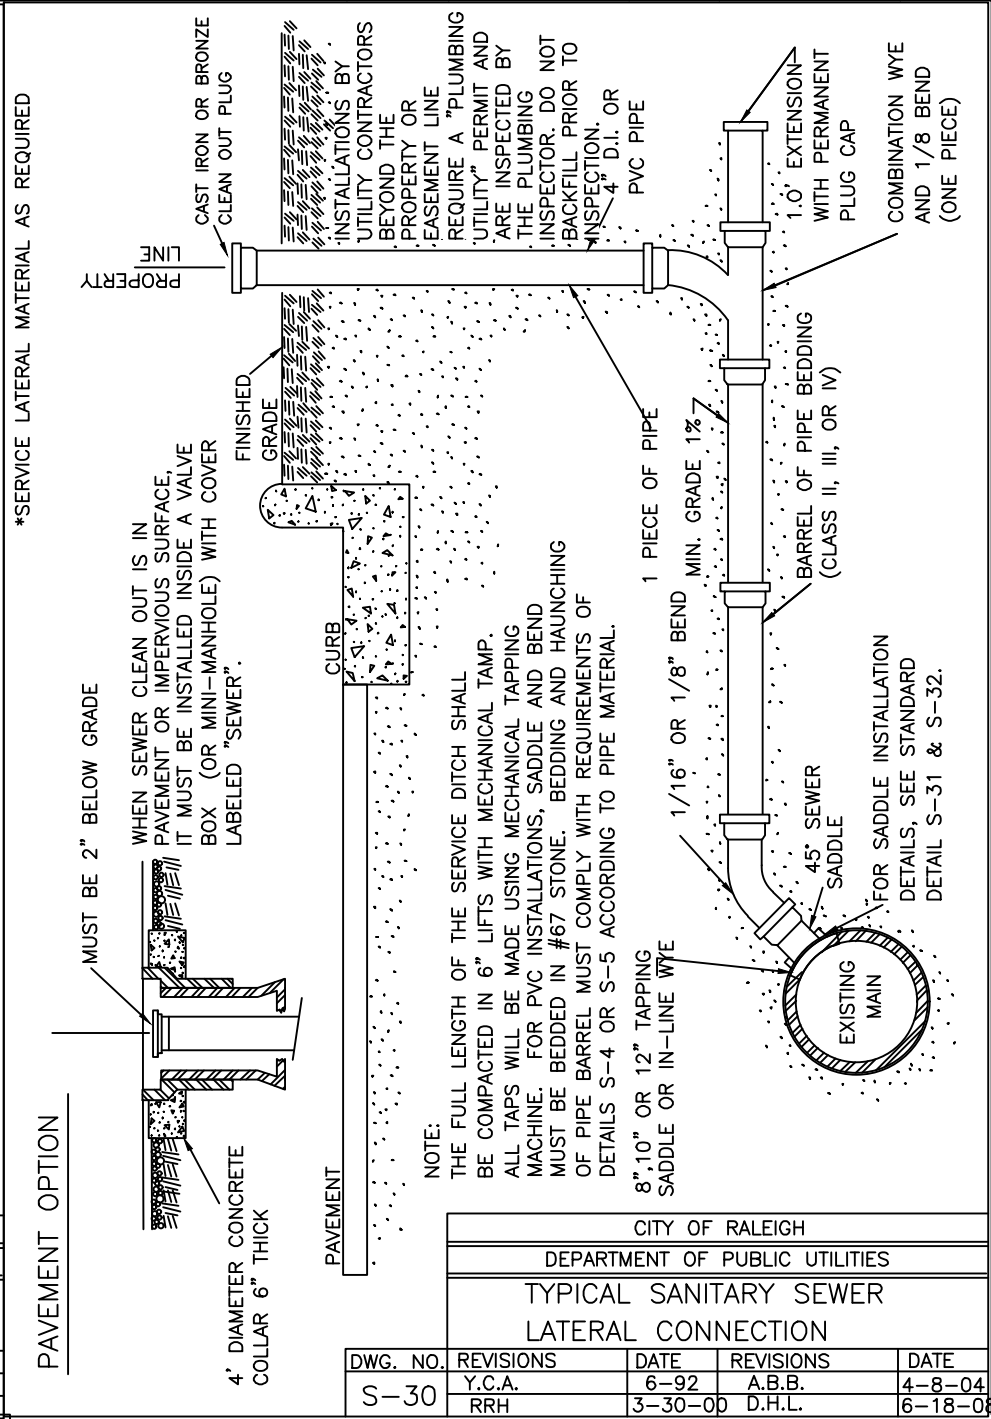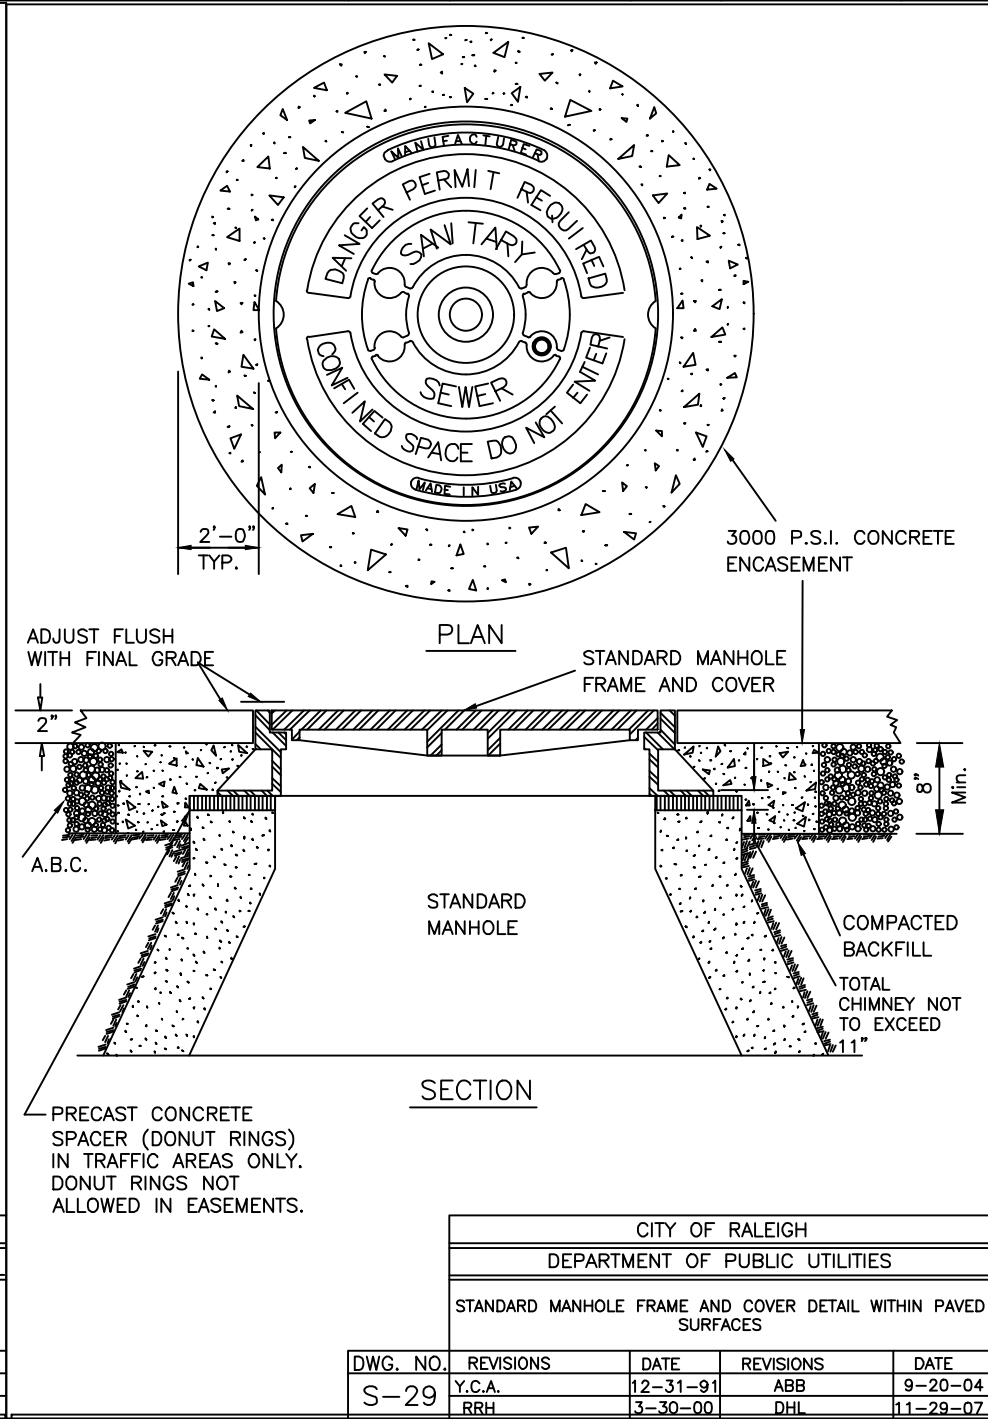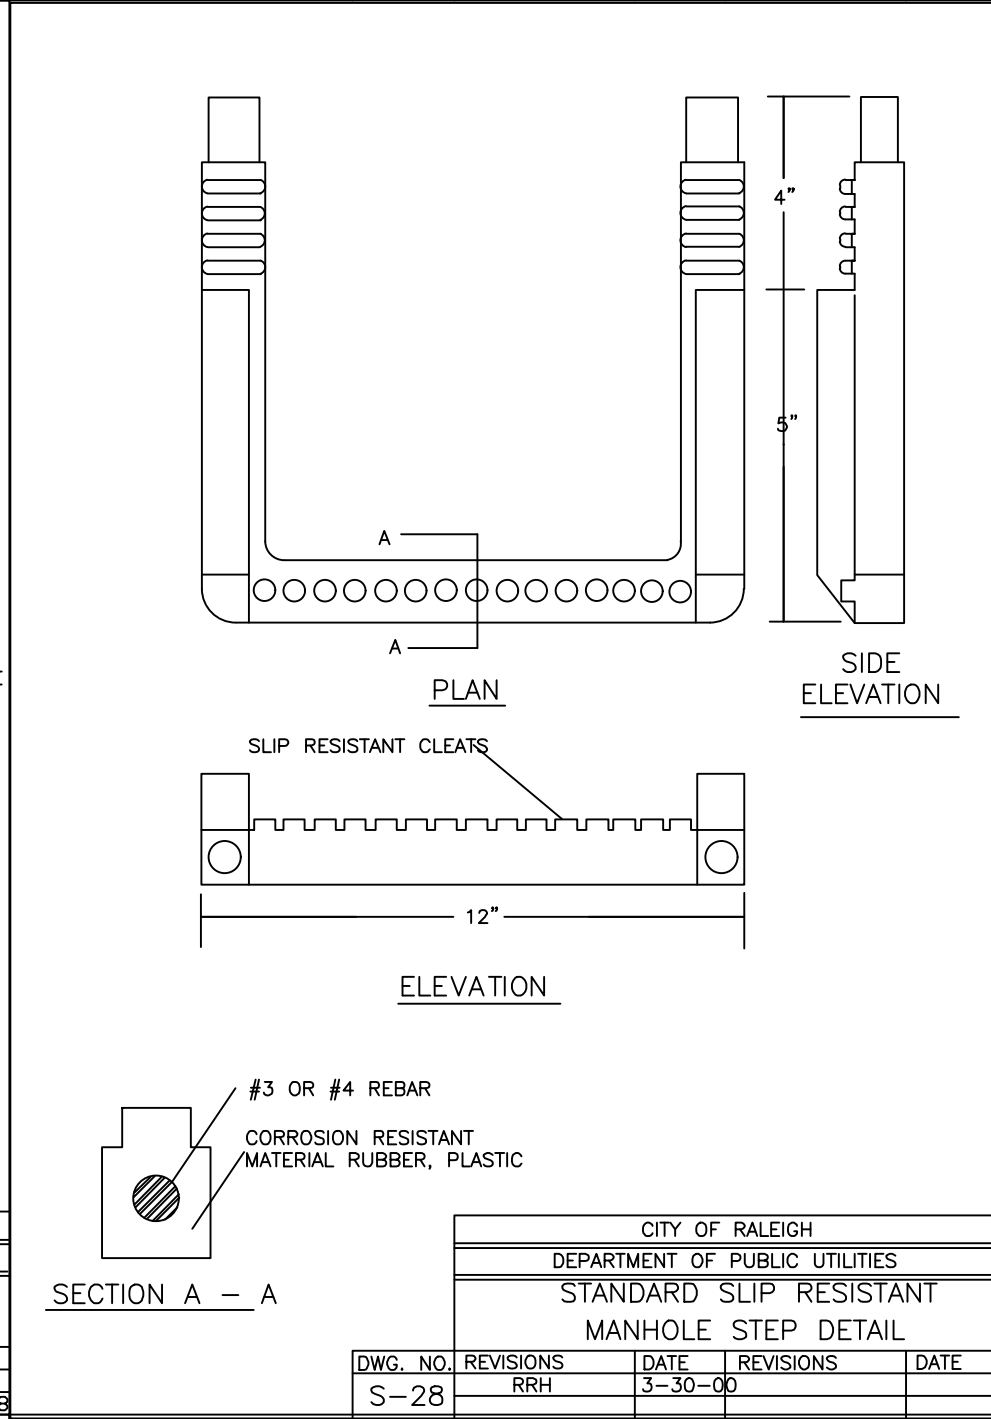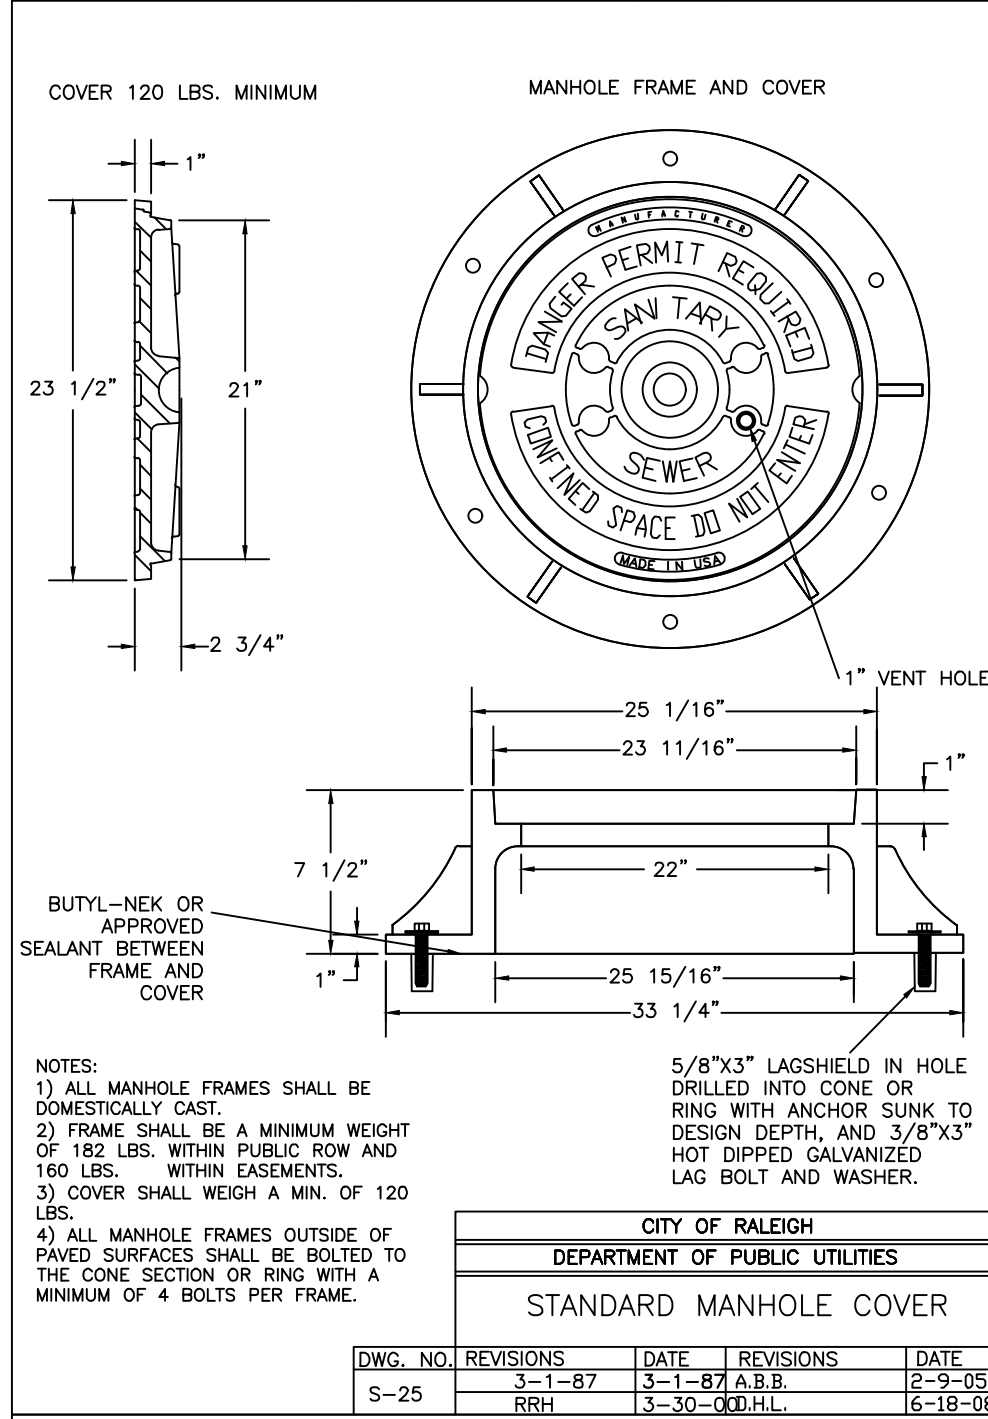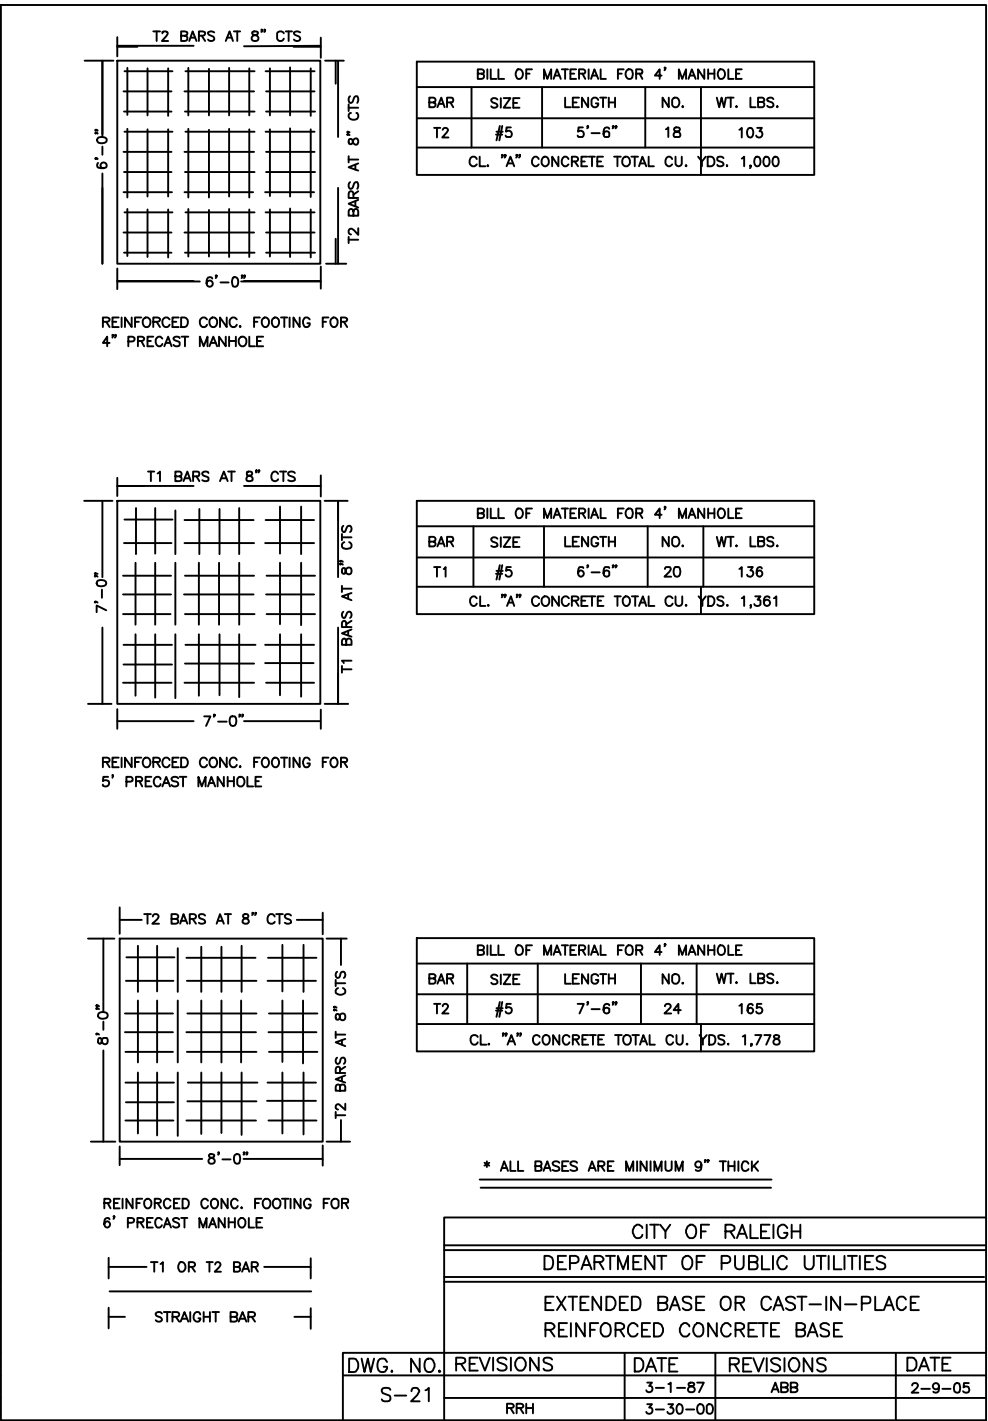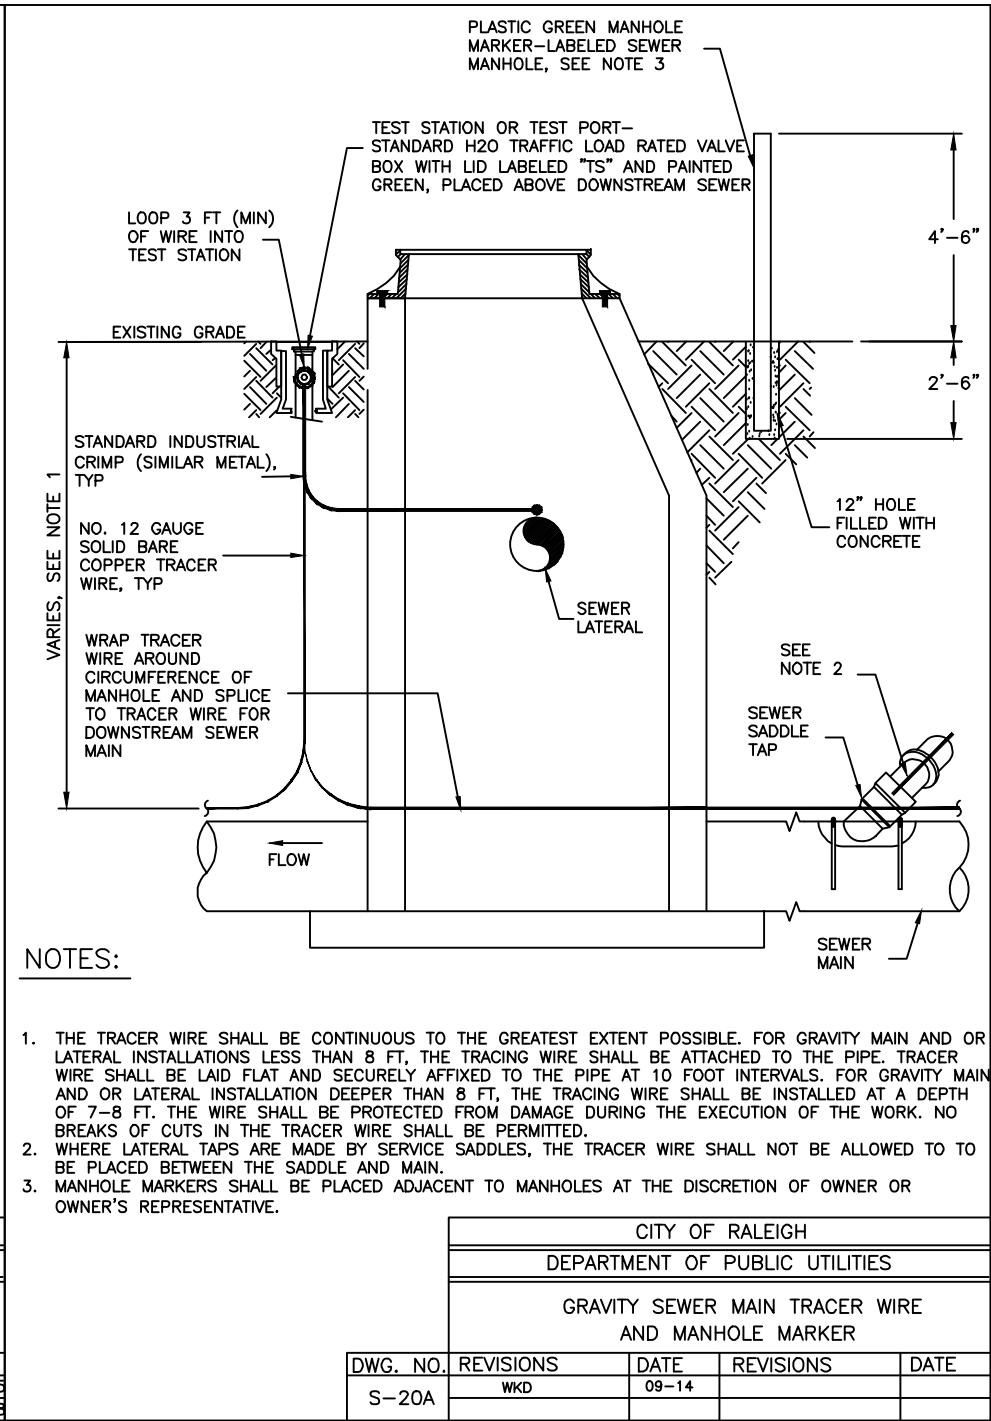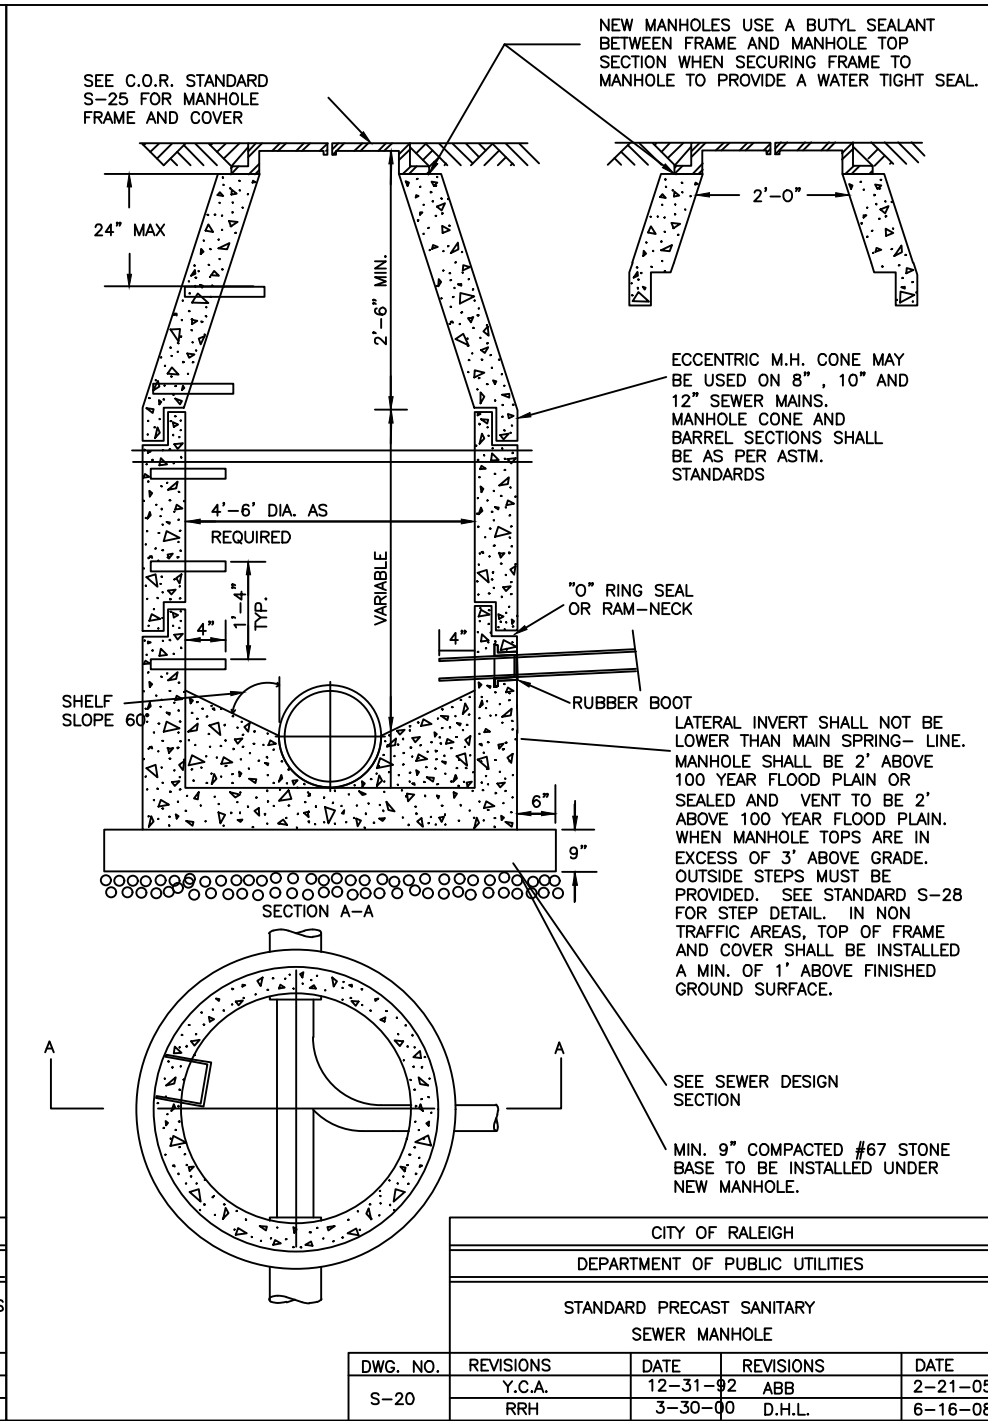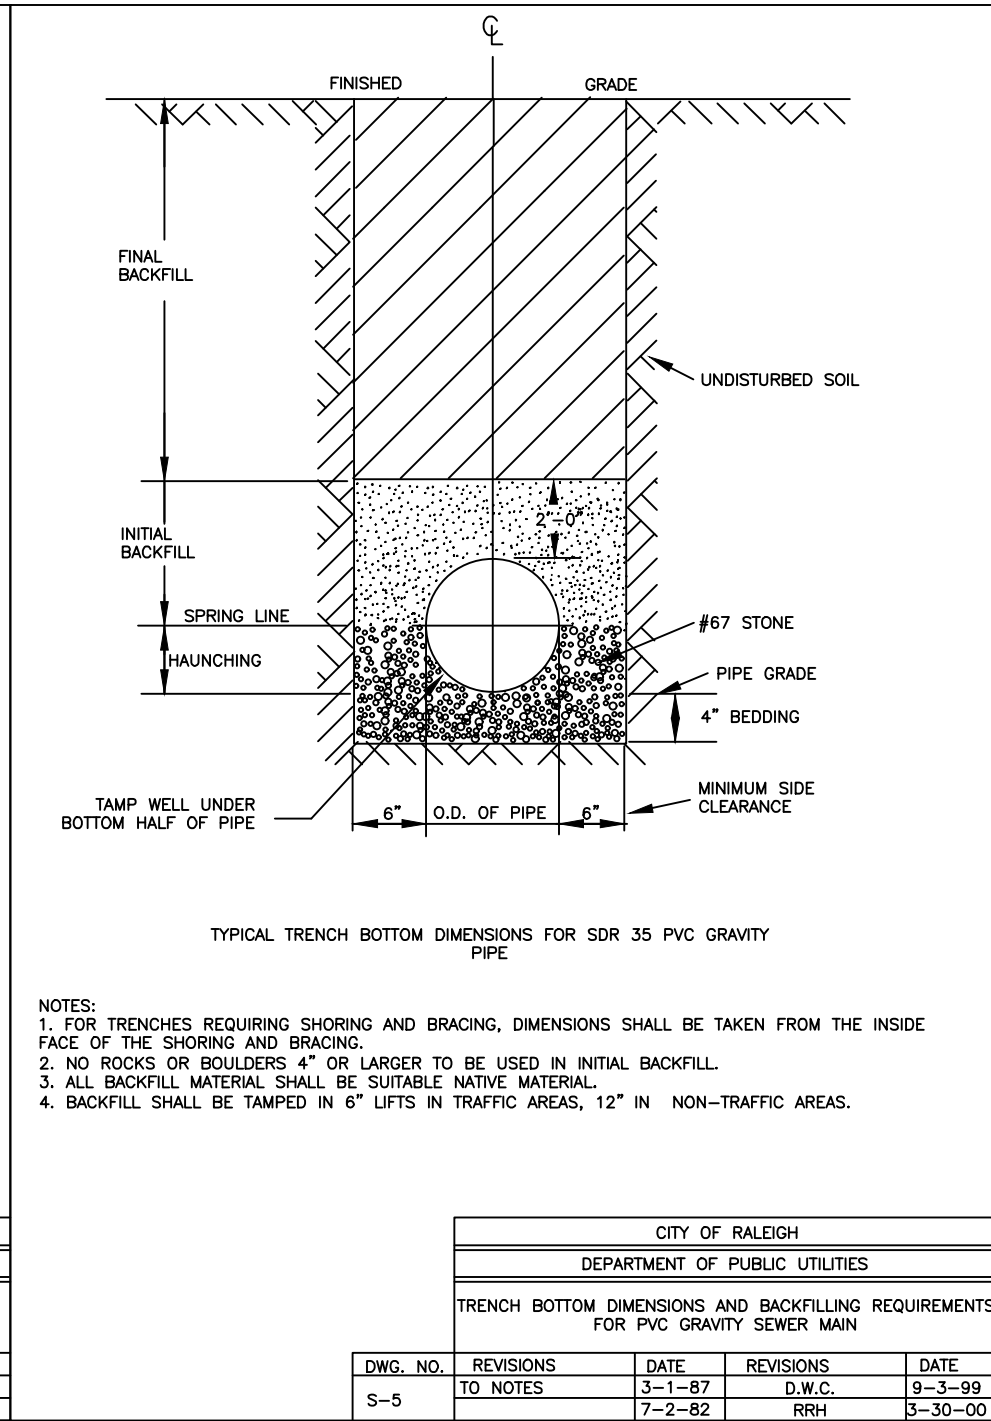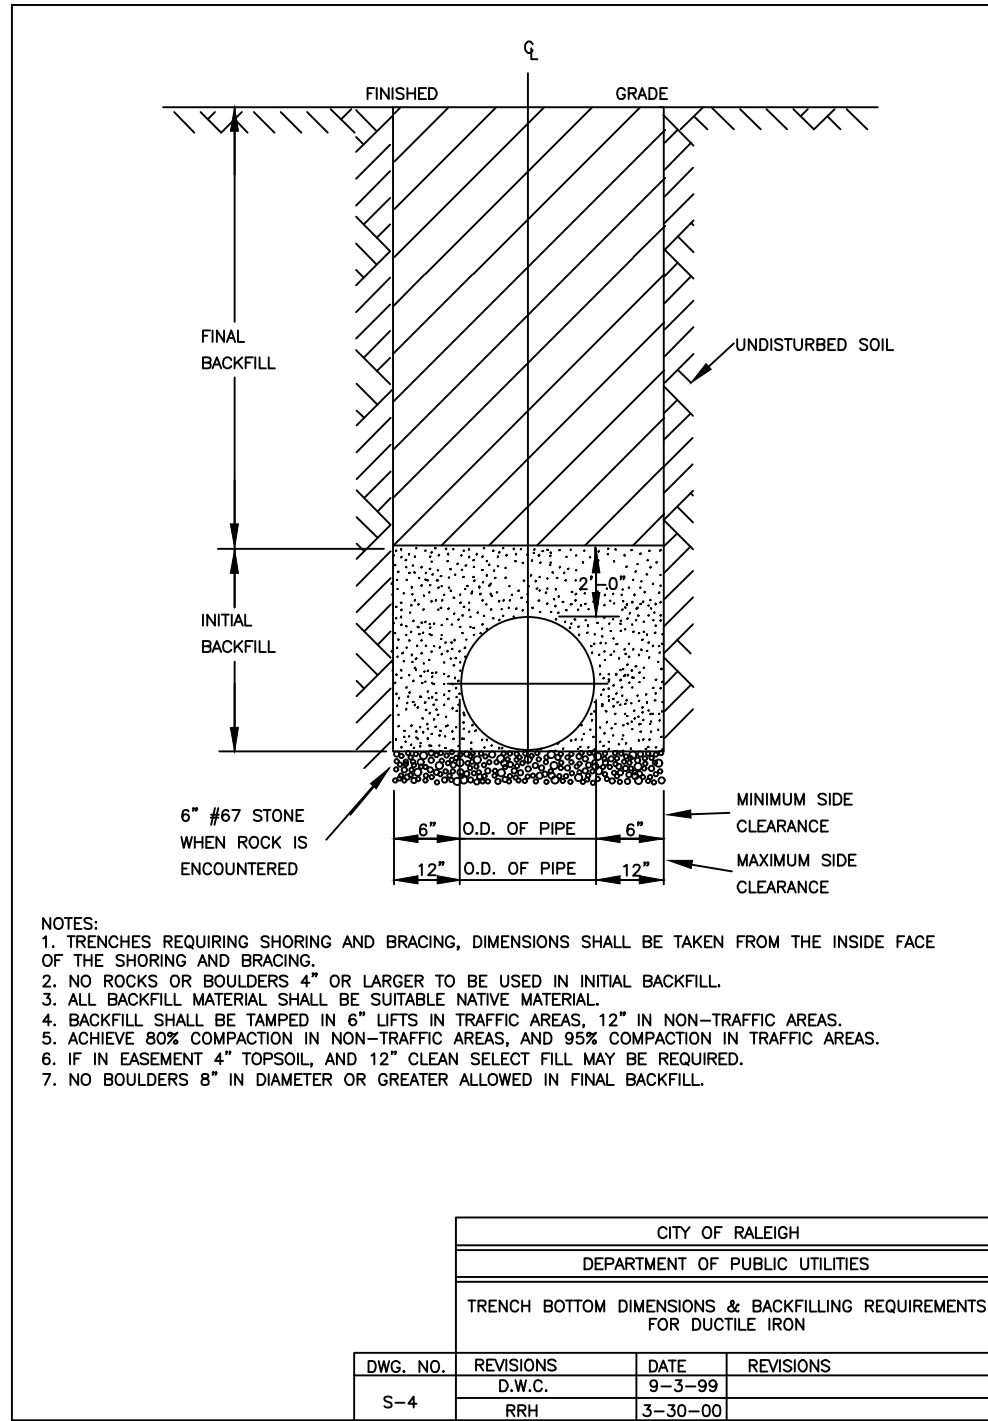

INFRASTRUCTURE CONSTRUCTION PLAN APPROVAL	
CITY OF RALEIGH - PLANS AUTHORIZED FOR CONSTRUCTION	
All Construction must be in accordance with all Local, State, and Federal Rules and Regulations.	
PUBLIC UTILITIES	

PUD

HEMNITZ DESIGN LLP

8522-204 SIX FORKS ROAD
RALEIGH, NORTH CAROLINA 27615
919.845.7600 PHONE
919.845.7703 FAX
ENGR. FIRM LICENSE NO. F-0843

NORTH CAROLINA
Professional Engineer
MICHAEL L. SCHNEIDER
2/04/25

901 MACK TODD ROAD


901 MACK TODD ROAD
ZEBULON, NORTH CAROLINA

ISSUED: 04 FEB 2025

REVISIONS:

DRAWN BY: MLS
CHECKED BY: MLS
PROJECT: CPMTRZ

DETAILS

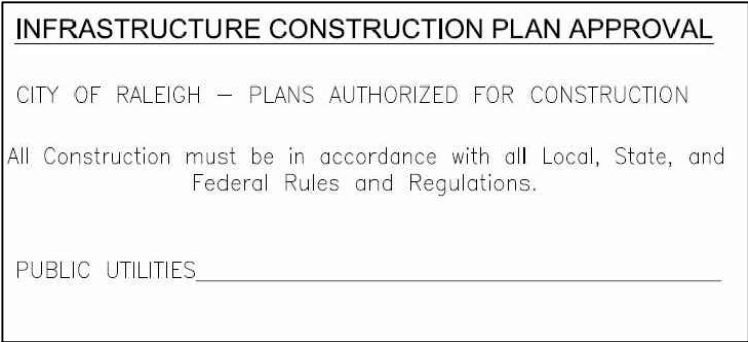


ISSUED: 04 FEB 2025

REVISIONS:


[illegible]

DRAWN BY: **MLS**
CHECKED BY: **MLS**
PROJECT: **CPMTRZ**

DETAILS

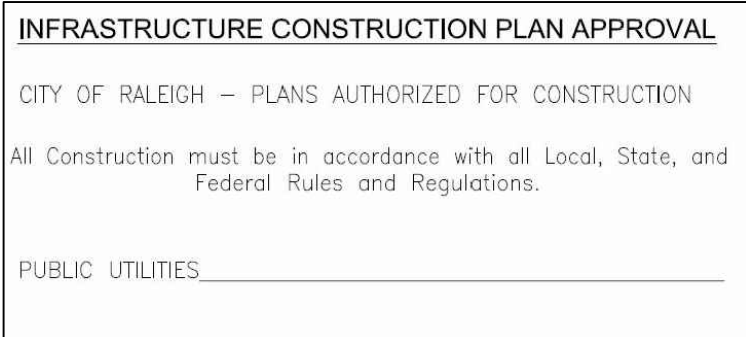DWG. NO. **SITE 15**

EFFECTIVE: 01/31/08

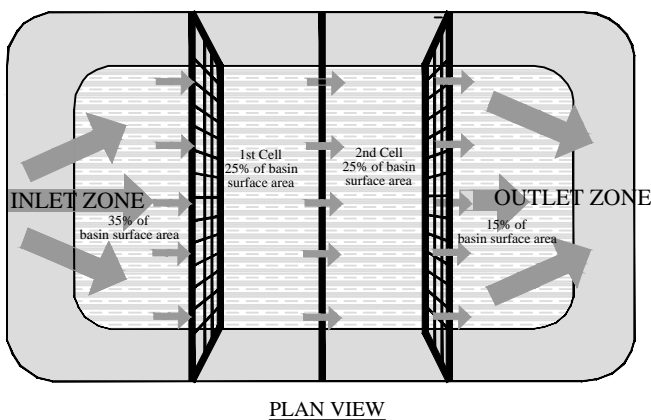


- NOTES:
1. Baffle material should be secured at the bottom and sides using staples or by trenching as for silt fence.
 2. Most of the sediment will accumulate in the 1st bay, which should be readily accessible for maintenance.
 3. Provide 1 baffle for every 20 feet of length. Provide 5 baffles for drainage areas greater than 10 acres.
 4. Baffles shall be 700 GCS Coir Erosion Blanket.
 5. Tops of baffles should be 2 inches lower than the top of the berms.
- MAINTENANCE NOTES:
1. INSPECT BAFFLES FOR REPAIR ONCE A WEEK AND AFTER EACH 1" RAINFALL.
 2. MAINTAIN ACCESS TO BAFFLES AND MAKE ANY REPAIRS IMMEDIATELY.
 3. REMOVE SEDIMENT DEPOSITS WHEN IT REACHES HALF FULL.
 4. AVOID DAMAGING BAFFLES DURING CLEANOUT AND REPLACE IF DAMAGED.
 5. REMOVE BAFFLES AND SEDIMENT DEPOSITS AFTER CONTRIBUTING DRAINAGE AREA HAS BEEN PERMANENTLY STABILIZED.



STANDARD BAFFLES DETAIL

EFFECTIVE: 01/31/08

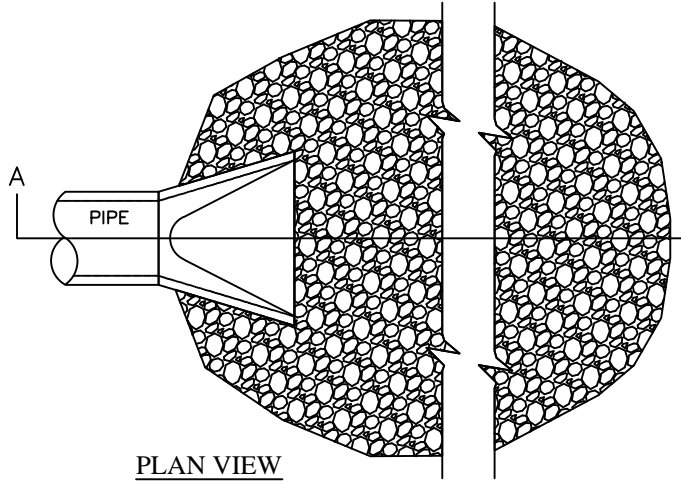


- NOTES:
1. L = THE LENGTH OF THE RIPRAP APRON.
 2. d = 1.5 TIMES THE MAXIMUM STONE DIAMETER BUT NOT LESS THAN 6" (INCHES).
 3. IN A WELL-DEFINED CHANNEL EXTEND THE APRON UP THE CHANNEL BANKS TO AN ELEVATION OF 6" (INCHES) ABOVE THE MAXIMUM TAILWATER DEPTH OR TO THE TOP OF THE BANK, WHICHEVER IS LESS.
 4. A FILTER BLANKET OR FILTER FABRIC SHOULD BE INSTALLED BETWEEN THE RIPRAP AND SOIL FOUNDATION.
- MAINTENANCE NOTES:
1. INSPECT RIPRAP OUTLET STRUCTURES WEEKLY AND AFTER SIGNIFICANT (1 INCH OR GREATER) RAINFALL EVENTS TO SEE IF ANY EROSION AROUND OR BELOW THE RIPRAP HAS TAKEN PLACE, OR IF STONES HAVE BEEN DISLOOSED. IMMEDIATELY MAKE ALL NEEDED REPAIRS TO PREVENT FURTHER DAMAGE.



STANDARD PIPE OUTLET TO WELL-DEFINED CHANNEL

EFFECTIVE: 01/31/08

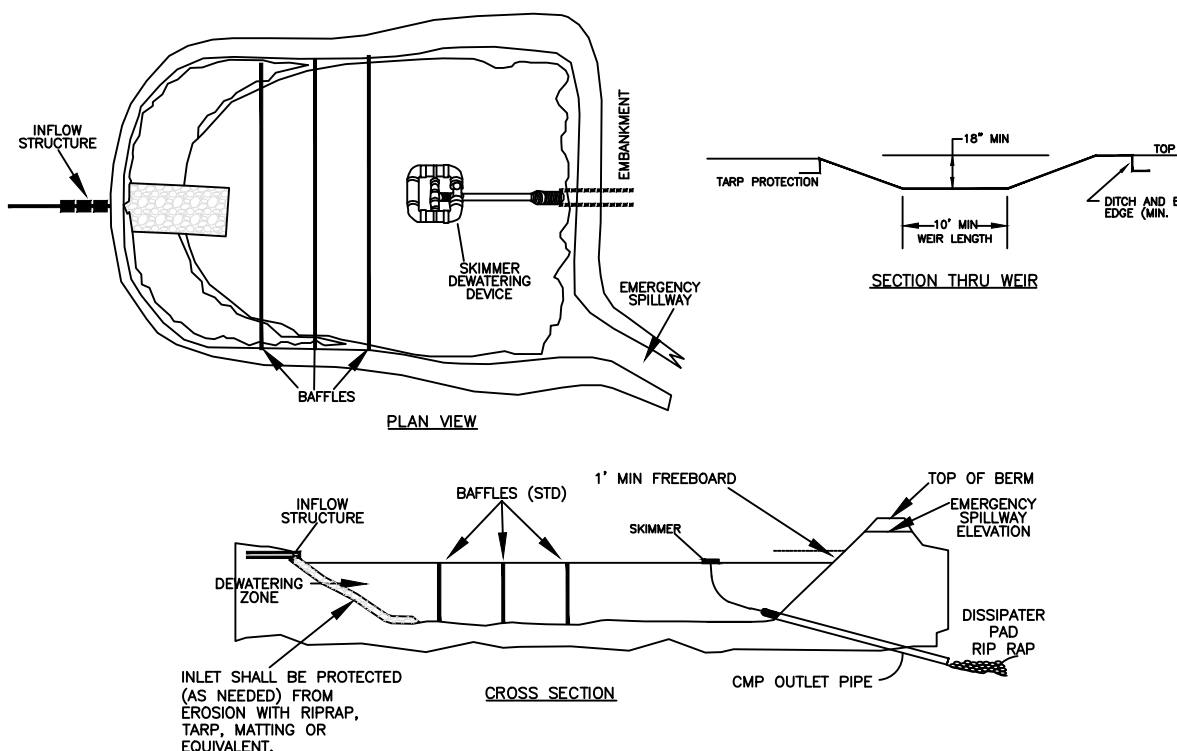


- MAINTENANCE NOTES:
1. INSPECT THE BASIN ON A REGULAR BASIS AND AFTER EVERY SIGNIFICANT RAINFALL EVENT (1 INCH OR GREATER).
 2. CLEAN OUT THE BASIN WHEN SEDIMENT ACCUMULATIONS REACH APPROXIMATELY ONE-HALF THE HEIGHT OF THE FIRST OUTLET.
 3. CHECK THE SKIMMER TO MAKE SURE THAT IT IS NOT CLOGGED WITH SEDIMENT.
 4. CHECK THE FABRIC LINER SPILLWAY FOR DAMAGE.
 5. CHECK THE COIR FIBER MAT AT THE OUTLET OF THE SKIMMER TO DETERMINE IF A REPLACEMENT IS NEEDED.
 6. DURING WINTER, SUPPORT THE SKIMMER AT AN ANGLE SUCH THAT WATER DOES NOT STAGNATE INSIDE THE SKIMMER. THIS SKIMMER SHOULD BE REPAIRED IMMEDIATELY.
 7. REPAIR SEEDS AND REPLACE MATINGS ON THE SIDE SLOPE AREAS THAT HAVE ERODED OR HAVE BECOME DAMAGED BY EROSION FROM RAIN FLOW.
 8. REMOVE SEDIMENT FROM THE SKIMMER AND INSURE THE SKIMMER IS OPERATING PROPERLY.
 9. INSPECT THE BAFFLES AFTER EACH RAIN FROM FOR EROSION DAMAGE AND SEDIMENT ACCUMULATIONS.




STANDARD SKIMMER BASIN

EFFECTIVE: 01/31/08

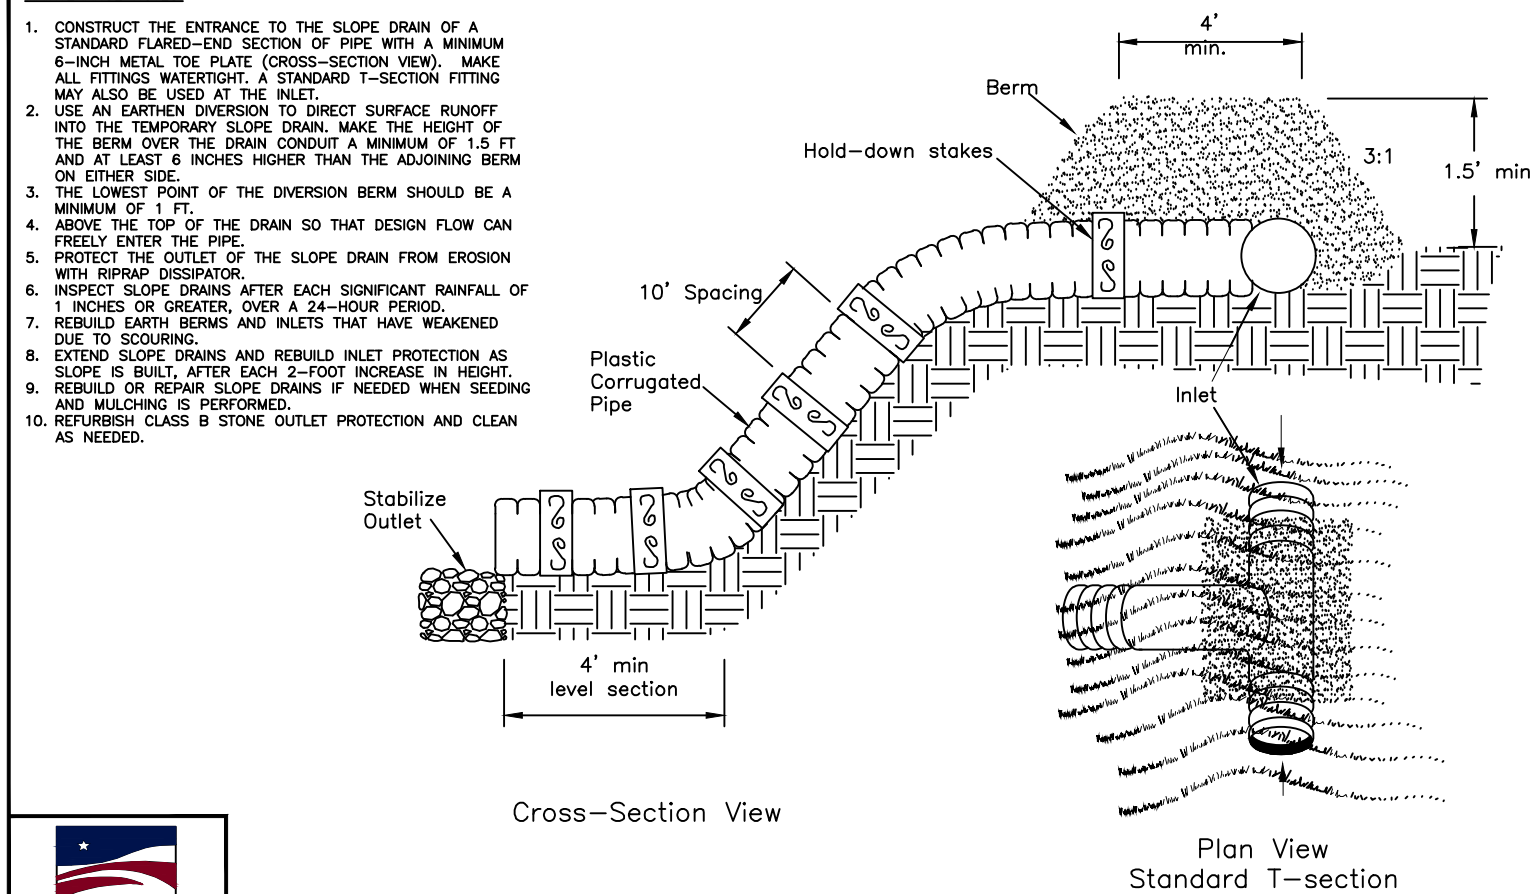

STANDARD TEMPORARY SLOPE DRAIN

EFFECTIVE: 01/31/08

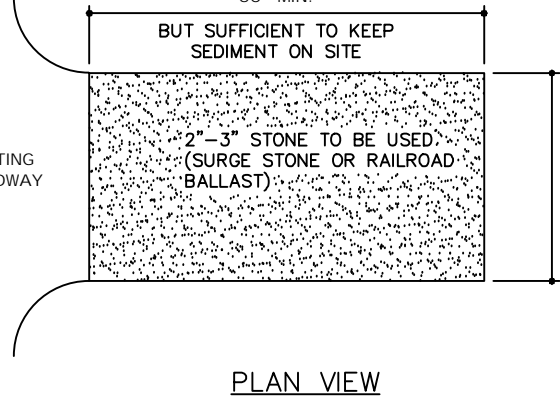


- NOTES:
1. INSTALL SILT FENCE OR TREE PROTECTION FENCE TO ENSURE CONSTRUCTION ENTRANCE IS USED BY VEHICLES.
 2. IF MUD IS NOT REMOVED FROM TIRES AFTER VEHICLE TRAVELS OVER STONE, THE TIRES OF THE VEHICLE MUST BE WASHED BEFORE ENTERING PUBLIC ROADS.
- MAINTENANCE NOTES:
1. THE GRAVEL CONSTRUCTION ENTRANCE MUST BE MAINTAINED IN A CONDITION TO PREVENT TRACKING OR DIRECT FLOW OF MUD ONTO ADJACENT ROADWAYS.
 2. REPLACEMENT OF STONE MAY BE NECESSARY TO ENSURE THE GRAVEL ENTRANCE FUNCTIONS PROPERLY.
 3. REPLENISHMENT OF STONE MAY BE NECESSARY.
 4. FREQUENT CHECKS OF THE DEVICE AND TIMELY MAINTENANCE SHOULD BE COMPLETED.
 5. ANY MATERIAL TRACKED ONTO THE ROADWAY SHALL BE CLEANED UP IMMEDIATELY.



STANDARD CONSTRUCTION ENTRANCE

EFFECTIVE: 01/31/08

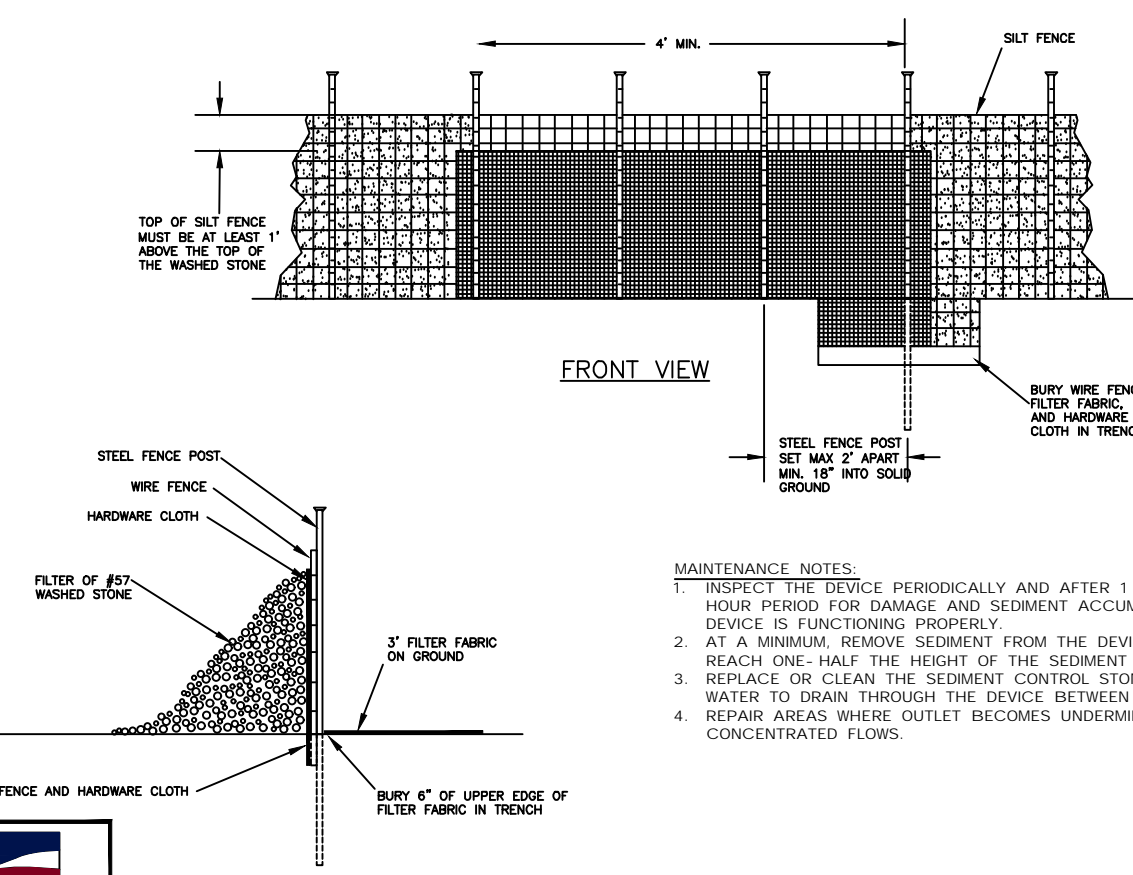


- MAINTENANCE NOTES:
1. INSPECT THE DEVICE PERIODICALLY AND AFTER 1 INCH RAINFALL OVER 24 HOUR PERIOD FOR DAMAGE AND SEDIMENT ACCUMULATION TO CONFIRM THE DEVICE IS FUNCTIONING PROPERLY.
 2. AT A MINIMUM, REMOVE SEDIMENT FROM THE DEVICE WHEN ACCUMULATIONS REACH ONE-HALF THE HEIGHT OF THE SEDIMENT CONTROL STONE.
 3. REPLACE OR CLEAN THE SEDIMENT CONTROL STONE AS NEEDED TO ALLOW WATER TO SEAR THROUGH THE DEVICE BETWEEN DAMNALL EVENTS.
 4. REPAIR AREAS WHERE OUTLET BECOMES UNDERMINED DUE TO CONCENTRATED FLOWS.



STANDARD SILT FENCE OUTLET

EFFECTIVE: 01/31/08

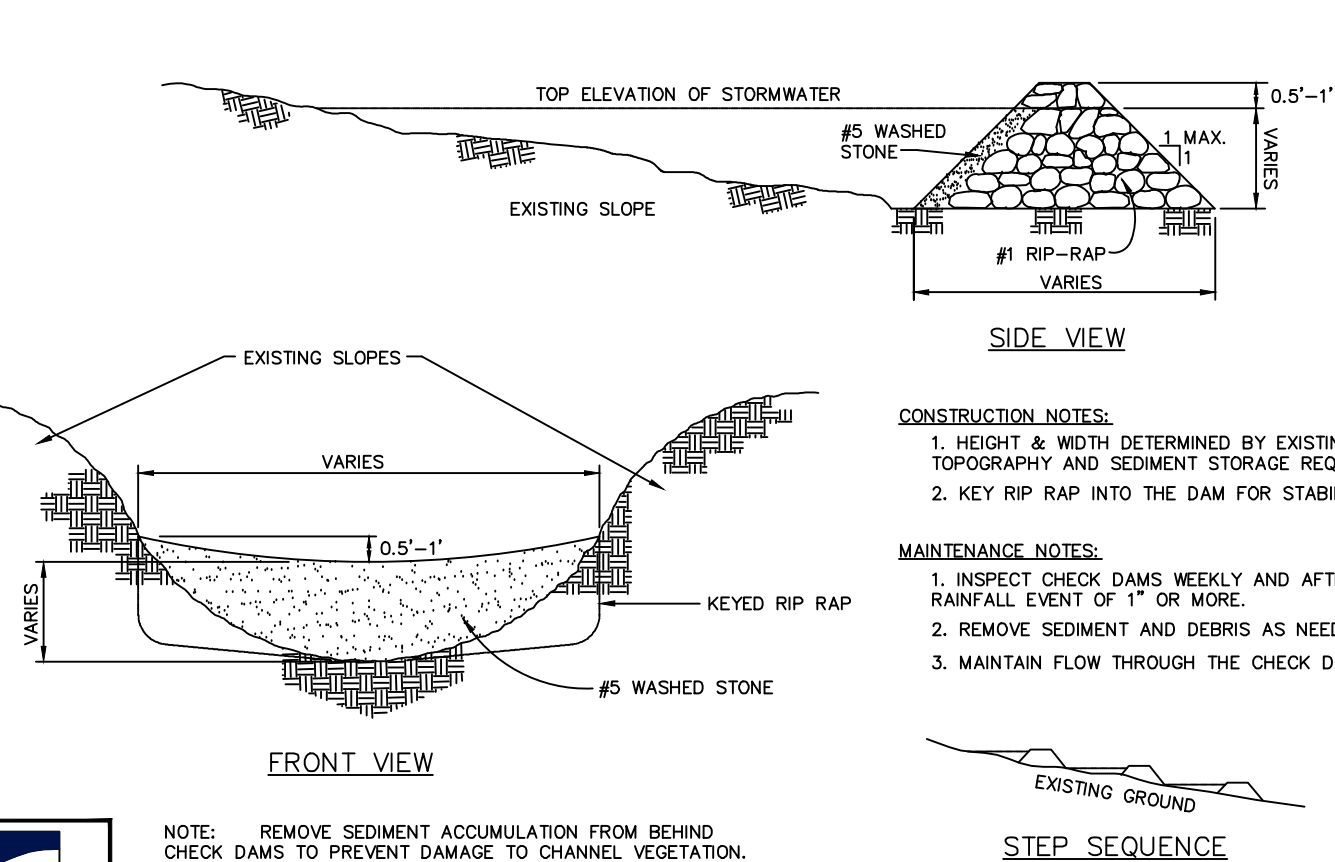


- CONSTRUCTION NOTES:
1. HEIGHT & WIDTH DETERMINED BY EXISTING TOPOGRAPHY AND SEDIMENT STORAGE REQUIRED.
 2. KEY RIP RAP INTO THE DAM FOR STABILIZATION.
- MAINTENANCE NOTES:
1. INSPECT CHECK DAMS WEEKLY AND AFTER EVERY RAINFALL EVENT OF 1" OR MORE.
 2. REMOVE SEDIMENT AND DEBRIS AS NEEDED.
 3. MAINTAIN FLOW THROUGH THE CHECK DAM.



STANDARD CHECK DAM

EFFECTIVE: 01/31/08

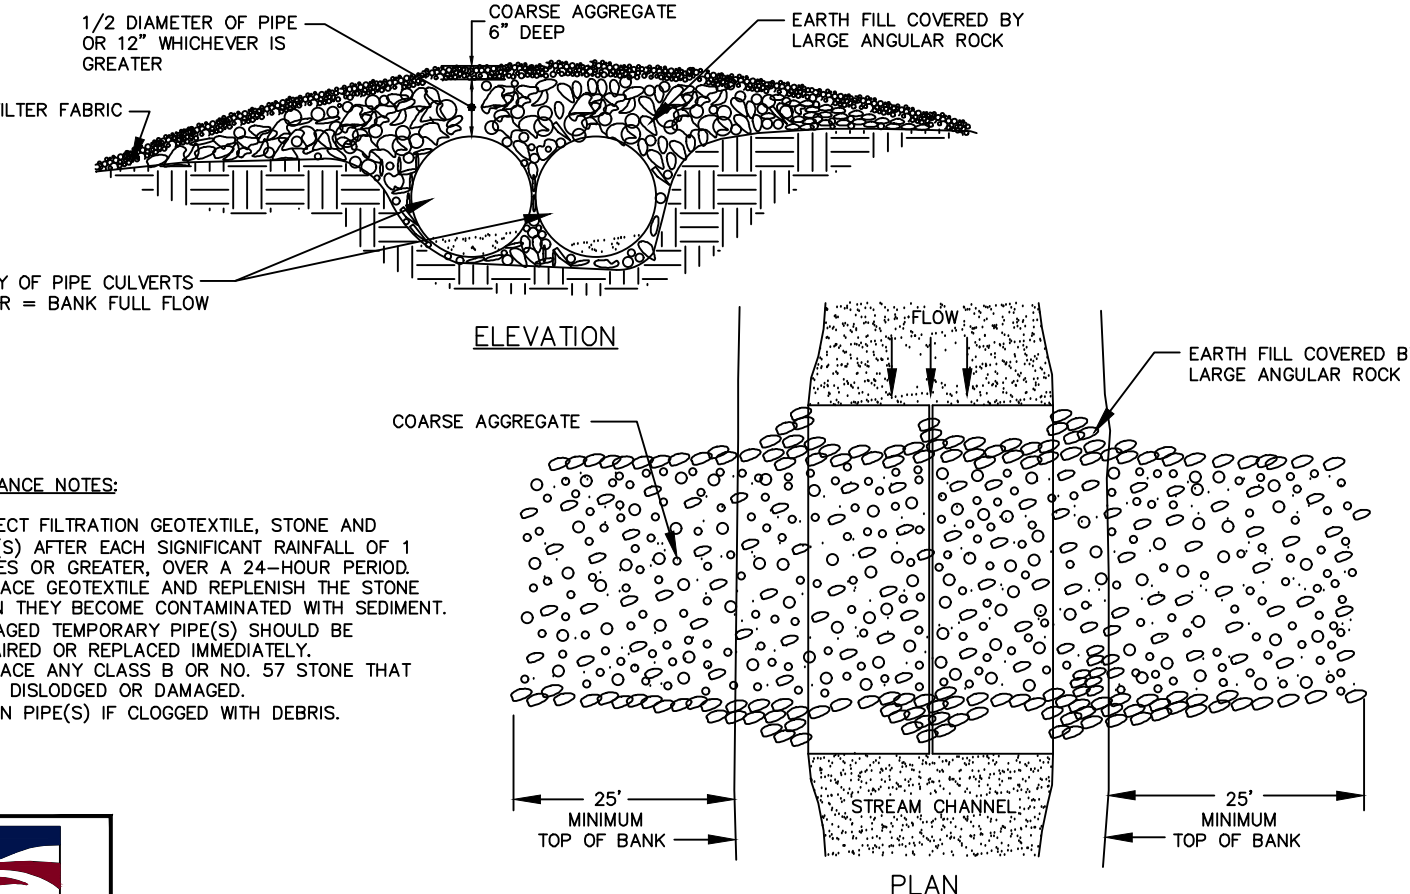

STANDARD TEMPORARY STREAM CROSSING


EFFECTIVE: 01/31/08

NOTES:

1. TEMPORARY DIVERSION DITCH TO BE USED TO INTERCEPT FLOW AND/OR DIVERT TO A SEDIMENT CONTROL MEASURE OR BMP.
2. STABILIZE DIVERSION DITCH BERM WITH TEMPORARY SEEDING, MULCH WITH TAC, AND/OR EROSION CONTROL NETTING.


MAINTENANCE NOTES:

1. INSPECT ONCE A WEEK AND AFTER EVERY 1" RAINFALL.
2. SILT SHALL BE REMOVED WHEN DITCH IS ONE-HALF FULL.
3. DITCH SHALL BE RECONSTRUCTED WHEN DAMAGED BY EQUIPMENT OR COVERED BY FILL.
4. CHECK OUTLETS AND MAKE TIMELY REPAIRS AS NEEDED.
5. AFTER DRAINAGE AREA IS PERMANENTLY STABILIZED, PLACE WASTE MATERIAL IN DITCH TO BLEND WITH NATURAL GROUND AND STABILIZE.

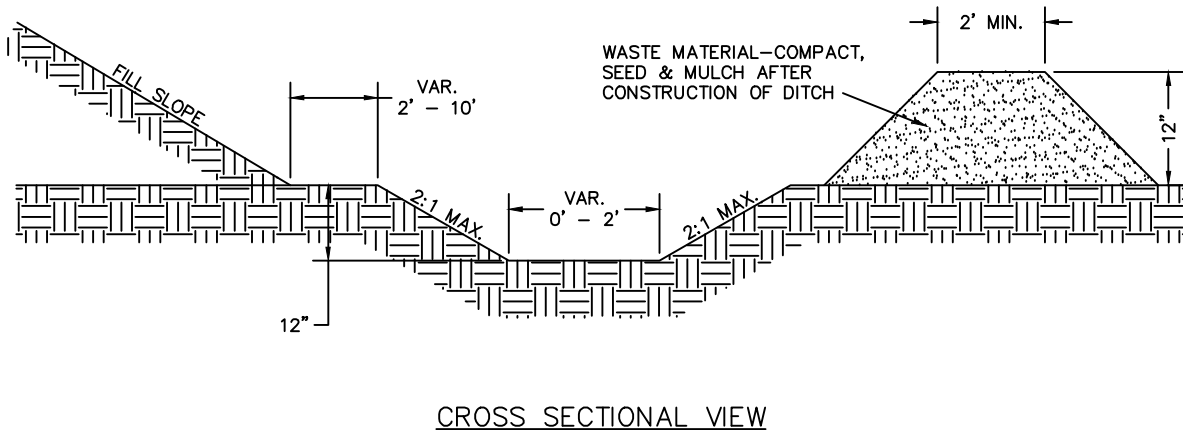

STANDARD TEMPORARY DIVERSION DITCH

EFFECTIVE: 01/31/08

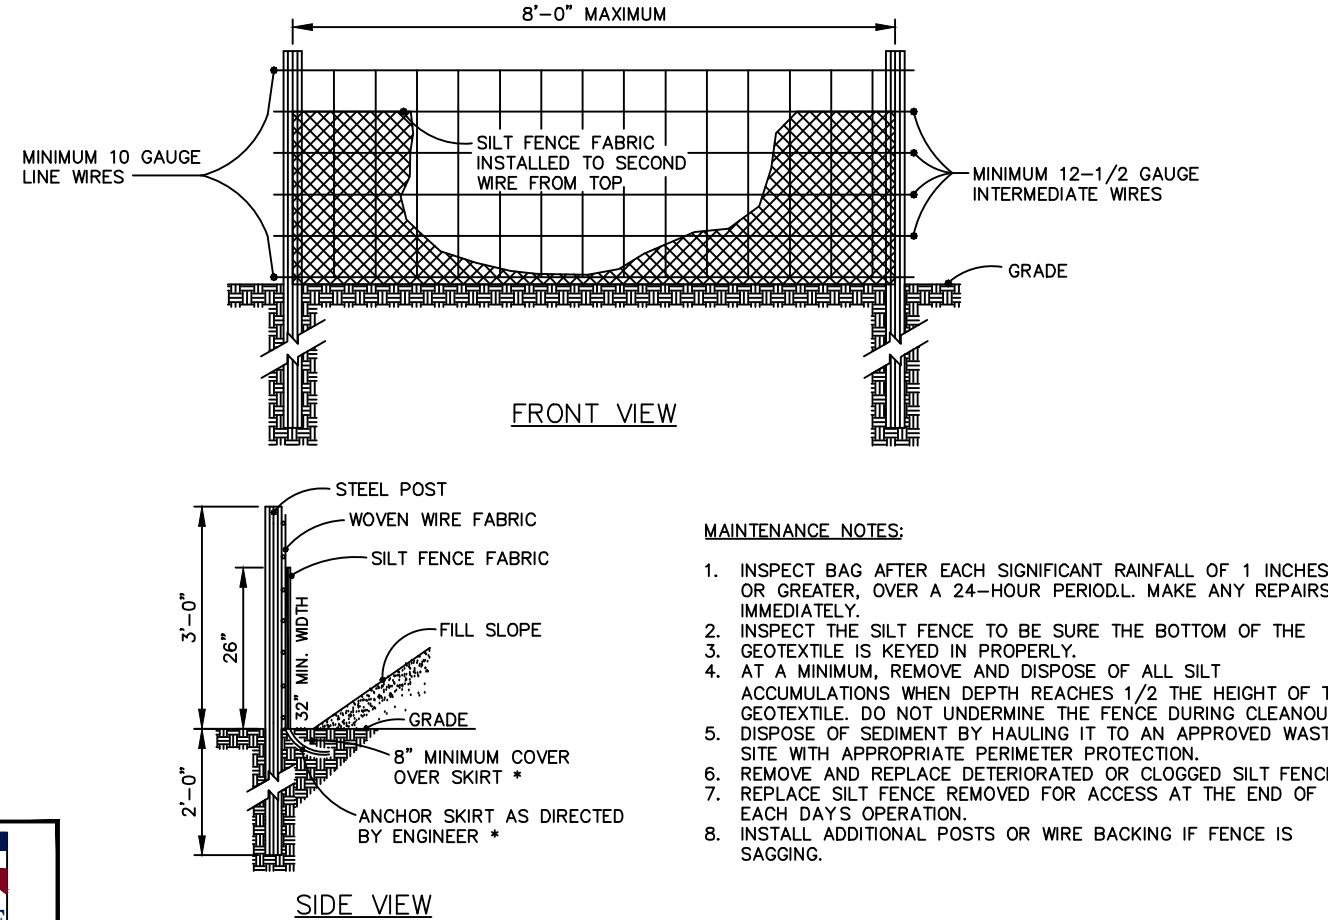


- MAINTENANCE NOTES:
1. INSPECT BAG AFTER EACH SIGNIFICANT RAINFALL OF 1 INCHES OR GREATER, OVER A 24-HOUR PERIOD. MAKE ANY REPAIRS IMMEDIATELY.
 2. INSPECT THE SILT FENCE TO BE SURE THE BOTTOM OF THE GEOTEXTILE IS KEPT IN PROPERLY.
 3. AT A MINIMUM, REMOVE AND DISPOSE OF ALL SILT ACCUMULATIONS WHEN DEPTH REACHES 1/2 THE HEIGHT OF THE GEOTEXTILE. DO NOT UNDERMINE THE FENCE DURING CLEANOUT.
 4. DISPOSE OF SEDIMENT BY HAULING IT TO AN APPROVED WASTE SITE WITH APPROPRIATE PERMITTER PROTECTION.
 5. REMOVE AND REPLACE DETERIORATED OR CLOGGED SILT FENCE.
 6. REPLACE SILT FENCE REMOVED FOR ACCESS AT THE END OF EACH DAY'S OPERATION.
 7. INSTALL ADDITIONAL POSTS OR WIRE BACKING IF FENCE IS SAGGING.



STANDARD TEMPORARY SILT FENCE

EFFECTIVE: 01/31/08

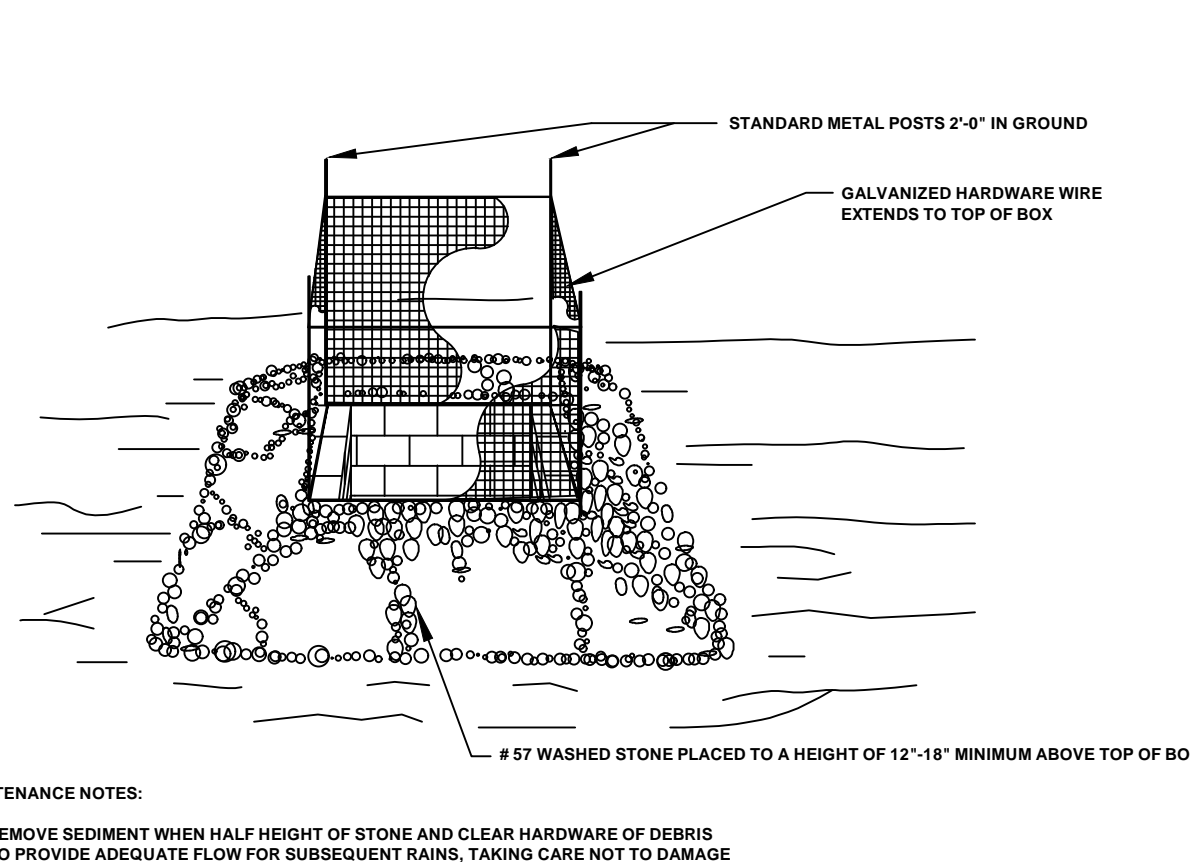

- MAINTENANCE NOTES:
1. REMOVE SEDIMENT WHEN HALF HEIGHT OF STONE AND CLEAR HARDWARE OF DEBRIS TO PROVIDE ADEQUATE FLOW FOR SUBSEQUENT RAINS. TAKING CARE NOT TO DAMAGE OR UNDERCUT HARDWARE DURING SEDIMENT REMOVAL.
 2. REPLACE STONE AS NEEDED.



STANDARD GRAVEL YARD INLET PROTECTION

EFFECTIVE: 01/31/08

NPDES Stormwater Discharge Permit for Construction Activities (NCGO1)

NCDENR/Division of Water Quality

NEW STABILIZATION TIMEFRAMES

(Effective Aug. 3, 2011)

SITE AREA DESCRIPTION	STABILIZATION TIMEFRAME EXCEPTIONS	
Perimeter dikes, swales, ditches, slopes	7 days	None
High Quality Water (HQP) Zones	7 days	None
Slopes steeper than 3:1	7 days	If slopes are 10' or less in length and are not steeper than 2:1, 14 days are allowed.
Slopes 3:1 or flatter	14 days	7 days for slopes greater than 50' in length.
All other areas with slopes flatter than 4:1	14 days	None, except for perimeters and HQW Zones.

Seedbed Preparation:

1. Chisel compacted areas and spread topsoil three inches deep over adverse soil conditions, if available.
2. Rip the entire area to six inches deep.
3. Remove all loose rock, roots and other obstructions, leaving surface reasonably smooth and uniform.
4. Apply agricultural lime, fertilizer and superphosphate uniformly and mix with soil (see mixture below).
5. Continue tillage until a well-pulverized, firm, reasonably uniform seedbed is prepared four to six inches deep.
6. Seed on a freshly prepared seedbed and cover seed lightly with seeding equipment or cultipack after seeding.
7. Mulch immediately after seeding and anchor mulch.
8. Inspect all seeded areas and make necessary repairs or reseeds within the planting season, if possible. If stand should be more than 60% damaged, re-establish following the original lime, fertilizer and seeding rates.
9. Consult S&EC Environmental Engineers on maintenance treatment and fertilization after permanent cover is established.

Mixture

Agricultural Limestone	2 tons/acre (3 tons/acre in clay soils)
Fertilizer	1,000 lbs/acre – 10-10-10
Superphosphate	500 lbs/acre – 20% analysis
Mulch	2 tons/acre – small grain straw
Anchor	Asphalt emulsion at 300 gals/acre

Seding Schedule

For Shoulders, Side Ditches, Slopes (Max 3:1):

Date	Type	Planting Rate
Aug 15 – Nov 1	Tall Fescue	300 lbs/acre
Nov 1 – Mar 1	Tall Fescue & Abruzzi Rye	300 lbs/acre
Mar 1 – Apr 15	Tall Fescue	300 lbs/acre
Apr 15 – Jun 30	Hulled Common Bermudagrass	25 lbs/acre
Jul 1 – Aug 15	Tall Fescue AND Browntop Millet or Sorghum-Sudan Hybrids***	125 lbs/acre (Tall Fescue); 35 lbs/acre (Browntop Millet); 30 lbs/acre (Sorghum-Sudan Hybrids)

For Shoulders, Side Ditches, Slopes (3:1 to 2:1):

Date	Type	Planting Rate
Mar 1 – Jun 1	Sericea Lespedeza (scarified) and use the following combinations:	50 lbs/acre (Sericea Lespedeza);
Mar 1 – Apr 15	Add Tall Fescue	120 lbs/acre
Mar 1 – Jun 30	Or add Weeping Love grass	10 lbs/acre
Mar 1 – Jun 30	Or add Hulled Common Bermudagrass	25 lbs/acre
Jun 1 – Sept 1	Tall Fescue AND Browntop Millet or Sorghum-Sudan Hybrids***	120 lbs/acre (Tall Fescue); 35 lbs/acre (Browntop Millet); 30 lbs/acre (Sorghum-Sudan Hybrids)
Sept 1 – Mar 1	Sericea Lespedeza (unhulled unscarified) AND Tall Fescue	70 lbs/acre (Sericea Lespedeza); 120 lbs/acre (Tall Fescue)
Nov 1 – Mar 1	AND Abruzzi Rye	25 lbs/acre

PLD

HEMNITZ DESIGN LLP

8522-204 SIX FORKS ROAD
RALEIGH, NORTH CAROLINA 27615
919.845.7600 PHONE
919.845.7703 FAX
ENGR. FIRM LICENSE NO. F-0843



901 MACK TODD ROAD

901 MACK TODD ROAD

ZEBULON, NORTH CAROLINA

ISSUED: **04 FEB 2025**

REVISIONS:

DRAWN BY: **MLS**

CHECKED BY: **MLS**

PROJECT: **CPMTRZ**

DETAILS

DWG. NO. **SITE 16**

F:\Projects\CPMTRZ\Drawings\Site\CPMTRZ_details.dwg - DETAILS Mar 18, '25 - 11:02am

GROUND STABILIZATION AND MATERIALS HANDLING PRACTICES FOR COMPLIANCE WITH THE NCG01 CONSTRUCTION GENERAL PERMIT

Implementing the details and specifications on this plan sheet will result in the construction activity being considered compliant with the Ground Stabilization and Materials Handling sections of the NCG01 Construction General Permit (Sections E and F, respectively). The permittee shall comply with the Erosion and Sediment Control plan approved by the delegated authority having jurisdiction. All details and specifications shown on this sheet may not apply depending on site conditions and the delegated authority having jurisdiction.

SECTION E: GROUND STABILIZATION

Required Ground Stabilization Timeframes		
Site Area Description	Stabilize within this many calendar days after ceasing land disturbance	Timeframe variations
(a) Perimeter dikes, swales, ditches, and perimeter slopes	7	None
(b) High Quality Water (HQW) Zones	7	None
(c) Slopes steeper than 3:1	7	If slopes are 10' or less in length and are not steeper than 2:1, 14 days are allowed
(d) Slopes 3:1 to 4:1	14	- 7 days for slopes greater than 50' in length and with slopes steeper than 4:1 - 7 days for perimeter dikes, swales, ditches, perimeter slopes and HQW Zones - 10 days for Falls Lake Watershed
(e) Areas with slopes flatter than 4:1	14	- 7 days for perimeter dikes, swales, ditches, perimeter slopes and HQW Zones - 10 days for Falls Lake Watershed unless there is zero slope

Note: After the permanent cessation of construction activities, any areas with temporary ground stabilization shall be converted to permanent ground stabilization as soon as practicable but in no case longer than 90 calendar days after the last land disturbing activity. Temporary ground stabilization shall be maintained in a manner to render the surface stable against accelerated erosion until permanent ground stabilization is achieved.

GROUND STABILIZATION SPECIFICATION

Stabilize the ground sufficiently so that rain will not dislodge the soil. Use one of the techniques in the table below:

Temporary Stabilization	Permanent Stabilization
<ul style="list-style-type: none">Temporary grass seed covered with straw or other mulches and tackifiersHydroseedingRolled erosion control products with or without temporary grass seedAppropriately applied straw or other mulchPlastic sheeting	<ul style="list-style-type: none">Permanent grass seed covered with straw or other mulches and tackifiersGeotextile fabrics such as permanent soil reinforcement mattingHydroseedingShrubs or other permanent plantings covered with mulchUniform and evenly distributed ground cover sufficient to restrain erosionStructural methods such as concrete, asphalt or retaining wallsRolled erosion control products with grass seed

POLYACRYLAMIDES (PAMS) AND FLOCCULANTS

- Select flocculants that are appropriate for the soils being exposed during construction, selecting from the *NC DWR List of Approved PAMS/Flocculants*.
- Apply flocculants at or before the inlets to Erosion and Sediment Control Measures.
- Apply flocculants at the concentrations specified in the *NC DWR List of Approved PAMS/Flocculants* and in accordance with the manufacturer's instructions.
- Provide ponding area for containment of treated Stormwater before discharging offsite.
- Store flocculants in leak-proof containers that are kept under storm-resistant cover or surrounded by secondary containment structures.

EQUIPMENT AND VEHICLE MAINTENANCE

- Maintain vehicles and equipment to prevent discharge of fluids.
- Provide drip pans under any stored equipment.
- Identify leaks and repair as soon as feasible, or remove leaking equipment from the project.
- Collect all spent fluids, store in separate containers and properly dispose as hazardous waste (recycle when possible).
- Remove leaking vehicles and construction equipment from service until the problem has been corrected.
- Bring used fuels, lubricants, coolants, hydraulic fluids and other petroleum products to a recycling or disposal center that handles these materials.

LITTER, BUILDING MATERIAL AND LAND CLEARING WASTE

- Never bury or burn waste. Place litter and debris in approved waste containers.
- Provide a sufficient number and size of waste containers (e.g dumpster, trash receptacle) on site to contain construction and domestic wastes.
- Locate waste containers at least 50 feet away from storm drain inlets and surface waters unless no other alternatives are reasonably available.
- Locate waste containers on areas that do not receive substantial amounts of runoff from upland areas and does not drain directly to a storm drain, stream or wetland.
- Cover waste containers at the end of each workday and before storm events or provide secondary containment. Repair or replace damaged waste containers.
- Anchor all lightweight items in waste containers during times of high winds.
- Empty waste containers as needed to prevent overflow. Clean up immediately if containers overflow.
- Dispose waste off-site at an approved disposal facility.
- On business days, clean up and dispose of waste in designated waste containers.

PAINT AND OTHER LIQUID WASTE


- Do not dump paint and other liquid waste into storm drains, streams or wetlands.
- Locate paint washouts at least 50 feet away from storm drain inlets and surface waters unless no other alternatives are reasonably available.
- Contain liquid wastes in a controlled area.
- Containment must be labeled, sized and placed appropriately for the needs of site.
- Prevent the discharge of soaps, solvents, detergents and other liquid wastes from construction sites.

PORTABLE TOILETS

- Install portable toilets on level ground, at least 50 feet away from storm drains, streams or wetlands unless there is no alternative reasonably available. If 50 foot offset is not attainable, provide relocation of portable toilet behind silt fence or place on a gravel pad and surround with sand bags.
- Provide staking or anchoring of portable toilets during periods of high winds or in high foot traffic areas.
- Monitor portable toilets for leaking and properly dispose of any leaked material. Utilize a licensed sanitary waste hauler to remove leaking portable toilets and replace with properly operating unit.

EARTHEN STOCKPILE MANAGEMENT

- Show stockpile locations on plans. Locate earthen-material stockpile areas at least 50 feet away from storm drain inlets, sediment basins, perimeter sediment controls and surface waters unless it can be shown no other alternatives are reasonably available.
- Protect stockpile with silt fence installed along toe of slope with a minimum offset of five feet from the toe of stockpile.
- Provide stable stone access point when feasible.
- Stabilize stockpile within the timeframes provided on this sheet and in accordance with the approved plan and any additional requirements. Soil stabilization is defined as vegetative, physical or chemical coverage techniques that will restrain accelerated erosion on disturbed soils for temporary or permanent control needs.

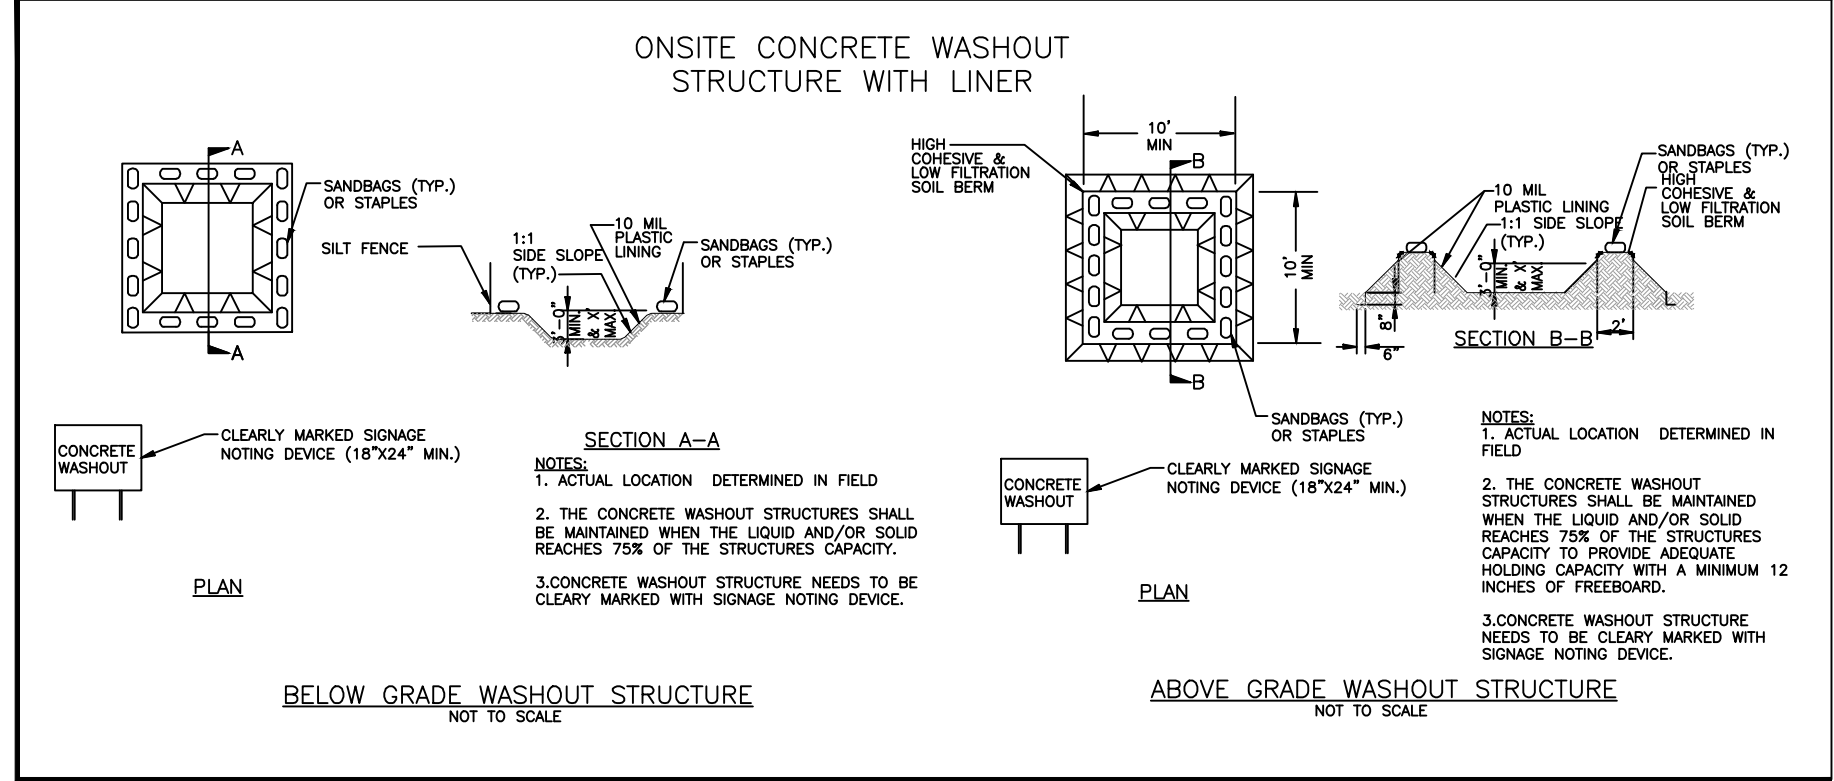

CONCRETE WASHOUTS

- Do not discharge concrete or cement slurry from the site.
- Dispose of, or recycle settled, hardened concrete residue in accordance with local and state solid waste regulations and at an approved facility.
- Manage washout from mortar mixers in accordance with the above item and in addition place the mixer and associated materials on impervious barrier and within lot perimeter silt fence.
- Install temporary concrete washouts per local requirements, where applicable. If an alternate method or product is to be used, contact your approval authority for review and approval. If local standard details are not available, use one of the two types of temporary concrete washouts provided on this detail.
- Do not use concrete washouts for dewatering or storing defective curb or sidewalk sections. Stormwater accumulated within the washout may not be pumped into or discharged to the storm drain system or receiving surface waters. Liquid waste must be pumped out and removed from project.
- Locate washouts at least 50 feet from storm drain inlets and surface waters unless it can be shown that no other alternatives are reasonably available. At a minimum, install protection of storm drain inlet(s) closest to the washout which could receive spills or overflow.
- Locate washouts in an easily accessible area, on level ground and install a stone entrance pad in front of the washout. Additional controls may be required by the approving authority.
- Install at least one sign directing concrete trucks to the washout within the project limits. Post signage on the washout itself to identify this location.
- Remove leavings from the washout when at approximately 75% capacity to limit overflow events. Replace the tarp, sand bags or other temporary structural components when no longer functional. When utilizing alternative or proprietary products, follow manufacturer's instructions.
- At the completion of the concrete work, remove remaining leavings and dispose of in an approved disposal facility. Fill pit, if applicable, and stabilize any disturbance caused by removal of washout.

HERBICIDES, PESTICIDES AND RODENTICIDES

- Store and apply herbicides, pesticides and rodenticides in accordance with label restrictions.
- Store herbicides, pesticides and rodenticides in their original containers with the label, which lists directions for use, ingredients and first aid steps in case of accidental poisoning.
- Do not store herbicides, pesticides and rodenticides in areas where flooding is possible or where they may spill or leak into wells, stormwater drains, ground water or surface water. If a spill occurs, clean area immediately.
- Do not stockpile these materials onsite.

HAZARDOUS AND TOXIC WASTE

- Create designated hazardous waste collection areas on-site.
- Place hazardous waste containers under cover or in secondary containment.
- Do not store hazardous chemicals, drums or bagged materials directly on the ground.

